



Civil Engineering and Development Department
New Territories East Development Office
Suite 1213 Chinachem Golden Plaza
77 Mody Road
Tsim Sha Tsui East
Kowloon

Your reference:

Our reference: HKCEDD10/50/105707

Date: 18 April 2019

Attention: Mr Leung Siu Kau, Kelvin

BY POST

Dear Sirs

Agreement No.: NTE 08/2016

Independent Environmental Checker for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Monthly Environmental Monitoring and Audit Report (March 2019)

We refer to the emails of 10, 16 and 17 April 2019 from Action-United Environmental Services and Consulting attaching a Monthly Environmental Monitoring and Audit Report (March 2019) for the captioned project.

We have no further comment and hereby verify the Monthly Environmental Monitoring and Audit Report (March 2019).

Should you have any queries, please do not hesitate to contact the undersigned or our Ms Angie Chan on 2618 2831.

Yours faithfully

ANewR CONSULTING LIMITED

Adi Lee

Independent Environmental Checker

LYMA/CWA/lhnh

cc CEDD – Mr Matthew Fung (email: mphfung@cedd.gov.hk)
AECOM – Mr Tommy Li (email: c1-srec2@arqaecom.com)
AECOM – Mr Vincent Y H Yuen (email: c2-srec3@arqaecom.com)
AECOM – Mr Brad C W Chan (email: c3-srec4@arqaecom.com)
AUES – Mr T W Tam (email: twtam@fordbusiness.com)

ANewR Consulting Limited

Unit 517, 5/F, Tower A, Regent Centre
63 Wo Yi Hop Road, Kwai Chung, Hong Kong
Tel: (852) 2618 2831 Fax: (852) 3007 8648
Email: info@anewr.com
Web: www.anewr.com



ISO 9001 : 2015
Certificate No.: CC 3988

JOB No.: TCS00864/16



CEDD SERVICE CONTRACT NO. NTE/07/2016

**ENVIRONMENTAL TEAM FOR DEVELOPMENT OF
ANDERSON ROAD QUARRY SITE – SITE FORMATION
AND ASSOCIATED INFRASTRUCTURE WORKS**

**MONTHLY ENVIRONMENTAL MONITORING AND AUDIT
REPORT (MARCH 2019)**

PREPARED FOR

**CIVIL ENGINEERING AND DEVELOPMENT DEPARTMENT
(CEDD)**

Date	Reference No.	Prepared By	Certified By
16 April 2019	TCS00864/16/600/R0263v2		
		Nicola Hon (Environmental Consultant)	Tam Tak Wing (Environmental Team Leader)

Version	Date	Remarks
1	10 April 2019	First Submission
2	16 April 2019	Amended according to the IEC's comments on 12 April 2019



Civil Engineering and Development Department
New Territories East Development Office
Suite 1213 Chinachem Golden Plaza
77 Mody Road
Tsim Sha Tsui East
Kowloon

Your reference:

Our reference: HKCEDD10/50/105707

Date: 18 April 2019

Attention: Mr Leung Siu Kau, Kelvin

BY POST

Dear Sirs

Agreement No.: NTE 08/2016

Independent Environmental Checker for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Monthly Environmental Monitoring and Audit Report (March 2019)

We refer to the emails of 10, 16 and 17 April 2019 from Action-United Environmental Services and Consulting attaching a Monthly Environmental Monitoring and Audit Report (March 2019) for the captioned project.

We have no further comment and hereby verify the Monthly Environmental Monitoring and Audit Report (March 2019).

Should you have any queries, please do not hesitate to contact the undersigned or our Ms Angie Chan on 2618 2831.

Yours faithfully

ANewR CONSULTING LIMITED

Adi Lee

Independent Environmental Checker

LYMA/CWA/lhnh

cc CEDD – Mr Matthew Fung (email: mphfung@cedd.gov.hk)
AECOM – Mr Tommy Li (email: c1-srec2@arqaecom.com)
AECOM – Mr Vincent Y H Yuen (email: c2-srec3@arqaecom.com)
AECOM – Mr Brad C W Chan (email: c3-srec4@arqaecom.com)
AUES – Mr T W Tam (email: twtam@fordbusiness.com)

ANewR Consulting Limited

Unit 517, 5/F, Tower A, Regent Centre
63 Wo Yi Hop Road, Kwai Chung, Hong Kong
Tel: (852) 2618 2831 Fax: (852) 3007 8648
Email: info@anewr.com
Web: www.anewr.com



ISO 9001 : 2015
Certificate No.: CC 3988

EXECUTIVE SUMMARY

- ES01 Action-United Environmental Services & Consulting (AUES) has been awarded the Civil Engineering and Development Department (CEDD) Service Contract No. NTE/07/2016 Environmental Team for Development of Anderson Road Quarry Site – Site Formation and Associated Infrastructure Works (hereinafter called “the Service Contract”) on 15 December 2016. The commencement date of the Service Contract is from December 2016 and the Contract Period is 70 months.
- ES02 The Services under the Service Contract is to provide environmental monitoring and audit (EM&A) services for the Works Contracts pursuant to the requirement of Environmental Team (ET) under the EM&A manual to ensure that the environmental performance of the Works Contracts comply with the requirement specified in the EM&A Manual and EIA Report of Development of Anderson Road Quarry and other relevant statutory requirements.
- ES03 To facilitate the project management and implementation, the Service Contract is divided to three CEDD contracts including Contract 1 (NE/2016/01), Contract 2 (NE/2016/05) and Contract 3 (NE/2017/03). As advised by the RE, the date for commencement of Contract 1 was on 21 December 2016 and the major construction works has been commenced on 12 April 2017. The date for commencement of Contract 2 was 31 March 2017 and the major construction activities have been commenced on 2 May 2017. Furthermore, Contract 3 was commenced on 31 May 2018 and the major construction activities works was commenced in November 2018. The EM&A programme under the Project was commenced on 12 April 2017 pursuant to the requirement under the EM&A manual.
- ES04 This is the 24th monthly EM&A report presenting the monitoring results and inspection findings for the reporting period from **1 to 31 March 2019** (hereinafter ‘the Reporting Period’).

ENVIRONMENTAL MONITORING AND AUDIT ACTIVITIES

- ES05 Environmental monitoring activities under the EM&A programme in the Reporting Period are summarized in the following table.

Environmental Aspect	Environmental Monitoring Parameters / Inspection	Reporting Period	
		Number of Active Monitoring Locations	Total Occasions
Air Quality	1-hour TSP	5	75
	24-hour TSP	4	20
Construction Noise	$L_{eq(30min)}$ Daytime	5	20
	$L_{eq(30min)}$ Daytime for Contract NE/2017/03	3	12

BREACH OF ACTION AND LIMIT (A/L) LEVELS

No exceedance of air quality was recorded in the Reporting Period. For construction noise monitoring, no Limit Level exceedance was recorded but two noise complaints (which triggered Action Level) were received in the reporting period. The environmental exceedance, NOE issued and investigation of exceedance are summarized in the following table.

Environmental Aspect	Monitoring Parameters	Action Level	Limit Level	Event & Action		
				NOE Issued	Investigation	Corrective Actions
Air Quality	1-hour TSP	0	0	0	NA	NA
	24-hour TSP	0	0	0	NA	NA
Construction Noise	$L_{eq(30min)}$ Daytime	2	0	0	under investigated by ET	NA

ENVIRONMENTAL COMPLAINT

- ES06 In the Reporting Period, two (2) environmental complaints were received with respect to the noise concerns arising from the Project in relation to work under Contract NE/2016/01 and Contract NE/2016/05. Investigation for the complaint for NE/2016/01 was completed by ET which revealed that the Contractor has enhanced the noise mitigation measures in response to the complainant. The Investigation for complaint under Contract NE/2016/05 is underway by ET.

NOTIFICATION OF SUMMONS AND SUCCESSFUL PROSECUTIONS

- ES07 No environmental summons or successful prosecutions for the Project were recorded in the Reporting Period.

REPORTING CHANGE

- ES08 A Work Instruction was issued from AECOM to AUES in November 2018 for installing three additional noise monitoring stations under Contract 3. Impact noise monitoring was performed at these three additional noise monitoring locations since December 2018.

SITE INSPECTION

- ES09 In this Reporting Period, joint site inspection to evaluate the site environmental performance for **Contract 1** was carried out by the RE, ET and Contractor on **7, 12, 19 and 26 March 2019** in which IEC joined the site inspection with SSEMC on **7 March 2019**. No non-compliance was noted during the site inspection.
- ES10 In this Reporting Period, joint site inspection to evaluate the site environmental performance for **Contract 2** was carried out by the RE, ET and Contractor on **8, 13, 20 and 27 March 2019** in which IEC joined the site inspection with SSEMC on **20 March 2019**. No non-compliance was noted during the site inspection.
- ES11 In this Reporting Period, joint site inspection to evaluate the site environmental performance for **Contract 3** was carried out by the RE, ET and Contractor on **7, 14, 21 and 28 March 2019** in which IEC joined the site inspection with SSEMC on **7 March 2019**. No non-compliance was noted during the site inspection.

FUTURE KEY ISSUES

- ES12 As wet season is approaching, preventive measures for muddy water or other water pollutants from site surface overflow to public area should be properly maintained. The Contractors should paid special attention on water quality mitigation measures and fully implement according ISEMM of the EM&A Manual.
- ES13 Since construction site is highly visible to the resident at nearby estates, the Contractors should fully implement air quality mitigation measures to reduce construction dust emission.
- ES14 Construction noise would be a key environmental issue during construction work of the Project. Noise mitigation measures such as using quiet plants should be implemented in accordance with the EM&A requirement.
- ES15 In addition, all effluent discharge shall be ensure to fulfill Technical Memorandum of Effluent Discharged into Drainage and Sewerage Systems, inland and Coastal Waters criteria or discharge permits stipulation.

Table of Contents

1. INTRODUCTION	1
1.1 PROJECT BACKGROUND	1
1.2 REPORT STRUCTURE	1
2. PROJECT ORGANIZATION AND CONSTRUCTION PROGRESS	2
2.1 CONSTRUCTION CONTRACT PACKAGING	2
2.2 PROJECT ORGANIZATION	3
2.3 CONSTRUCTION PROGRESS	3
3. SUMMARY OF IMPACT MONITORING REQUIREMENTS	6
3.1 GENERAL	6
3.2 MONITORING PARAMETERS	6
3.3 MONITORING LOCATIONS	6
3.4 MONITORING FREQUENCY AND PERIOD	9
3.5 MONITORING EQUIPMENT	9
3.6 MONITORING METHODOLOGY	10
3.7 DERIVATION OF ACTION/LIMIT (A/L) LEVELS	12
3.8 DATA MANAGEMENT AND DATA QA/QC CONTROL	13
4. AIR QUALITY MONITORING	14
4.1 GENERAL	14
4.2 RESULTS OF AIR QUALITY MONITORING	14
5. CONSTRUCTION NOISE MONITORING	16
5.1 GENERAL	16
5.2 NOISE MONITORING RESULTS IN REPORTING MONTH	16
6. WASTE MANAGEMENT	17
6.1 GENERAL WASTE MANAGEMENT	17
6.2 RECORDS OF WASTE QUANTITIES	17
7. SITE INSPECTION	18
7.1 REQUIREMENTS	18
7.2 FINDINGS / DEFICIENCIES DURING THE REPORTING MONTH	18
8. ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE	20
8.1 ENVIRONMENTAL COMPLAINT, SUMMONS AND PROSECUTION	20
9. IMPLEMENTATION STATUS OF MITIGATION MEASURES	22
9.1 GENERAL REQUIREMENTS	22
9.2 TENTATIVE CONSTRUCTION ACTIVITIES IN THE COMING MONTH	22
9.3 KEY ISSUES FOR THE COMING MONTH	23
10. CONCLUSIONS AND RECOMMENDATIONS	24
10.1 CONCLUSIONS	24
10.2 RECOMMENDATIONS	24

LIST OF TABLES

TABLE 2-1	STATUS OF ENVIRONMENTAL LICENSES AND PERMITS OF THE CONTRACT 1
TABLE 2-2	STATUS OF ENVIRONMENTAL LICENSES AND PERMITS OF THE CONTRACT 2
TABLE 2-3	STATUS OF ENVIRONMENTAL LICENSES AND PERMITS OF THE CONTRACT 3
TABLE 3-1	SUMMARY OF EM&A REQUIREMENTS
TABLE 3-2	IMPACT MONITORING STATIONS - AIR QUALITY
TABLE 3-3	IMPACT MONITORING STATIONS - CONSTRUCTION NOISE
TABLE 3-4	ADDITIONAL IMPACT MONITORING STATIONS – CONSTRUCTION NOISE
TABLE 3-5	AIR QUALITY MONITORING EQUIPMENT
TABLE 3-6	CONSTRUCTION NOISE MONITORING EQUIPMENT
TABLE 3-7	ACTION AND LIMIT LEVELS FOR AIR QUALITY MONITORING
TABLE 3-8	ACTION AND LIMIT LEVELS FOR CONSTRUCTION NOISE
TABLE 4-1	SUMMARY OF 24-HOUR AND 1-HOUR TSP MONITORING RESULTS (AMS-1)
TABLE 4-2	SUMMARY OF 24-HOUR AND 1-HOUR TSP MONITORING RESULTS (AMS-2)
TABLE 4-3	SUMMARY OF 24-HOUR AND 1-HOUR TSP MONITORING RESULTS (AMS-5)
TABLE 4-4	SUMMARY OF 24-HOUR AND 1-HOUR TSP MONITORING RESULTS (AMS-6)
TABLE 4-4	SUMMARY OF 24-HOUR AND 1-HOUR TSP MONITORING RESULTS (AMS-7)
TABLE 5-1	SUMMARY OF CONSTRUCTION NOISE MONITORING RESULTS
TABLE 6-1	SUMMARY OF QUANTITIES OF INERT C&D MATERIALS
TABLE 6-2	SUMMARY OF QUANTITIES OF C&D WASTES
TABLE 7-1	SITE OBSERVATIONS OF CONTRACT 1
TABLE 7-2	SITE OBSERVATIONS OF CONTRACT 2
TABLE 7-3	SITE OBSERVATIONS OF CONTRACT 3
TABLE 8-1	STATISTICAL SUMMARY OF ENVIRONMENTAL COMPLAINTS
TABLE 8-2	STATISTICAL SUMMARY OF ENVIRONMENTAL SUMMONS
TABLE 8-3	STATISTICAL SUMMARY OF ENVIRONMENTAL PROSECUTION
TABLE 9-1	ENVIRONMENTAL MITIGATION MEASURES

LIST OF APPENDICES

APPENDIX A	LAYOUT PLAN OF THE PROJECT
APPENDIX B	ORGANIZATION CHART
APPENDIX C	THREE-MONTHS ROLLING CONSTRUCTION PROGRAMME
APPENDIX D	MONITORING LOCATIONS FOR IMPACT MONITORING
APPENDIX E	CALIBRATION CERTIFICATE OF MONITORING EQUIPMENT AND HOKLAS-ACCREDITATION CERTIFICATE OF THE TESTING LABORATORY
APPENDIX F	EVENT AND ACTION PLAN
APPENDIX G	IMPACT MONITORING SCHEDULE
APPENDIX H	DATABASE OF MONITORING RESULT
APPENDIX I	GRAPHICAL PLOTS FOR MONITORING RESULT
APPENDIX J	METEOROLOGICAL DATA
APPENDIX K	WASTE FLOW TABLE
APPENDIX L	IMPLEMENTATION SCHEDULE FOR ENVIRONMENTAL MITIGATION MEASURES
APPENDIX M	COMPLAINT LOG AND INVESTIGATION REPORT FOR COMPLAINT

1. INTRODUCTION

1.1 PROJECT BACKGROUND

- 1.1.1 Action-United Environmental Services & Consulting (hereinafter referred as “AUES”) has been awarded the CEDD Service Contract No. NTE/07/2016 Environmental Team for Development of Anderson Road Quarry Site – Site Formation and Associated Infrastructure Works (hereinafter called “the Service Contract”) on 15 December 2016. The commencement date of the Service Contract was December 2016 and the Contract Period is 70 months. The Services under the Service Contract is to provide environmental monitoring and audit (EM&A) services for the Works Contracts pursuant to the requirement of Environmental Team (ET) under the EM&A manual to ensure that the environmental performance of the Works Contracts comply with the requirement specified in the EM&A Manual and EIA Report of Development of Anderson Road Quarry and other relevant statutory requirements.
- 1.1.2 Development of Anderson Road Quarry is to provide land and the associated infrastructures for the proposed land used at the existing Anderson Road Quarry Site at the North-eastern of East Kowloon according to the final Recommended Outline Development Plan (hereinafter named as the Project Works).
- 1.1.3 To facilitate the project management and implementation, the Service Contract is divided to three CEDD contracts including Contract 1 (NE/2016/01), Contract 2 (NE/2016/05) and Contract 3 (NE/2017/03). The date for commencement of Contract 1 was on 21 December 2016 and the major construction works commenced on 12 April 2017. The date for commencement of Contract 2 was 31 March 2017 and the major construction activities commenced on 2 May 2017. Contract 3 was commenced on 31 May 2018 but the major construction activities works have not yet commenced in this reporting period. The EM&A programme under the Project was commenced on 12 April 2017 pursuant to the requirement under the EM&A manual.
- 1.1.4 According to the Approved EM&A Manual, air quality and construction noise are required to be monitored during the construction phase of the Project. As part of the EM&A program, baseline monitoring to determine the ambient environmental conditions is required to be carried out before construction work of the Project commencement. Hence, baseline air quality and background noise monitoring were conducted on **17th January 2017 to 30th January 2017, 16th February 2017 to 2nd March 2017 and 26th March 2017 to 8th April 2017**. Furthermore, Baseline Monitoring Report, which certified by Environmental Team Leader (ETL) and verified by the Independent Environmental Checker (IEC) has been submitted to Environmental Protection Department (EPD) on **9 May 2017** for endorsement.
- 1.1.5 This is the **24th** monthly EM&A report presenting the monitoring results and inspection findings for the reporting period from **1 to 31 March 2019**.

1.2 REPORT STRUCTURE

- 1.2.1 The Monthly Environmental Monitoring and Audit (EM&A) Report is structured into the following sections:-

Section 1	<i>Introduction</i>
Section 2	<i>Project Organization and Construction Progress</i>
Section 3	<i>Summary of Impact Monitoring Requirements</i>
Section 4	<i>Air Quality Monitoring</i>
Section 5	<i>Construction Noise Monitoring</i>
Section 6	<i>Water Quality Monitoring</i>
Section 7	<i>Waste Management</i>
Section 8	<i>Site Inspections</i>
Section 9	<i>Environmental Complaints and Non-Compliance</i>
Section 10	<i>Implementation Status of Mitigation Measures</i>
Section 11	<i>Conclusions and Recommendations</i>

2. PROJECT ORGANIZATION AND CONSTRUCTION PROGRESS

2.1 CONSTRUCTION CONTRACT PACKAGING

- 2.1.1 To facilitate the project management and implementation, the Project would be divided by the 3 contracts as described in following. The details of each contract are summarized below and the delineation of each contract is shown in [Appendix A](#).

Contract 1 (Contract No. NE/2016/01)

- 2.1.2 Commencement date of Contract 1 was in late December 2016 and the major scope of work of Contract 1 is listed below:

- Formation of about 40 hectares (ha) of land platforms at the ARQ site and the associated geotechnical works;
- Road works including construction of approximately 3-kilometer long vehicular roads, footpaths, cycle tracks, an approximately 130-meter long underpass at the southern end and a public transport terminus at the northern end at the ARQ site;
- Provision of and improvement to water supply, drainage and sewerage systems as well as landscaping works; and
- Construction of proposed subway structures and lift tower structures of pedestrian connectivity facilities.

Contract 2 (Contract No. NE/2016/05)

- 2.1.3 Commencement date of Contract 2 was 31 March 2017 and the major Scope of Work of the Contract 2 is listed below:

- (i) Construction of the following pedestrian connectivity facilities with covered elevated walkways, covered at grad walkways, escalators, lift towers with associated staircase and lifts:-
 - (a) Linking Hiu Kwong street with Hiu Ming Street (E1)
 - (b) Linking the proposed “Footbridge Link at Sau Ming Road” with Hiu Ming Street (E2, C1 and E3)
 - (c) Linking the proposed bus-to-bus interchange at Tseung Kwan O Tunnel Toll Plaza with Lin Tak Road (E12)
- (ii) Construction of bus-to-bus interchange (BBI) at Tseung Kwan O Tunnel Toll Plaza;
- (iii) Associated landscape works;
- (iv) Construction of green routes connecting to Jordan Valley Park and Choi Wing Road; and
- (v) Slope improvement works in the vicinity of Po Lam Road South and other associated works.

Contract 3 (Contract No. NE/2017/03)

- 2.1.4 The commencement date of Contract 3 is on 31 May 2018 and the major Scope of Work of the Contract 3 is listed below:

- (i) Site formation and road works in the following sections:-
 - (a) at junction of Clear Water Bay Road (CWBR) and On Sau Road constructed under the Development at Anderson Road (DAR) project including the provision of U-turn facility and noise mitigation measures (RIW1);
 - (b) at New Clear Water Bay Road (NCWBR) near Shun Lee Tsuen Road including the road widening works at NCWBR, modification of existing subway structure and provision of noise mitigation measures (RIW2); and
 - (c) at the junction of Lin Tak Road and Sau Mau Ping Road, construction of flyover above Tseung Kwan O Road, provision of loading and unloading bays along Lin Tak Road and noise mitigation measures (RIW3).
- (ii) construction of the following pedestrian connectivity facilities with covered elevated walkways, escalators and lift towers with associated staircases and lifts:-

- (a) linking Anderson Road Quarry site with the DAR Site (except the works covered under Contract 1) (System A and System B);
 - (b) linking Hiu Ming Street with Hiu Yuk Path (E8); and
 - (c) linking the proposed bus-bus interchange at Tseung Kwan O Tunnel Toll Plaza with Sau Mau Ping Road (E11).
- (iii) Associated landscape works.

2.2 PROJECT ORGANIZATION

- 2.2.1 The project organization for Contracts 1 and 2 is shown in [Appendix B](#).

2.3 CONSTRUCTION PROGRESS

- 2.3.1 The three-months rolling construction program for Contracts 1 and 2 are enclosed in [Appendix C](#) while the construction program for Contract 3 has not yet provided by the Contractor in this Reporting Period. As provided by the Contractors, the major construction activities conducted in the Reporting Period are summarized in below.

Contract 1 (NE/2016/01)

1. Implementation of Temporary Traffic Arrangement at the junction between On Sau Road and Road L4, Po Lam Road near Po Tat Estate and Po Lam Road near Ma Yau tong Village;
2. Excavation of footing at South and North Towers of Pedestrian Connectivity System B (PSCB);
3. Excavation works for Subway of PCSB;
4. Construction of drainage pipe 1350mm dia. from M/H S310 to M/H X3A near North Tower of PCSB;
5. Construction of drainage works near the box culvert BC1 and BC2;
6. Construction of drainage works at Road L1 between Road L3 and Road 5;
7. Excavation works from Bay 1 to Bay 10 of BC1 and constructions of bay 11 and 12 of BC01
8. Construction of box culvert BC2 of Bay 5, 6, 7 and 11;
9. Construction of water mains at Road L5;
10. Construction of pile cap and strap beams and steel post erection of Public Transport Terminus;
11. Road Improvement Works at Po Lam Road
12. Tunneling works at West Portal
13. Site formation works at slope A1 of East Portal and slope A3 West Portal
14. Excavation works for Water Pumping Station area;
15. Backfilling works for Retaining Wall RWA 13 and RWA 14;
16. Base slabs and walls at Salt and Fresh Water Reservoir;
17. Retaining walls of Artificial Flood Attenuation Lake;
18. Construction of U channels for the area of Portal B8 and KW Asphalt Plant;
19. Construction of walls and columns works for Underground Stormwater Retention Tank (USRT)
20. Noise Barrier walls, Retaining Walls RWA12 and RWA18 for internet road L4; and
21. Rock Slope Survey and Slope Stabilization at Portion B1 and B5

Contract 2 (NE/2016/05)

1. Portion 1: Excavation and shoring works for E1 – PC2 & E1 –PC6; Continue piling works for pile cap E1-PC3 and haul road construction.
2. Portion 2: Rock breaking for E3-ST1.
3. Portion 4 : Rectification of defects
4. Portion 5: Footing construction of the covered walkway footing BBI-NB-F3; excavation and shoring works of Southern High Mast and Footing construction for Northern High Mast
5. Portion 6: Rock breaking for rock cut slope and BBI Footing; fixing formwork,

reinforcement and place concrete for RW12

Contract 3 (NE/2017/03)

1. Trees felling at Portion B (excluding 22nos. *Aquilaria Sinensis* at Portion B) and partial Portion C;
2. Excavate trial pit;
3. Setup Temporary Traffic Arrangement (TTA) on the road;
4. Utilities mapping on RIW3
5. Remove works of central median along Clear Water Bay Road of Traffic Sign diversion;
6. ELS works for footing construction at PC-System A;
7. Excavate works for footing construction at BBI Public Toilet
8. Tree felling works and tree transplant works.

2.3.2 Summary of the relevant permits, licenses, and/or notifications on environmental protection for the Project of contracts 1 and 2 are presented in **Tables 2-1, 2-2 and 2-3**.

Table 2-1 Status of Environmental Licenses and Permits of the Contract 1

Item	Description	License/Permit Status			
		Permit no./ account no./ Ref. no.	Valid Period		Status
			From	To	
1	Form NA – Notification pursuant to Air pollution Control (Construction Dust) Regulation	EPD ref. no. 411762	NA	NA	valid
	Form NB – Notification pursuant to Air pollution Control (Construction Dust) Regulation	EPD ref. no. 412730	NA	NA	valid
2	Chemical Waste Producer Registration	Registration no. WPN 5213-292-C4115-01	15 Feb 17	End of project	valid
3	Water Pollution Control Ordinance – Discharge License	WT00027252-2017	20 Mar 17	31 Mar 22	valid
4	Waste Disposal Regulation – Billing Account for Disposal of Construction Waste	Account no. 7026925	20 Jan 17	End of project	valid
5	Construction Noise Permit	GW-RE0060-19	4 Feb 19	3 May 19	valid

Table 2-2 Status of Environmental Licenses and Permits of the Contract 2

Item	Description	License/Permit Status			
		Permit no./ account no./ Ref. no.	Valid Period		Status
			From	To	
1	Notification pursuant to Air pollution Control (Construction Dust) Regulation	EPD ref. no. 312173	NA	NA	valid
2	Chemical Waste Producer Registration	Registration no. WPN 5213-294-K2890-08	3 Jul 17	End of Project	Valid
3	Water Pollution Control Ordinance – Discharge License	WT00028685-2017	02 Aug 17	31 Aug 22	Valid
		WT00028686-2017	02 Aug 17	31 Aug 22	Valid

Item	Description	License/Permit Status			
		Permit no./ account no./ Ref. no.	Valid Period		Status
			From	To	
		WT00028687-2017	02 Aug 17	31 Aug 22	Valid
4	Waste Disposal Regulation – Billing Account for Disposal of Construction Waste	Account no.7027548	12 Apr 17	End of project	Valid

Table 2-3 Status of Environmental Licenses and Permits of the Contract 3

Item	Description	License/Permit Status			
		Permit no./ account no./ Ref. no.	Valid Period		Status
			From	To	
1	Form NA – Notification pursuant to Air Pollution Control (Construction Dust) Regulation	Notification to EPD on 29 May 2018.			
2	Chemical Waste Producer Registration	<u>For Area R1W3 (E11)</u> Registration no. WPN : 5213-294-C4239-04	6-Aug-18	End of Project	Valid
		<u>For Area System A</u> Registration no. WPN: 5213-293-C4239-05	6-Aug-18	End of Project	Valid
		<u>For Area System B</u> Registration no. WPN 5213-294-C4239-03	6-Aug-18	End of Project	Valid
		<u>For Area E8</u> Registration no. WPN 5213-292-C4239-06	6-Aug-18	End of Project	Valid
3	Water Pollution Ordinance – Discharge License	<u>For Area R1W3 (E11)</u> WT00032742-2018	18-Jan-19	31-Jan-24	Valid
		<u>For Area System A</u> WT00033223-2019	31-Jan-19	31-Jan-24	Valid
		<u>For Area System B</u>	Pending approval from EPD		
		<u>For Area E8</u> WT00033299-2019	5-Mar-19	5-Mar-24	Valid
4	Waste Disposal Regulation – Billing Account for Disposal of Construction Waste	Account no.7031075	20 July 2018	End of project	Valid
5	Construction Noise Permit	GW-RE0131-19	26 Feb 19	25 May 19	Valid
6	Construction Noise Permit	GW-RE0058-19	18 Feb 19	17 May 19	Valid

3. SUMMARY OF IMPACT MONITORING REQUIREMENTS**3.1 GENERAL**

3.1.1 The Environmental Monitoring and Audit requirements are set out in the Approved EM&A manual. Environmental issues such as air quality, construction noise and water quality were identified as the key issues during the construction phase of the Project.

3.1.2 A summary of construction phase EM&A requirements are presented in the sub-sections below.

3.2 MONITORING PARAMETERS

3.2.1 The EM&A program of construction phase monitoring shall cover the following environmental issues:

- Air quality; and
- Construction noise

3.2.2 A summary of the monitoring parameters is presented in *Table 3-1*.

Table 3-1 Summary of EM&A Requirements

Environmental Issue	Parameters
Air Quality	<ul style="list-style-type: none"> • 1-hour TSP by Real-Time Portable Dust Meter; and • 24-hour TSP by High Volume Air Sampler
Noise	<ul style="list-style-type: none"> • Leq(30min) in normal working days (Monday to Saturday) 07:00-19:00 except public holiday • Supplementary information for data auditing, statistical results such as L₁₀ and L₉₀ shall also be obtained for reference.

3.3 MONITORING LOCATIONS

3.3.1 According to the EM&A Manual Section 4.6, seven (7) most representative and affected air sensitive receivers (ASR) were selected as air monitoring stations (AQM). The air quality monitoring locations are listed in *Table 3-2* and illustrated in *Appendix D*.

Table 3-2 Impact Monitoring Stations – Air Quality

ID	ASR ID in EIA	Location in the EM&A Manual	Identified Location during Site Visit	Status
AMS-1	ACYC-01	Chi Yum Ching She	Ground of Chi Yum Ching facing the project site	Active
AMS-2 (#)	DARB-13	Block 8, Site B	Ground of Fung Tai House of On Tai Estate	Active
AMS-3	DARC-16	Planned Clinic and Community Centre, Site C2 <small>Note 1</small>	Ground of Planned Clinic and Community Centre facing Anderson Road	Not yet commenced
AMS-4	DARC-26	Planned School, Site C2 <small>Note 2</small>	Ground of Planned School facing Anderson Road	Not yet commenced
AMS-5	DARE-06	Block 5, DAR Site E	Main roof of Oi Tat House of On Tat Estate facing the project site	Active
AMS-6	DARE-17	Block 9, Site E	Main roof of Hau Tat House of On Tat Estate facing the project site	Active
AMS-7	AMYT-04	Ma Yau Tong Village	Balcony at 2 nd floor of Village House Anderson Road No. 1 facing the project site	Active

Note 1: The ASR is under construction and not yet in operation.

Note 2: The ASR is not yet constructed.

(#) AMS-2 was activated on 26 November 2018 since Fung Tai House became an air sensitive receiver. 1-hour TSP monitoring was commenced on 26 November 2018 while installation of HVS for 24-hour TSP was pending approval from Housing Authority.

- 3.3.2 In our recent site visit at the subject site, it was noted that some planned ASRs identified in the EM&A Manual are still under construction/ has not yet constructed and there were no suitable location to set up the high volume sampler to carry out the baseline 24-hour TSP monitoring. Therefore, a proposed change for the baseline monitoring programme was submitted and agreed by EPD before the baseline monitoring.
- 3.3.3 In our baseline monitoring proposal, baseline 1-hour TSP monitoring will be conducted at all AQM location AMS-1 to AMS-7. However, baseline 24-hour TSP monitoring will be conducted at existing ASR AMS-1, AMS-5, AMS-6 and AMS-7 only with our justifications present below:
- (a) AQM Locations AMS-2, AMS-3 & AMS-4 are planned ASRs which are still under construction/ has not yet constructed. During recent site visit, there were no suitable locations for setting up the HVS and electricity supply at these AQM locations.
 - (b) Alternative locations were considered in accordance with EM&A Manual Section 4.7.3. However, there were no suitable location found and our justifications are provided in below:
 - (i) Alternative locations Sau Mau Ping Estate and Shun Tin Estate were located at downhill of the subject site which separated by the active construction site (i.e., AMS-2, AMS-3 & AMS-4) and Sau Mau Ping Road. In view of the level deviation, the baseline data obtained in these alternative locations could not represent the baseline condition of the designated location AMS-2, AMS-3 & AMS-4. Moreover, when the planned ASR AMS-2, AMS-3 & AMS-4 activate sooner or later, impact monitoring should be carried out at these designated locations instead of the alternative locations.
 - (ii) Alternative location such as site boundary of the site subject was considered, however, there were no provisions of power supply to sustain the HVS continuously after consultation with the Contractor.
 - (c) According to EM&A Manual Section 4.7.4, as an exceptional cases, it is proposed to adopt the Action Level established at AMS-5 to AMS-2, AMS-3 & AMS-4 for impact monitoring as AMS-5 with our justification below.
 - (i) AMS-5 is the closest ASR to AMS-2, AMS-3 & AMS-4 under same direction of prevailing wind.
 - (ii) In view of the baseline 1-hour TSP data, the measured results at AMS-5 were lower than those collected at AMS-2, AMS-3 & AMS-4. As a conservation approach, adopting Action Level at AMS-5 for Location AMS-2, AMS-3 & AMS-4 is more stringent for the project.
 - (iii) The Action level for AMS-2, AMS-3 & AMS-4 will be subject to review in accordance with EM&A Manual Section 4.7.5

Construction Noise

- 3.3.4 According to the EM&A Manual Section 5.5, three (3) most representative and affected noise sensitive receivers (NSR) were selected as monitoring stations. As recommended by the RE and agreed by IEC, one (1) additional noise monitoring location is proposed to add in Oi Tat House of On Tat Estate (hereafter “NMS-4”) to oversee the possible noise impact pose to the resident in On Tat Estate, which is an existing NSR close to the major works activities. Moreover, review of impact monitoring location was proposed to IEC in view of the current site condition and it was agreed by all parties. The details of noise monitoring location are listed in **Table 3-3** and illustrated in **Appendix D**.

Table 3-3 Impact Monitoring Stations – Construction Noise

ID	NSR ID in EIA	Location	Status
NMS-1	Site C2 – School 05 ^{Note 1}	Ground of planned school at DAR facing the project site	Not yet commenced
NMS-2	Site E – School ^{Note 1}	Ground area between the planned school and Him Tat House facing the project site	Not yet commenced
NMS-3	Site C2 – R102 ^{Note 1}	Ground of Ancillary Facilities Building facing the project site	Not yet commenced
NMS-4*	Oi Tat House	1m from the exterior of ground floor façade of Oi Tat House of On Tat Estate facing the project site	Active
NMS-4a#	Oi Tat House	Rooftop of Oi Tat House where 1m from the exterior of Oi Tat House facing the project site	Active
NMS-5#	Hau Tat House	22/F, refuge floor of Hau Tat House where 1m from the exterior of Hau Tat House facing the project site.	Active
NMS-6~	Yung Tai House of On Tai Estate	Rooftop of Yung Tai House where 1m from the exterior of the building facing the project site)	Active
NMS-7~	Chi Tai House of On Tai Estate	Rooftop of Chi Tai House where 1m from the exterior of the building facing the project site	Active
NMS-8^	No. 3-4 Ma Yau Tong Village	1m from the exterior of the building façade and facing the construction site	Active

Note 1: The NSR is under construction and not yet in operation.

Remark:

- (*) Additional noise monitoring location was recommended by RE and agreed by IEC. It was temporary suspended and the monitoring location is relocated to NMS4a with effective on 15 Nov 2017.
- (#) Review of noise monitoring locations was proposed by ET and NMS-5 was effective on 15 November 2017.
- (~) Review of noise monitoring locations was proposed by ET and NMS-6 and NMS-7 were effective on 28 Feb 2018.
- (^) Review of noise monitoring locations was proposed by ET and NMS-8 was effective on 18 April 2018. Noise monitoring at NMS-8 was started on 3 May 2018 upon commencement of construction at relevant section.

Addition Construction Noise Monitoring Location

- 3.3.5 A Work Instruction was issued from AECOM to AUES in November 2018 for installing three additional noise monitoring stations under Contract 3. According to the Work Instruction, one noise monitoring station was proposed to install at System A Area and two station monitoring points were proposed to install at E8 Area. The noise monitoring locations are shown in **Table 3-4** below and illustrated in **Appendix D**.

Table 3-4 Additional Impact Monitoring Stations – Construction Noise

ID	Location	Description
CN1	Holm Glad College	Ground floor of Holm Glad College, where 1m from the exterior of the building facing E8
CN2	Leung Shek Chee College	Ground floor of Leung Shek Chee College, where 1m from the exterior of the building facing E8
CN3	Oi Tat House of On Tat Estate	Ground floor of Oi Tat House of On Tat Estate, where 1m from the exterior of the building facing System A

3.4 MONITORING FREQUENCY AND PERIOD

- 3.4.1 The requirements of impact monitoring in the approved *EM&A Manual* and presented as follows.

Air Quality Monitoring

- 3.4.2 Frequency of impact air quality monitoring is as follows:

- 1-hour TSP 3 times every six days during course of works throughout the construction period
- 24-hour TSP Once every 6 days during course of works throughout the construction period

Noise Monitoring

- 3.4.3 Noise monitoring will be to conduct at the all available designated monitoring stations. The monitoring frequency shall depend on the scale of the construction activities. The following is an initial guide on the regular monitoring frequency for each station on a weekly basis when noise generating activities are underway:

- one set of $Leq_{(30min)}$ measurements between 07:00 and 19:00 hours on normal weekdays

3.5 MONITORING EQUIPMENT*Air Quality Monitoring*

- 3.5.1 The 24-hour and 1-hour TSP levels shall be measured by following the standard high volume sampling method as set out in the *Title 40 of the Code of Federal Regulations, Chapter 1 (Part 50), Appendix B*. If the ET proposes to use a direct reading dust meter to measure 1-hour TSP levels, it shall submit sufficient information to the IEC to prove that the instrument is capable of achieving a comparable results to the HVS. The instrument should be calibrated regularly, and the 1-hour sampling shall be determined on yearly basis by the HVS to check the validity and accuracy of the results measured by direct reading method. The filter paper of 24-hour TSP measurement shall be determined by HOKLAS accredited laboratory.

- 3.5.2 All equipment to be used for air quality monitoring is listed in **Table 3-5**.

Table 3-5 Air Quality Monitoring Equipment

Equipment		Model
24-hour TSP	High Volume Air Sampler	TISCH High Volume Air Sampler, HVS Model TE-5170
	Calibration Kit	TISCH Model TE-5025A
1- hour TSP	Portable Dust Meter	Sibata LD-3B Laser Dust Monitor

Noise Monitoring

- 3.5.3 Sound level meter in compliance with the International Electrotechnical Commission Publications 651: 1979 (Type 1) and 804: 1985 (Type 1) specifications shall be used for carrying out the noise monitoring. The sound level meter shall be checked using an acoustic calibrator. The wind speed shall be checked with a portable wind speed meter capable of measuring the wind speed in ms^{-1} .

- 3.5.4 Noise equipment as perform for construction phase monitoring is listed in **Table 3-6**.

Table 3-6 Construction Noise Monitoring Equipment

Equipment	Model
Integrating Sound Level Meter	B&K Type 2238
Calibrator	Rion NC-74
Portable Wind Speed Indicator	Anemometer AZ Instrument 8908

3.6 MONITORING METHODOLOGY

1-hour TSP

3.6.1 The 1-hour TSP monitor was a brand named “Sibata LD-3 Laser Dust monitor Particle Mass Profiler & Counter” which is a portable, battery-operated laser photometer. The 1-hour TSP meter provides a real time 1-hour TSP measurement based on 90° light scattering. The 1-hour TSP monitor consists of the following:

- (a.) A pump to draw sample aerosol through the optic chamber where TSP is measured;
- (b.) A sheath air system to isolate the aerosol in the chamber to keep the optics clean for maximum reliability; and
- (c.) A built-in data logger compatible with Windows based program to facilitate data collection, analysis and reporting.

3.6.2 The 1-hour TSP meter to be used will be within the valid period, calibrated by the manufacturer prior to purchasing. Zero response of the instrument will be checked before and after each monitoring event.

24-hour TSP

3.6.3 The equipment used for 24-hour TSP measurement is Thermo Andersen Model GS2310 TSP high volume air sampling system, which complied with *EPA Code of Federal Regulation, Appendix B to Part 50*. The High Volume Air Sampler (HVS) consists of the following:

- (a.) An anodized aluminum shelter;
- (b.) A 8”x10” stainless steel filter holder;
- (c.) A blower motor assembly;
- (d.) A continuous flow/pressure recorder;
- (e.) A motor speed-voltage control/elapsed time indicator;
- (f.) A 7-day mechanical timer, and
- (g.) A power supply of 220v/50 Hz

3.6.4 For HVS for 24-hour TSP monitoring, the HVS is mounted in a metallic cage with a top for protection and also it is sat on the existing ground or the roof of building. The flow rate of the HVS between 0.6m³/min and 1.7m³/min will be properly set in accordance with the manufacturer’s instruction to within the range recommended in *EPA Code of Federal Regulation, Appendix B to Part 50*. Glass Fiber Filter 8" x 10" of TE-653 will be used for 24-Hour TSP monitoring and would be supplied by laboratory. The general procedures of sampling are described as below:-

- A horizontal platform with appropriate support to secure the samples against gusty wind should be provided;
- No two samplers should be placed less than 2 meters apart;
- The distance between the sampler and an obstacle, such as building, must be at least twice the height that the obstacle protrudes above the sample;
- A minimum of 2 meters of separation from any supporting structure, measured horizontally is required;
- Before placing any filter media at the HVS, the power supply will be checked to ensure the sampler work properly;
- The filter paper will be set to align on the screen of HVS to ensure that the gasket formed an air tight seal on the outer edges of the filter. Then filter holder frame will be tightened to the filter hold with swing bolts. The holding pressure should be sufficient to avoid air leakage at the edge;
- The mechanical timer will be set for a sampling period of 24 hours (00:00 mid-night to 00:00 mid-night next day). Information will be recorded on the field data sheet, which would be included the sampling data, starting time, the weather condition at current and the filter paper ID with the initial weight;
- After sampling, the filter paper will be collected and transfer from the filter holder of the

HVS to a sealed envelope and sent to a local HOKLAS accredited laboratory for quantifying.

- 3.6.5 All the sampled 24-hour TSP filters will be kept in normal air conditioned room conditions, i.e. 70% HR (Relative Humidity) and 25°C, for six months prior to disposal.
- 3.6.6 The HVS used for 24-hour TSP monitoring will be calibrated before the commencement for sampling, and after in two months interval for 1 point checking of maintenance and six months interval for five points calibrate in accordance with the manufacturer's instruction using the NIST-certified standard calibrator (Tisch Calibration Kit Model TE-5025A) to establish a relationship between the follow recorder meter reading in cfm (cubic feet per minute) and the standard flow rate, Qstd, in m³/min. Motor brushes of HVS will be regularly replaced of about five hundred hours per time. The calibration certificates of all monitoring equipment used for the impact monitoring program in the Reporting Period and the HOKLAS accredited certificate of laboratory are attached in [Appendix E](#).

Noise Monitoring

- 3.6.7 As referred to in the Technical Memorandum (TM) issued under the NCO, sound level meters in compliance with the International Electrotechnical Commission Publications 651: 1979 (Type 1) and 804:1985 (Type 1) specifications shall be used for carrying out the noise monitoring. Immediately prior to and following each noise measurement the accuracy of the sound level meter shall be checked using an acoustic calibrator generating a known sound pressure level at a known frequency. Measurements may be accepted as valid only if the calibration levels from before and after the noise measurement agree to within 1.0 dB.
- 3.6.8 All noise measurements will be performed with the meter set to FAST response and on the A-weighted equivalent continuous sound pressure level (Leq). Leq_(30 min) in six consecutive Leq_(5 min) measurements will be used as the monitoring parameter for the time period between 07:00-19:00 hours on weekdays throughout the construction period.
- 3.6.9 The sound level meter will be mounted on a tripod at a height of 1.2 m and placed at the assessment point and oriented such that the microphone is pointed to the site with the microphone facing perpendicular to the line of sight. The windshield will be fitted for all measurements. Where a measurement is to be carried out at a building, the assessment point would normally be at a position 1 m from the exterior of the building façade. Where a measurement is to be made for noise being received at a place other than a building, the assessment point would be at a position 1.2 m above the ground in a free-field situation, i.e. at least 3.5 m away from reflective surfaces such as adjacent buildings or walls.
- 3.6.10 Immediately prior to and following each noise measurement the accuracy of the sound level meter will be checked using an acoustic calibrator generating a known sound pressure level at a known frequency. Measurements will be accepted as valid only if the calibration level from before and after the noise measurement agrees to within 1.0 dB.
- 3.6.11 Noise measurements will not be made in fog, rain, wind with a steady speed exceeding 5m/s or wind with gusts exceeding 10m/s. The wind speed will be checked with a portable wind speed meter capable of measuring the wind speed in m/s.
- 3.6.12 The sound level meter and calibrator are calibrated and certified by a laboratory accredited under HOKLAS or any other international accreditation scheme at yearly basis. The calibration certificates of all monitoring equipment used for the impact monitoring program in the Reporting Period is attached in [Appendix E](#).

Meteorological Information

- 3.6.13 The meteorological information including wind direction, wind speed, humidity, rainfall, air

pressure and temperature etc. during baseline monitoring is extracted from the closest Hong Kong Observatory Station. To obtain the most appropriate meteorological information where available, the data of temperature is extracted from the Kwun Tong Observatory Station; the data of wind speed and wind direction are extracted from Kai Tak Observatory Station and the data of humidity is extracted from King's Park Station.

3.7 DERIVATION OF ACTION/LIMIT (A/L) LEVELS

- 3.7.1 The baseline results form the basis for determining the environmental acceptance criteria for the impact monitoring. According to the approved Environmental Monitoring and Audit Manual, the air quality, construction noise were set up, namely Action and Limit levels are listed in *Tables 3-7 and 3-8*.

Table 3-7 Action and Limit Levels for Air Quality Monitoring

Monitoring Station	Action Level ($\mu\text{g}/\text{m}^3$)		Limit Level ($\mu\text{g}/\text{m}^3$)	
	1-hour TSP	24-hour TSP	1-hour TSP	24-hour TSP
AMS-1	313	154	500	260
AMS-2	319	165	500	260
AMS-3	319	165	500	260
AMS-4	315	165	500	260
AMS-5	299	166	500	260
AMS-6	303	168	500	260
AMS-7	307	156	500	260

Table 3-8 Action and Limit Levels for Construction Noise

Monitoring Location	Action Level	Limit Level in dB(A)
	Time Period: 0700-1900 hours on normal weekdays	
NMS-1	When one or more documented complaints are received	75 dB(A) ^{Note 1} /
NMS-2		70 dB(A) ^{Note 2} / 65 dB(A) ^{Note 2}
NMS-3		75 dB(A)
NMS-4*		75 dB(A)
NMS-4a#		75 dB(A)
NMS-5#		75 dB(A)
NMS-6~		75 dB(A)
NMS-7~		75 dB(A)
NMS-8^		75 dB(A)
CN1+		70 dB(A) ^{Note 2} / 65 dB(A) ^{Note 2}
CN2+		70 dB(A) ^{Note 2} / 65 dB(A) ^{Note 2}
CN3+		75 dB(A)

Note 1: Locations NMS-1 and NMS-2 are planned school as NSRs which are still under construction/ not yet constructed; hence the Limit Levels of 75dB(A) is adopted for NMS-1 and NMS-2 until the school is occupied and in operation.

Note 2: Noise Limit Levels for school is 70dB(A) and should be reduced to 65dB(A) during examination period.

Note: If works are to be carried out during restricted hours, the conditions stipulated in the construction noise permit issued by the Noise Control Authority have to be followed.

Remark: (*) Additional noise monitoring location was recommended by RE and agreed by IEC. It was temporary suspended and the monitoring location is relocated to NMS4a with effective on 15 Nov 2017.

(#) Review of noise monitoring locations was proposed by ET and NMS-5 was effective on 15 Nov 2017.

(~) Review of noise monitoring locations was proposed by ET and NMS-6 and NMS-7 were effective on 28 Feb 2018.

(^) Review of noise monitoring locations was proposed by ET and NMS-8 was effective on 18 April 2018. Noise monitoring at NMS-8 was started on 3 May 2018 upon commencement of construction at relevant section.

(+) Additional noise monitoring locations as instructed by AECOM which effective in Dec 18.

- 3.7.2 Should non-compliance of the environmental quality criteria occurs, remedial actions will be triggered according to the Event and Action Plan which presented in [Appendix F](#).

3.8 DATA MANAGEMENT AND DATA QA/QC CONTROL

- 3.8.1 All monitoring data will be handled by the ET's in-house data recording and management system. The monitoring data recorded in the equipment will be downloaded directly from the equipment at the end of each monitoring day. The downloaded monitoring data will input into a computerized database properly maintained by the ET. The laboratory results will be input directly into the computerized database and checked by personnel other than those who input the data.
- 3.8.2 For monitoring parameters that require laboratory analysis, the local laboratory shall follow the QA/QC requirements as set out under the HOKLAS scheme for the relevant laboratory tests.

4. AIR QUALITY MONITORING

4.1 GENERAL

- 4.1.1 In the Reporting Period, air quality monitoring was performed at the active designated monitoring locations AMS-1, AMS-2, AMS-5, AMS-6 and AMS-7. Since installation of HVS for 24-hour TSP at AMS-2 was pending approval from Housing Authority, only 1-hour TSP monitoring was conducted at AMS-2. No monitoring was conducted at AMS-3 and AMS-4 since they are planned ASR which are still under construction/ not yet constructed.
- 4.1.2 The air quality monitoring schedule is presented in *Appendix G* and the monitoring results are summarized in the following sub-sections.

4.2 RESULTS OF AIR QUALITY MONITORING

- 4.2.1 In the Reporting Period, a total of **75** events of 1-hour TSP monitoring and **20** events of 24-hours TSP were carried out and the monitoring results are summarized in *Tables 4-1 to 4-5*. The detailed 24-hour TSP monitoring data are presented in *Appendix H* and the relevant graphical plots are shown in *Appendix I*.

Table 4-1 Summary of 24-hour and 1-hour TSP Monitoring Results (AMS-1)

Date	24-hour TSP ($\mu\text{g}/\text{m}^3$)	1-hour TSP ($\mu\text{g}/\text{m}^3$)				
		Date	Start Time	1 st reading	2 nd reading	3 rd reading
4-Mar-19	81	5-Mar-19	9:11	51	49	50
9-Mar-19	34	11-Mar-19	9:25	65	61	69
22-Mar-19	27	16-Mar-19	10:01	64	69	66
25-Mar-19	22	22-Mar-19	9:05	57	58	59
27-Mar-19	41	28-Mar-19	9:11	49	51	50
Average (Range)	41 (22 – 81)	Average (Range)		58 (49 - 69)		

Table 4-2 Summary of 1-hour TSP Monitoring Results (AMS-2)

1-hour TSP ($\mu\text{g}/\text{m}^3$)				
Date	Start Time	1 st reading	2 nd reading	3 rd reading
5-Mar-19	10:01	48	49	50
11-Mar-19	10:14	55	59	64
16-Mar-19	12:41	63	63	62
22-Mar-19	12:48	67	64	60
28-Mar-19	13:24	61	59	58
Average (Range)		59 (48- 67)		

Table 4-3 Summary of 24-hour and 1-hour TSP Monitoring Results (AMS-5)

Date	24-hour TSP ($\mu\text{g}/\text{m}^3$)	1-hour TSP ($\mu\text{g}/\text{m}^3$)				
		Date	Start Time	1 st reading	2 nd reading	3 rd reading
4-Mar-19	26	5-Mar-19	9:08	45	46	44
9-Mar-19	14	11-Mar-19	9:05	50	55	57
15-Mar-19	31	16-Mar-19	9:16	59	61	51
21-Mar-19	27	22-Mar-19	9:49	62	64	68
27-Mar-19	16	28-Mar-19	9:14	60	57	59
Average (Range)	23 (14 – 31)	Average (Range)		56 (44 - 68)		

Table 4-4 Summary of 24-hour and 1-hour TSP Monitoring Results (AMS-6)

Date	24-hour TSP ($\mu\text{g}/\text{m}^3$)	1-hour TSP ($\mu\text{g}/\text{m}^3$)				
		Date	Start Time	1 st reading	2 nd reading	3 rd reading
4-Mar-19	37	5-Mar-19	12:31	49	50	50
9-Mar-19	18	11-Mar-19	12:49	52	59	55
15-Mar-19	48	16-Mar-19	9:38	53	60	57
21-Mar-19	35	22-Mar-19	9:28	62	65	67
27-Mar-19	19	28-Mar-19	12:38	59	58	58
Average (Range)	31 (18 – 48)	Average (Range)		57 (49 – 67)		

Table 4-5 Summary of 24-hour and 1-hour TSP Monitoring Results (AMS-7)

Date	24-hour TSP ($\mu\text{g}/\text{m}^3$)	1-hour TSP ($\mu\text{g}/\text{m}^3$)				
		Date	Start Time	1 st reading	2 nd reading	3 rd reading
4-Mar-19	52	5-Mar-19	14:09	54	52	53
9-Mar-19	39	11-Mar-19	13:09	60	53	61
15-Mar-19	35	16-Mar-19	9:19	64	65	70
21-Mar-19	39	22-Mar-19	13:47	60	62	67
27-Mar-19	53	28-Mar-19	10:45	61	60	63
Average (Range)	44 (35 – 53)	Average (Range)		60 (52 – 70)		

4.2.2 As shown in *Tables 4-1 to 4-5*, all the 1-hour TSP and 24-hour TSP monitoring results in the Reporting Period were below the Action and Limit Levels. No Notification of Exceedance (NOE) was issued in this Reporting Period.

4.2.3 The meteorological data during the impact monitoring days are summarized in *Appendix J*.

5. CONSTRUCTION NOISE MONITORING

5.1 GENERAL

- 5.1.1 In the Reporting Period, noise monitoring was only performed at the additional monitoring locations NMS4a, NMS5, NMS6, NMS7 and NMS8. No monitoring was conducted at the designated monitoring locations NMS1, NMS2 and NMS3 since they are the planned NSR and still under the construction or not yet constructed.
- 5.1.2 In addition, a Work Instruction was issued from AECOM to AUES in November 2018 for installing three additional noise monitoring stations, i.e., CN1, CN2 and CN3 for Contract 3. Impact noise monitoring was performed at the three additional noise monitoring locations since December 2018.
- 5.1.3 The noise monitoring schedule is presented in *Appendix G* and the monitoring results are summarized in the following sub-sections.

5.2 NOISE MONITORING RESULTS IN REPORTING MONTH

- 5.2.1 In the Reporting Period, a total of **20** events noise measurements were carried out at the designated locations under Contract 1. The noise monitoring results at the designated locations are summarized in *Tables 5-1*. The detailed noise monitoring data are presented in *Appendix H* and the relevant graphical plots are shown in *Appendix I*.

Table 5-1 Summary of Construction Noise Monitoring Results for Contract 1

Construction Noise Level ($L_{eq30min}$), dB(A)					
Date	NMS4a	NMS5	NMS6	NMS7	NMS8
5-Mar-19	73	60	59	64	70
11-Mar-19	67	59	59	70	70
22-Mar-19	70	62	61	62	71
28-Mar-19	68	67	63	69	72
Limit Level	75 dB(A)				

- 5.2.2 For the additional noise monitoring under Contract 3, a total of **12** events noise measurements were performed for the Contract. The noise monitoring results are summarized in *Tables 5-2*. The detailed noise monitoring data are presented in *Appendix H* and the relevant graphical plots are shown in *Appendix I*.

Table 5-2 Summary of Construction Noise Monitoring Results for Contract 3

Construction Noise Level ($L_{eq30min}$), dB(A)			
Date	CN1 #	CN2 @	CN3
5-Mar-19	59	65	63
11-Mar-19	58	62	66
22-Mar-19	60	59	64
28-Mar-19	61	62	66
Limit Level	70 dB(A)^{Note 1} / 65 dB(A)^{Note 1}	70 dB(A)^{Note 1} / 65 dB(A)^{Note 1}	75 dB(A)

Note 1: Noise Limit Levels for school is 70dB(A) and should be reduced to 65dB(A) during examination period.

Remark: # There was examination period during 21 to 26 Mar 2019 at CN1.

@ There was examination period during 25 to 29 Mar 2019 at CN2.

- 5.2.3 As shown in *Tables 5-1 and 5-2*, no Limit Level exceedance was recorded in this Reporting Period. However, two (2) noise complaints (which triggered Action Level) were received under the Project and complaint details could be referred to Section 8.

6. WASTE MANAGEMENT**6.1 GENERAL WASTE MANAGEMENT**

- 6.1.1 Waste management was carried out by an on-site Environmental Officer or an Environmental Supervisor from time to time.

6.2 RECORDS OF WASTE QUANTITIES

- 6.2.1 All types of waste arising from the construction work are classified into the following:
- Construction & Demolition (C&D) Material;
 - Chemical Waste;
 - General Refuse; and
 - Excavated Soil.
- 6.2.2 The quantities of waste for disposal in this Reporting Period are summarized in *Tables 6-1* and *6-2* and the Monthly Summary Waste Flow Table is shown in *Appendix K*. Whenever possible, materials were reused on-site as far as practicable.

Table 6-1 Summary of Quantities of Inert C&D Materials

Type of Waste	Contract 1		Contract 2		Contract 3	
	Quantity	Disposal Location	Quantity	Disposal Location	Quantity	Disposal Location
Total generated Inert C&D Materials ('000m ³)	31.450	-	0.4800	-	0.672	-
Hard Road and Large Broken Concrete	1.582	-	0.3910	-	0	-
Reused in this Contract (Inert) ('000m ³)	1.433	-	0.089	-	0	-
Reused in other Projects (Inert) ('000m ³)	2.512	-	0	-	0	-
Disposal as Public Fill (Inert) ('000m ³)	25.923	TKO 137	0	-	0.672	TKO 137

Table 6-2 Summary of Quantities of C&D Wastes

Type of Waste	Contract 1		Contract 2		Contract 3	
	Quantity	Disposal Location	Quantity	Disposal Location	Quantity	Disposal Location
Recycled Metal ('000kg)	0	-	0	-	0.001	License collector
Recycled Paper / Cardboard Packing ('000kg)	0.499	License collector	0	-	0.084	License collector
Recycled Plastic ('000kg)	0	-	0	-	0.002	License collector
Chemical Wastes ('000kg)	0	-	0	-	0	-
General Refuses ('000m ³)	0.048	SENT	0.0025	SENT	0.005	SENT

7. SITE INSPECTION**7.1 REQUIREMENTS**

- 7.1.1 According to the approved EM&A Manual, the environmental site inspection shall be formulation by ET Leader. Weekly environmental site inspections should be carried out to confirm the environmental performance.

7.2 FINDINGS / DEFICIENCIES DURING THE REPORTING MONTH**Contract 1**

- 7.2.1 In the Reporting Period, joint site inspection for Contract 1 to evaluate site environmental performance was carried out by the RE, ET and the Contractor on **7, 12, 19 and 26 March 2019** in which IEC joined the site inspection with SSEMC on **7 March 2019**. No non-compliance was noted. The findings / deficiencies of **Contract 1** that observed during the weekly site inspection are listed in **Table 7-1**.

Table 7-1 Site Observations of Contract 1

Date	Findings / Deficiencies	Follow-Up Status
7 March 2019	<ul style="list-style-type: none"> On-site sorting should be provided for waste disposed from site. General refuse and C&D waste should be stored separately. (URST) Proper protection for the existing tree should be provided, the contractor should not be used the existing tree as an anchor for holding materials. (Water Reservoir) 	<ul style="list-style-type: none"> On-site sorting had been provided, C&D waste and general refuse was stored separately. Materials hanging on the existing tree were removed.
12 March 2019	<ul style="list-style-type: none"> Silt and mud cumulated inside the de-silting chamber and outlet should be cleaned to maintain the system is functional. (Q6 de-silting chamber & Q3 outlet) 	<ul style="list-style-type: none"> Silt and mud cumulated inside the de-silting chamber and outlet had been cleaned.
19 March 2019	<ul style="list-style-type: none"> Water spraying should be provided for loading activities to reduce dust impact. (East Portion) Sediment cumulated inside the de-silting chamber should be cleaned frequency. (Q6) 	<ul style="list-style-type: none"> Water spraying was provided. Reminder only.
26 March 2019	<ul style="list-style-type: none"> Water spraying frequency for the haul road should be increased to reduce dust impact.(USRT) The contractor was reminded to remove stagnant water regularly. (Artificial Lake) 	<ul style="list-style-type: none"> Water spraying for haul road was provided. Reminder only.

Contract 2

- 7.2.2 In the Reporting Period, joint site inspection for Contract 2 to evaluate site environmental performance was carried out by the RE, ET and the Contractor on **8, 13, 20 and 27 March 2019** in which IEC joined the site inspection with SSEMC on **20 March 2019**. No non-compliance was noted. The findings / deficiencies of **Contract 2** that observed during the weekly site inspection are listed in **Table 7-2**.

Table 7-2 Site Observations of Contract 2

Date	Findings / Deficiencies	Follow-Up Status
8 March 2019	<ul style="list-style-type: none"> Muddy trails were observed at site entrance/exit area of portion 1. The 	<ul style="list-style-type: none"> Muddy trails were cleaned.

Date	Findings / Deficiencies	Follow-Up Status
	Contractor should clean the muddy trails as soon as possible. <ul style="list-style-type: none"> The Contractor was reminded to cleared stagnant water within site area after rainstorm. The Contractor was reminded to remove construction materials near retained tree. 	<ul style="list-style-type: none"> Reminder only. Reminder only.
13 March 2019	<ul style="list-style-type: none"> The Contractor was reminded to remove stagnant water regularly. The Contractor was reminded to review and update the temporary drainage plan. 	<ul style="list-style-type: none"> Reminder only. Reminder only.
20 March 2019	<ul style="list-style-type: none"> Accumulation of dead wood was observed at slope of public area near portion 1. The Contractor was reminded to dispose it as soon as possible. Oil leakage from mobile crane was observed at portion 1. The Contractor was advised to maintain the mobile crane regularly to avoid oil leakage. Oil drums were observed on the ground of portion 1. The Contractor was advised to place oil drums inside drip tray. The Contractor was reminded to remove stagnant water within site area. 	<ul style="list-style-type: none"> Accumulation of dead wood was disposed. Oil leakage was cleaned and disposed as chemical wastes. Proper mitigation measure was provided for oil drums. Reminder only.
27 March 2019	<ul style="list-style-type: none"> The Contractor was reminded to maintain the tree protection zone regularly at portion 2 next to site office. 	<ul style="list-style-type: none"> Reminder only.

Contract 3

- 7.2.3 In the Reporting Period, joint site inspection for Contract 3 to evaluate site environmental performance was carried out by the RE, ET and the Contractor on **7, 14, 21 and 28 March 2019** in which IEC joined the site inspection with SSEMC on **7 March 2019**. No non-compliance was noted. The findings / deficiencies of **Contract 3** that observed during the weekly site inspection are listed in **Table 7-3**

Table 7-3 Site Observations of Contract 3

Date	Findings / Deficiencies	Follow-Up Status
7 March 2019	<ul style="list-style-type: none"> The Contractor was reminded to remove stagnant water cumulated on site after rain. 	<ul style="list-style-type: none"> Reminder only.
14 March 2019	<ul style="list-style-type: none"> No adverse environmental issue was observed. 	<ul style="list-style-type: none"> NA
21 March 2019	<ul style="list-style-type: none"> No adverse environmental issue was observed. 	<ul style="list-style-type: none"> NA
28 March 2019	<ul style="list-style-type: none"> The Contractor was reminded to remove stagnant water within site area.(system A) 	<ul style="list-style-type: none"> Reminder only.

8. ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE

8.1 ENVIRONMENTAL COMPLAINT, SUMMONS AND PROSECUTION

- 8.1.1 In the Reporting Period, two (2) environmental complaints were received with respect to the noise concerns arising from Project. Besides, no summons and prosecution under the EM&A Programme was lodged for the project. Investigation for the complaint was undertaken by the ET and presented in following sections.

Complaint received for Contract 1(last Reporting Period)

DSD has referred a case to CEDD on 24 January 2019 regarding suspended illegal discharge of cementitious slurry from construction site of Development of ARQ Site to nearby Public Stormwater Drainage System. In our investigation, the concerned catchpit and U-channel mainly received the runoff from Po Lam Road as well as the discharge from the Anderson Road Quarry Site. It is suspected that the mud and silt found on the downstream has been accumulated over time particularly by rainstorm as well as routine discharge from construction site. As remedial action, CWSTVJV immediately clean the affected area where accessible. Nevertheless, in order to protection the watercourse at downstream of the construction site, CWSTVJV has some enhancement measures. The investigation report without comment from IEC was shown in [Appendix M](#).

Complaint received for Contract 1(last Reporting Period)

1823 has referred a case to CEDD on 15 February 2019, which the complainant complained about the construction noise generated from the CEDD site near 法源寺 (Ma Yau Tong Village). The complainant requested for the details of works and the completion date, the complainant also requested CEDD to use other construction methods in order to reduce the impact bring to the resident near by. In response to the complainant, CWSTVJV has proposed alternative quiet work method to alleviate the noise impact to the public. They will schedule the noisy activities to be carried out after 10am as far as practicable to minimize the impact to resident nearby, given that not affecting the site progress. Moreover, the coverage of acoustic barriers will be extended in view of the works programme. The investigation report without comment from IEC was shown in [Appendix M](#).

Complaint received for Contract 1(last Reporting Period)

EPD has referred a complaint case to CEDD on 21 February 2019, which the resident from Sau Hong House complained that the noise from the Anderson Road Quarry construction site has gotten worse. The complainant suspecting the sound proof measure has lessen as time goes. In our investigation, CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. However, to eliminate the inconvenience caused to the nearby resident, CWSTVJV should properly maintain the noise mitigation measures as appropriate, such as maintain good site practices such as intermittent use of machine and plant and Sequencing operation of construction plant equipment. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance. The investigation report without comment from IEC was shown in [Appendix M](#).

Complaint received for Contract 1

A public complaint was received by DEVB and referred to CEDD on 25 February 2019 regarding on the noise generated from the construction works of the Anderson Road Quarry Site affecting a local resident residing at the Anderson Road Squatter Area. In our investigation, additional acoustic mat has been erected in front of the Squatter Area to minimize the noise impact. Noise mitigation measures such as acoustic barriers erected along the works area and breaker head wrapped with acoustic material were implemented continually. Alternative quiet work method was adopted such as drilling the hard rock before the breaking work to reduce the breaking duration. In our investigation, CWSTVJV had enhanced the noise mitigation measures to ease the complainant's concerns. The investigation report without comment from IEC was

shown in [Appendix M](#).

Complaint received for Contract 2

A complaint is forwarded by CEDD which was received by KTDC member Mr CHENG Keung Fung from the residents of Tsui Yeung House(翠楊樓) about the noise nuisance generated and the working time up to 7:00 pm from the rock excavation of E3 lift tower. Follow up action is requested. The investigation for the complaint is underway by ET.

8.1.2 The complaint log and Investigation Report for the above complaints are shown in [Appendix M](#).

8.1.3 The statistical summary table of environmental complaint, summons and prosecution is presented in **Tables 8-1, 8-2 and 8-3**.

Table 8-1 Statistical Summary of Environmental Complaints

Reporting Period	Contract no.	Environmental Complaint Statistics		
		Frequency	Cumulative	Complaint Nature
1 Apr 2017 – 28 Feb 2019	1	0	37	Dust, Noise and light nuisance
21 Mar 2017 –28 Feb 2019	2	0	3	Noise
31 May 2018 –28 Feb 2019	3	0	1	Waste Management
1 – 31 Mar 2019	1	1 (#)	38	Noise
	2	1	4	NA
	3	0	1	NA

Received in February 19 but taken account in this Reporting Period.

Table 8-2 Statistical Summary of Environmental Summons

Reporting Period	Contract no.	Environmental Summons Statistics		
		Frequency	Cumulative	Summons Nature
1 Apr 2017 – 28 Feb 2019	1	0	0	NA
21 Mar 2017 –28 Feb 2019	2	0	0	NA
31 May 2018 –28 Feb 2019	3	0	0	NA
1 – 31 Mar 2019	1	0	0	NA
	2	0	0	NA
	3	0	0	NA

Table 8-3 Statistical Summary of Environmental Prosecution

Reporting Period	Contract no.	Environmental Prosecution Statistics		
		Frequency	Cumulative	Prosecution Nature
1 Apr 2017 – 28 Feb 2019	1	0	0	NA
21 Mar 2017 –28 Feb 2019	2	0	0	NA
31 May 2018 –28 Feb 2019	3	0	0	NA
1 – 31 Mar 2019	1	0	0	NA
	2	0	0	NA
	3	0	0	NA

9. IMPLEMENTATION STATUS OF MITIGATION MEASURES**9.1 GENERAL REQUIREMENTS**

- 9.1.1 The environmental mitigation measures that recommended in the Implementation Schedule for Environmental Mitigation Measures (ISEMM) in the approved EM&A Manual covered the issues of dust, noise, water and waste and they are summarized presented in [Appendix L](#).
- 9.1.2 All contracts under the Project shall be implementing the required environmental mitigation measures according to the approved EM&A Manual as subject to the site condition. Environmental mitigation measures generally implemented in this Reporting Period are summarized in **Table 9-1**.

Table 9-1 Environmental Mitigation Measures

Issues	Environmental Mitigation Measures
Water Quality	<ul style="list-style-type: none"> Wastewater to be treated by filtration system; such as, silt curtain or sedimentation tank before discharge. Replace silt curtain materials if necessary
Air Quality	<ul style="list-style-type: none"> Maintain damp / wet surface on access road Keep slow speed in the sites All vehicles must use wheel washing facility before off site All vehicles must use wheel washing facility before off site Sprayed water during breaking works
Noise	<ul style="list-style-type: none"> Restrain operation time of plants from 07:00 to 19:00 on any working day except for Public Holiday and Sunday. Keep good maintenance of plants Place noisy plants away from residence or school Provide noise barriers or hoarding to enclose the noisy plants or works Shut down the plants when not in used.
Waste and Chemical Management	<ul style="list-style-type: none"> On-site sorting prior to disposal Follow requirements and procedures of the “Trip-ticket System” Predict required quantity of concrete accurately Collect the unused fresh concrete at designated locations in the sites for subsequent disposal
General	<ul style="list-style-type: none"> The site was generally kept tidy and clean.

9.2 TENTATIVE CONSTRUCTION ACTIVITIES IN THE COMING MONTH

- 9.2.1 Construction activities for Contract 1 in the coming month are listed below:
- Implementation of Temporary Traffic Arrangement at the junction between On Sau Road and Road L4, Po Lam Road near Po Tat Estate and Po Lam Road near Ma Yau tong Village;
 - Excavation of footing at South and North Towers of Pedestrian Connectivity System B (PSCB);
 - Excavation works for Subway of PCSB;
 - Construction of drainage pipe 1350mm dia. from M/H S310 to M/H X3A near North Tower of PCSB;
 - Construction of drainage works near the box culvert BC1 and BC2;
 - Construction of drainage works at Road L1 between Road L3 and Road 5;
 - Excavation works from Bay 1 to Bay 10 of BC1 and constructions of bay 11 and 12 of BC01
 - Construction of box culvert BC2 of Bay 5, 6, 7 and 11;
 - Construction of water mains at Road L5;
 - Construction of pile cap and strap beams and steel post erection of Public Transport Terminus;
 - Road Improvement Works at Po Lam Road

12. Tunneling works at West Portal
13. Site formation works at slope A1 of East Portal and slope A3 West Portal
14. Excavation works for Water Pumping Station area;
15. Backfilling works for Retaining Wall RWA 13 and RWA 14;
16. Base slabs and walls at Salt and Fresh Water Reservoir;
17. Retaining walls of Artificial Flood Attenuation Lake;
18. Construction of U channels for the area of Portal B8 and KW Asphalt Plant;
19. Construction of walls and columns works for Underground Stormwater Retention Tank (USRT)
20. Noise Barrier walls, Retaining Walls RWA12 and RWA18 for internet road L4; and
21. Rock Slope Survey and Slope Stabilization at Portion B1 and B5

9.2.2 Construction activities for Contract 2 in the coming month are listed below:

1. Portion 1: Excavation and shoring works for E1 – PC3 & E1 –PC5; piling works for Pile Cap E1 – PC3 and construction of Pier E1-P1
2. Portion 2: Continue rock slope excavation for E3-ST1 and E3-F1; rock excavation for E3-F1; existing lighting removal and installation of rock dowel
3. Portion 3: Relocation of existing pedestrian crossing
4. Portion 4: Rectification of defects
5. Portion 5: - Excavation and Shoring works for covered walkway footing BBI-NB-F2,F1a,F1b; footing Construction for Northern and Southern High Mast; Relocation of High Masts and drainage Works
6. Portion 6: Rock breaking for rock cut slope and BBI Footing; fixing formwork, reinforcement and place concrete for RWE12

9.2.3 Construction activities for Contract 3 in the coming month are listed below:

1. Setup Temporary Traffic Arrangement (TTA) on the road (all area);
2. Erect hoarding and construct haul road at RIW1, RIW2 and RIW3;
3. *Aquilaria Sinensis* root pruning at Portion B;
4. Socketed H-pile works at PC-E11
5. ELS works for footing construction at PC-System A;
6. Excavate works for footing construction at BBI Public Toilet
7. Tree felling works and tree transplant works at RIW1, RIW2, RIW3, PC-E8;
8. Utilities mapping on RIW3;

9.3 KEY ISSUES FOR THE COMING MONTH

9.3.1 Key issues to be considered in the coming month include:

- Implementation of dust suppression measures at all times;
- Potential wastewater quality impact due to surface runoff;
- Potential fugitive dust quality impact due from the dry/loose/exposure soil surface/dusty material;
- Disposal of empty engine oil containers within site area;
- Ensure dust suppression measures are implemented properly;
- Sediment catch-pits and silt removal facilities should be regularly maintained;
- Management of chemical wastes;
- Discharge of site effluent to the nearby wetland, stockpiling or disposal of materials, and any dredging or construction area at this area are prohibited;
- Follow-up of improvement on general waste management issues; and
- Implementation of construction noise preventative control measures

10. CONCLUSIONS AND RECOMMENDATIONS

10.1 CONCLUSIONS

- 10.1.1 This is 24th monthly EM&A report presenting the monitoring results and inspection findings for the Reporting Period from 1 to 31 March 2019.
- 10.1.2 No 24-hour or 1-hour TSP monitoring results that triggered the Action or Limit Levels were recorded. No NOEs or the associated corrective actions were therefore issued.
- 10.1.3 In the Reporting Period, no exceedance was recorded and no Notification of Exceedance was issued. Moreover, two noise complaints (which triggered Action Level) were received for the Project. Investigation for the complaint for NE/2016/01 was completed by ET which revealed that the Contractor has enhanced the noise mitigation measures in response to the complainant. The Investigation for complaint under Contract NE/2016/05 is underway by ET.
- 10.1.4 In the Reporting Period, two (2) environmental complaints were received with respect to the noise concerns arising from the Project in relation to work under Contract NE/2016/01 and Contract NE/2016/05. Investigation for the complaint for NE/2016/01 was completed by ET which revealed that the Contractor has enhanced the noise mitigation measures in response to the complainant. The Investigation for complaint under Contract NE/2016/05 is underway by ET.
- 10.1.5 No notification of summons or successful prosecution was received under the Project.
- 10.1.6 During the Reporting Period, weekly joint site inspection by the RE, ET with the relevant Main-contractor was carried out for Contracts 1, 2 and 3 in accordance with the EM&A Manual stipulation whereas IEC performed monthly site inspection for both contracts. No non-compliance observed during the site inspection.


10.2 RECOMMENDATIONS

- 10.2.1 As wet season is approaching, preventive measures for muddy water or other water pollutants from site surface overflow to public area should be properly maintained. The Contractors should paid special attention on water quality mitigation measures and fully implement according ISEMM of the EM&A Manual.
- 10.2.2 Since construction site is highly visible to the resident at nearby estates, the Contractors should fully implement air quality mitigation measures to reduce construction dust emission.
- 10.2.3 Construction noise would be a key environmental issue during construction work of the Project. Noise mitigation measures such as using quiet plants should be implemented in accordance with the EM&A requirement.
- 10.2.4 In addition, all effluent discharge shall be ensure to fulfill Technical Memorandum of Effluent Discharged into Drainage and Sewerage Systems, inland and Coastal Waters criteria or discharge permits stipulation.
- 10.2.5 Mosquito control measures should be continued to prevent mosquito breeding on site.



Appendix A

Layout plan of the Project

Contract Packages

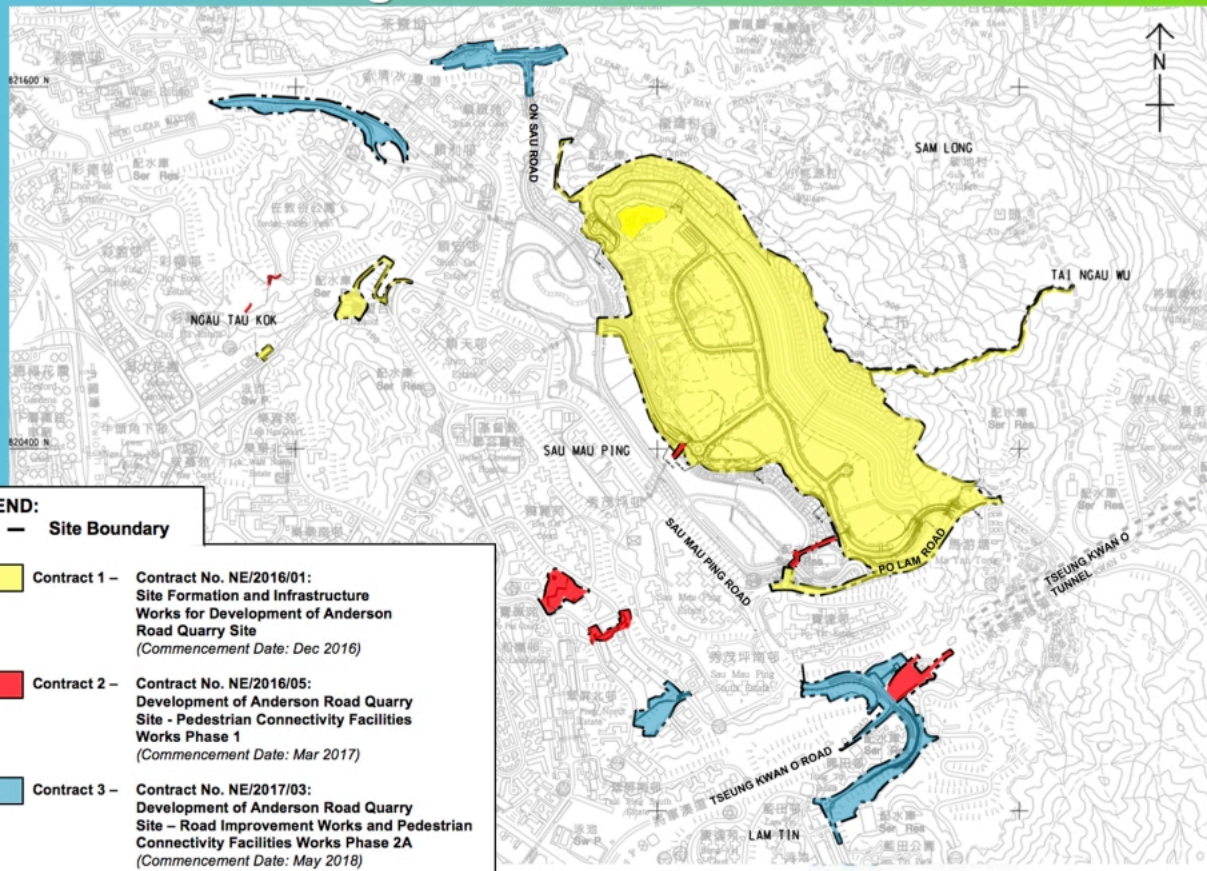

Layout plan of Contract 1 (NE/2016/01)

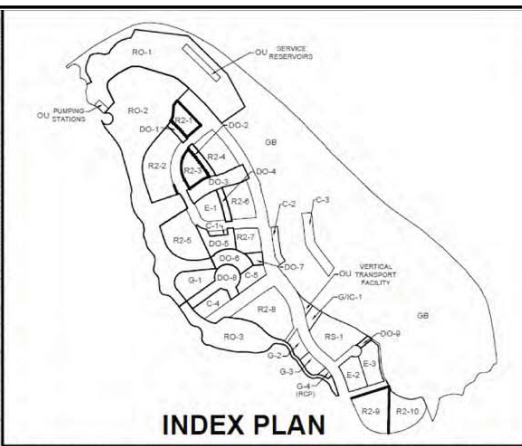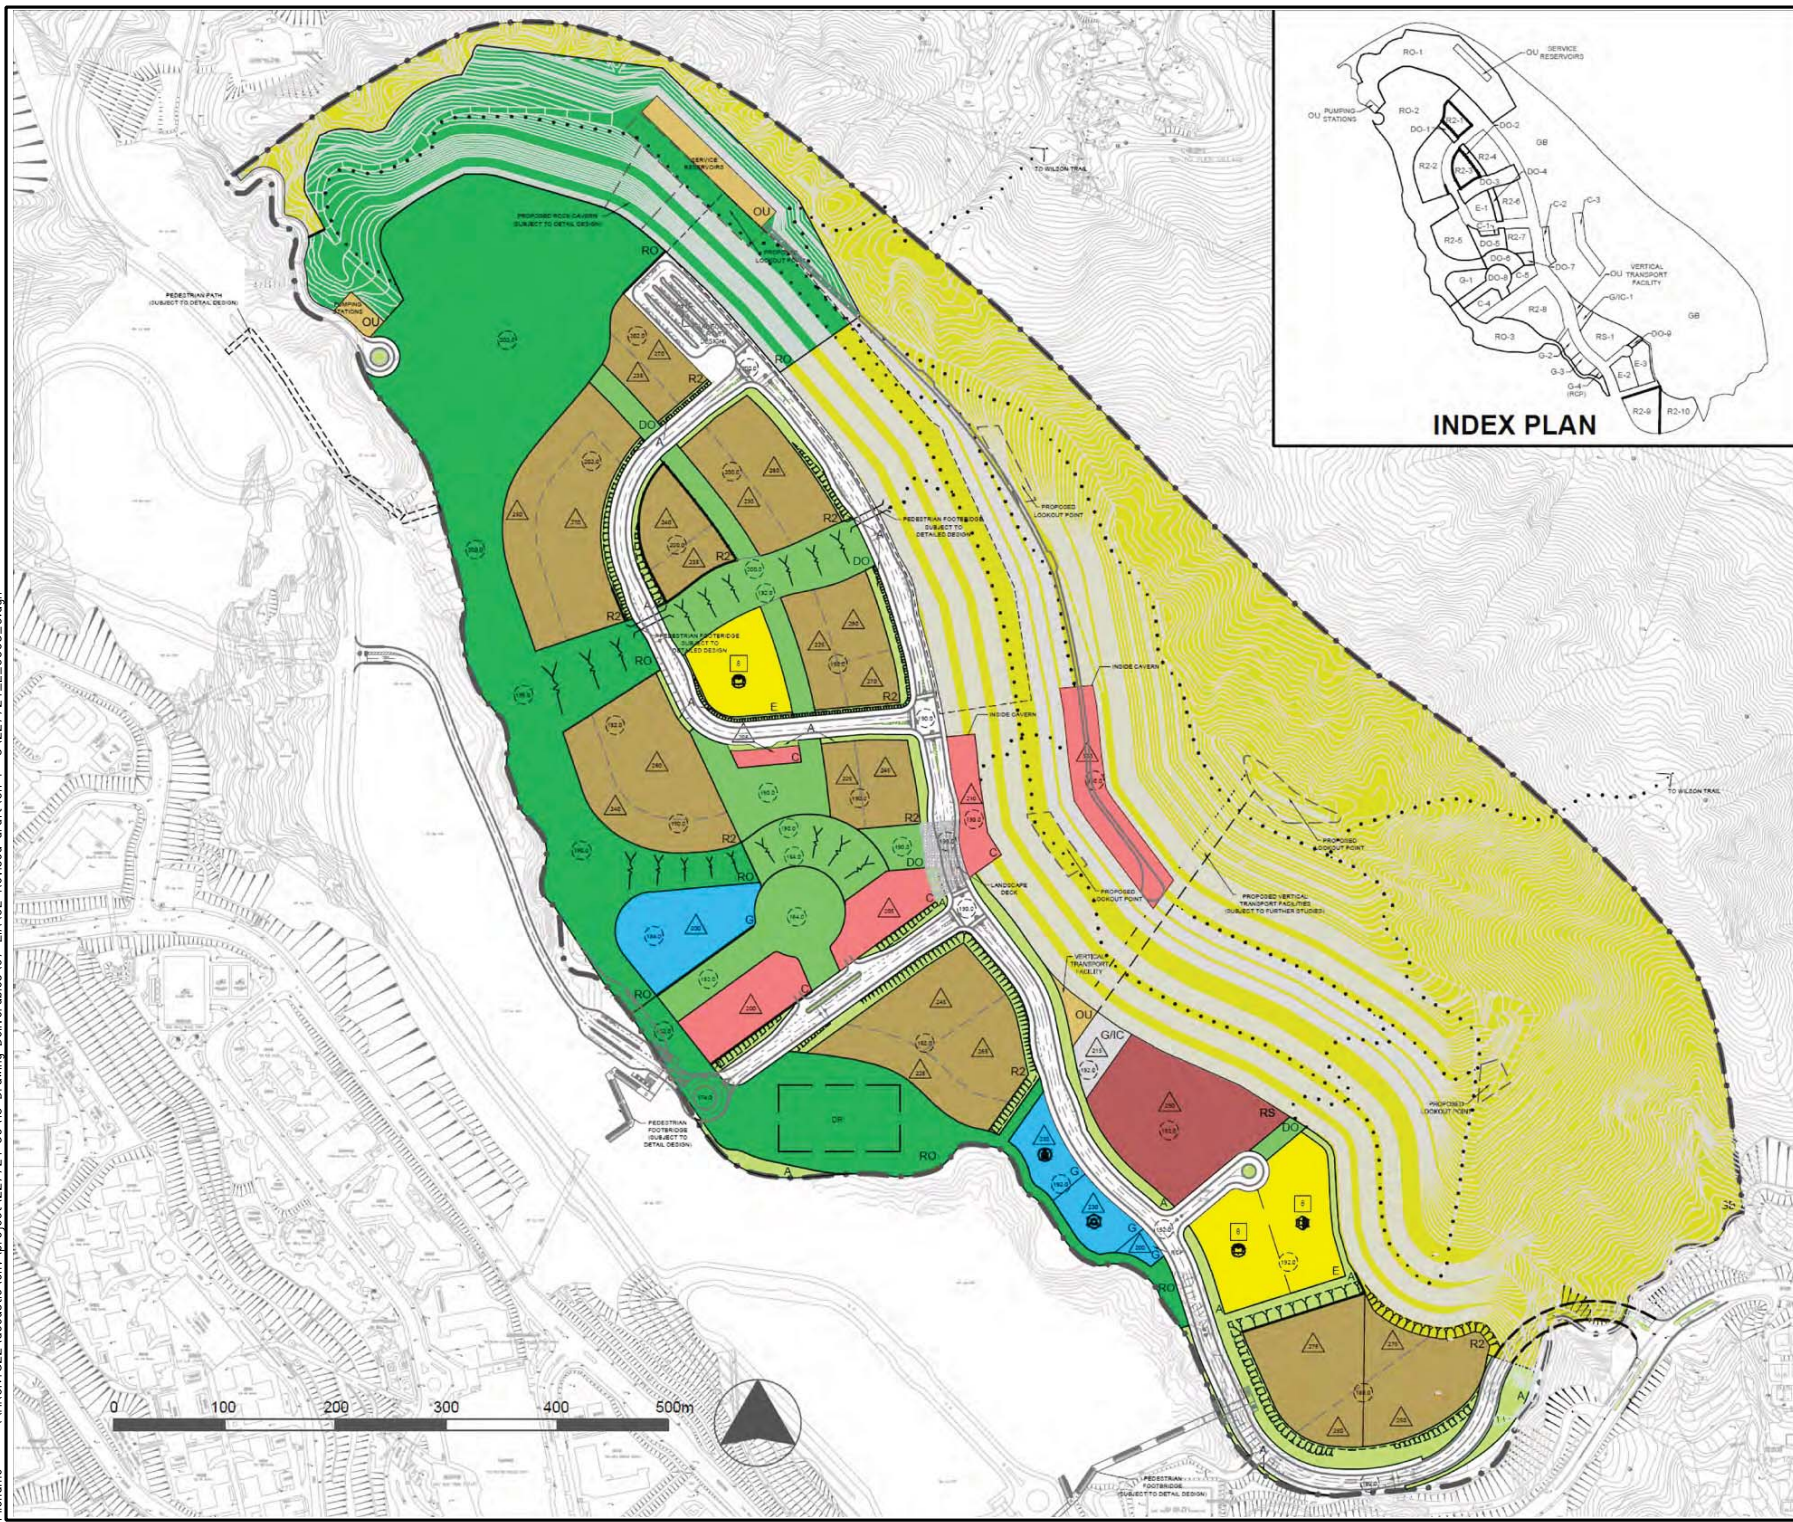


LEGEND

- POLICE STATION
- DIVISIONAL FIRE STATION
- SECONDARY SCHOOL
- PRIMARY SCHOOL
- PUBLIC TRANSPORT TERMINUS
- PLANNING BOUNDARY
- UNDERPASS
- PROPOSED PEDESTRIAN TRAIL
- PEDESTRIAN PRECINCT
- DRAINAGE RESERVE
- MAXIMUM BUILDING HEIGHT (in m above PD)
- MAXIMUM BUILDING HEIGHT (in storeys)
- PROPOSED LEVEL (in m above PD)
- PROPOSED SLOPE
- REFUSE COLLECTION POINT
- FOOTBRIDGE
- COMMERCIAL
- SPECIAL RESIDENTIAL
- RESIDENTIAL ZONE-2
- GOVERNMENT
- GOVERNMENT INSTITUTION OR COMMUNITY
- EDUCATION
- REGIONAL OPEN SPACE
- DISTRICT OPEN SPACE
- AMENITY
- OTHER SPECIFIED USES
- GREEN BELT
- ROADS, JUNCTIONS, ETC.
- AREA WITH POTENTIAL FOR ROCK CAVERN DEVELOPMENT

C	THIRD ISSUE	GL	03/14
B	SECOND ISSUE	GL	01/14
A	FIRST ISSUE	GL	10/13
Rev	Description	By	Date
Consultant			
ARUP			
Contract No. and Title			
Agreement No. CE 18/2012(CE)			
Development of Anderson Road Quarry - Investigation			
Drawing title			
Recommended Outline Development Plan			
Drawing no.		227724/E/0003	Rev. C
Drawn	Date	Checked	Approved
GL	03/14	TC	ST
Scale	AS SHOWN	Status	PRELIMINARY
COPYRIGHT RESERVED			
土木工程拓展署 Civil Engineering and Development Department			

Layout plan of Contract 2 (NE/2016/05)

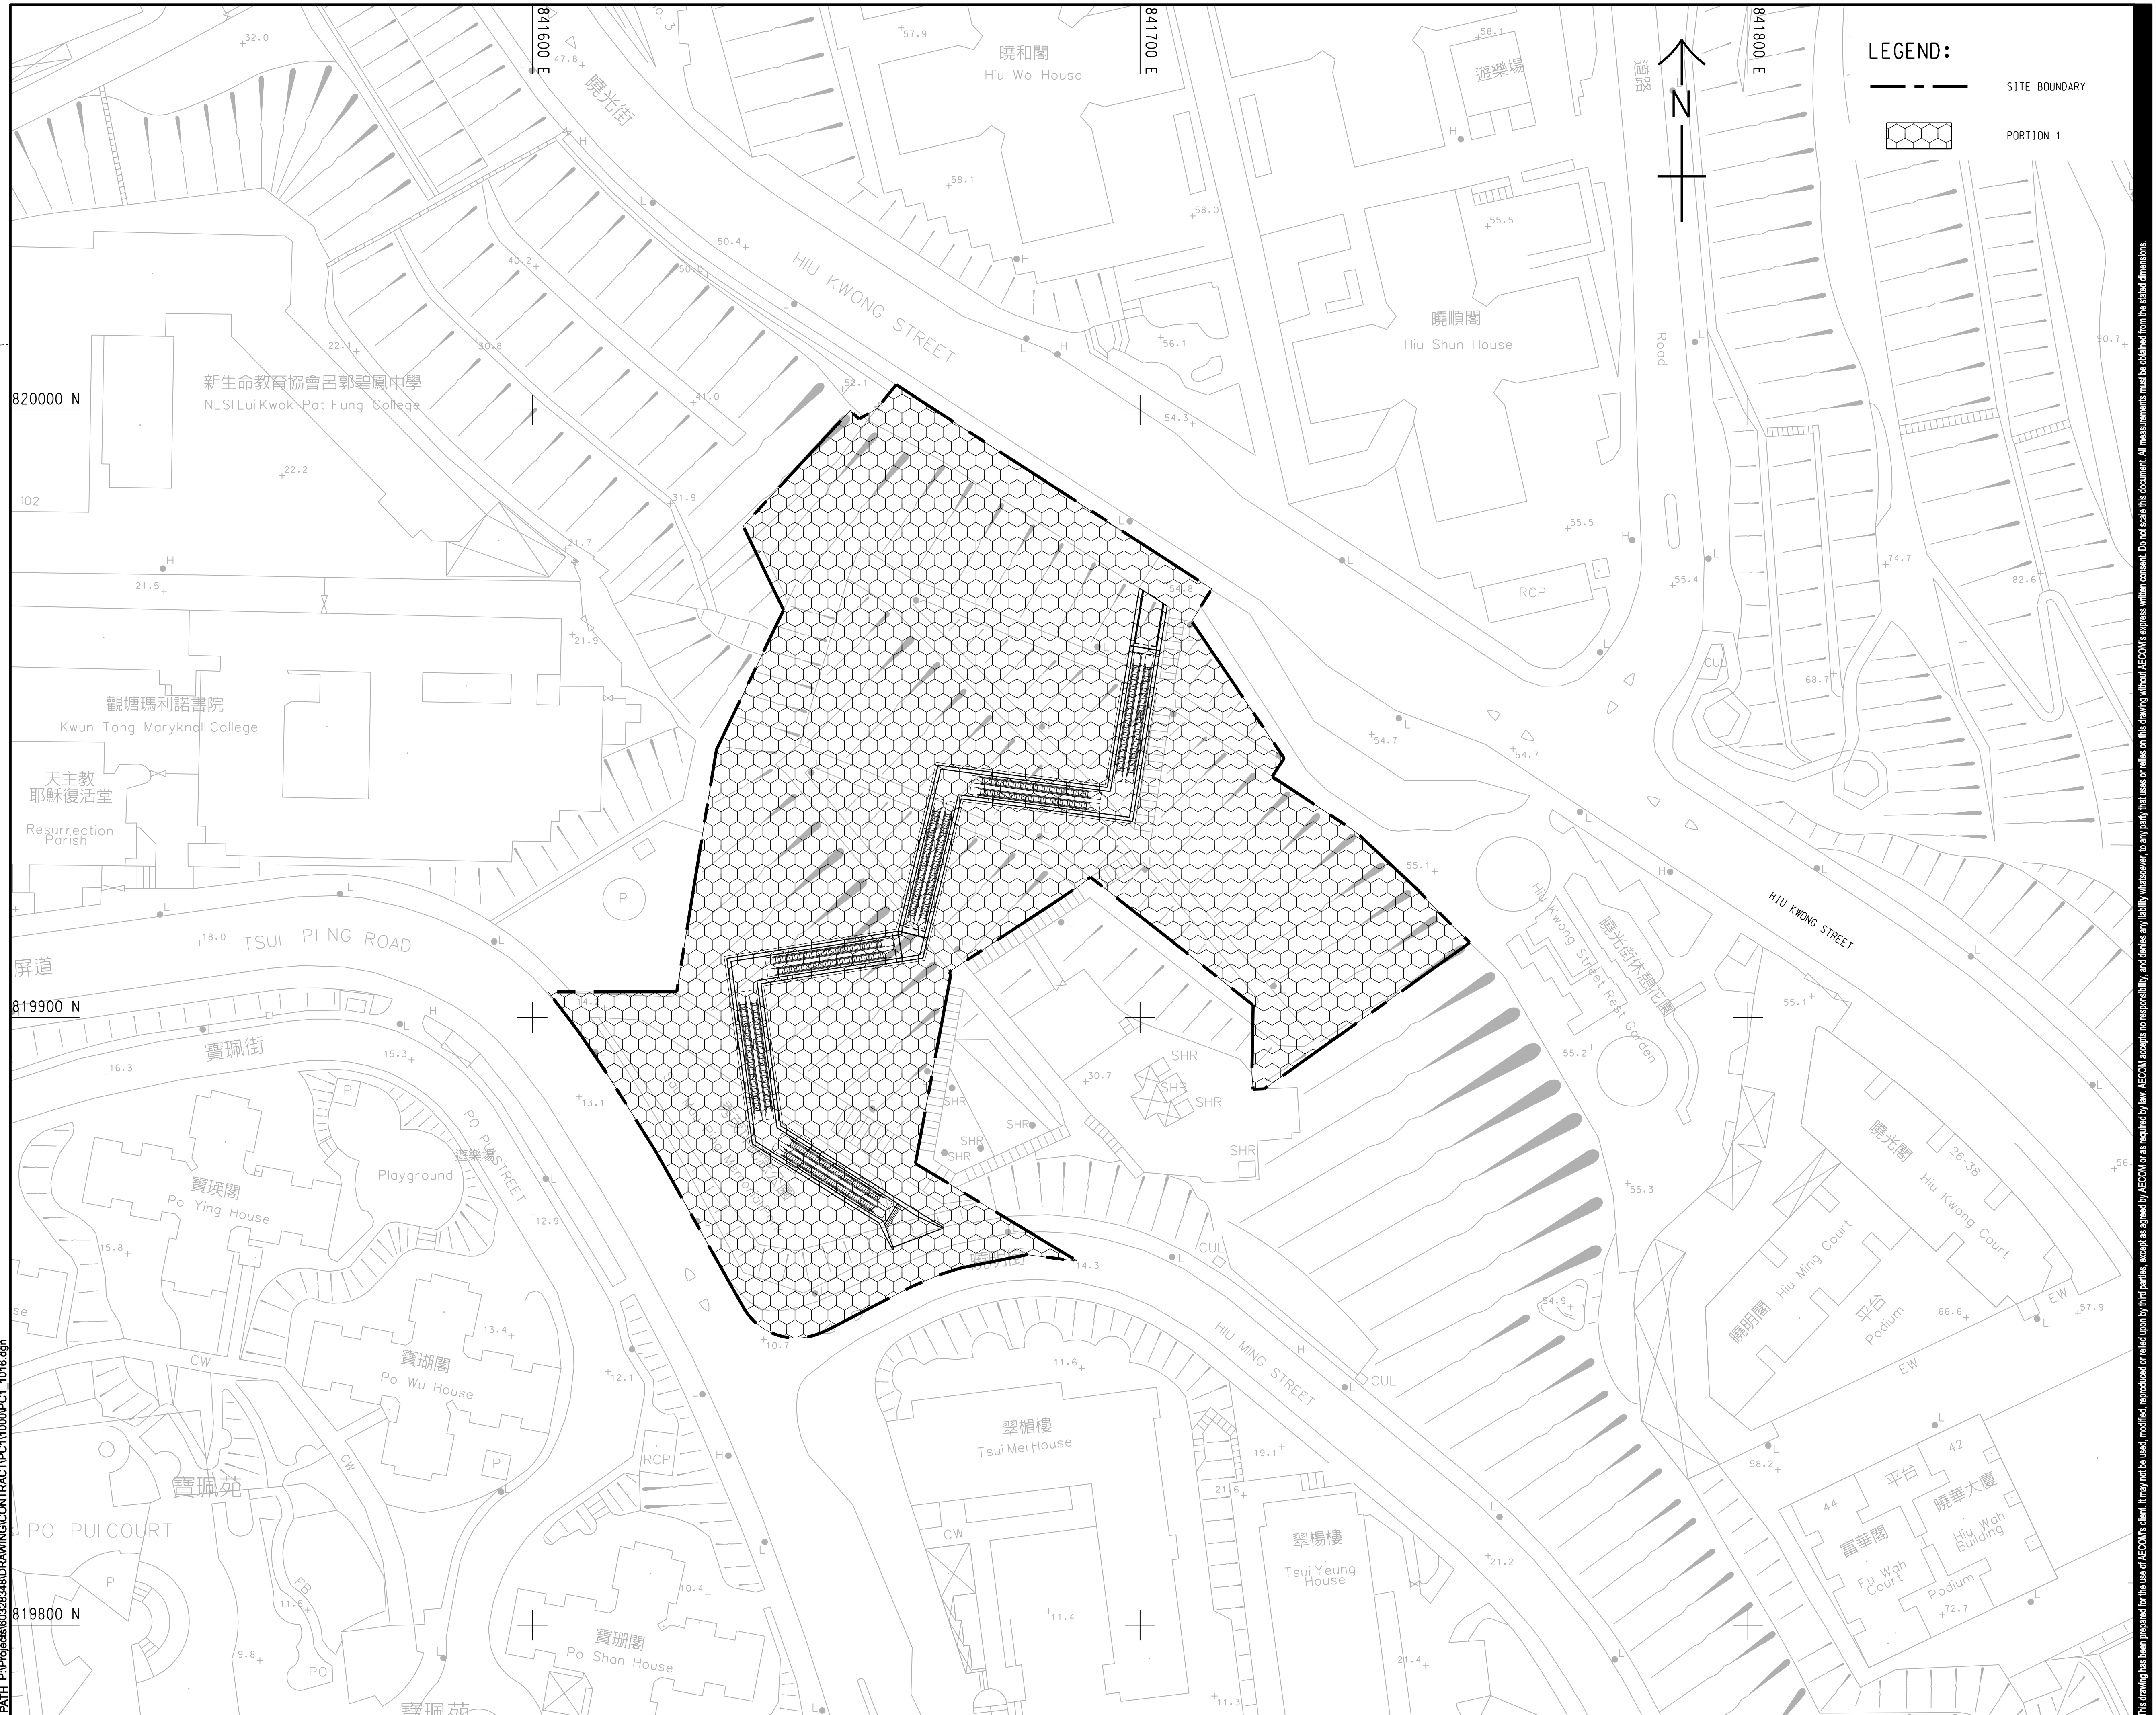


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the scaled dimensions.

60328348/PC1/1016

Pld File by: WANGGLW 2016/10/24
PATH P:\Projects\60328348\DRAWING\CONTRACT\PC1\2000\PC1_2016.dgn

Project Management Initials: Designer: *W* PCTR Checked: *AL* Approved: *B*
BWCW ISO A1 594mm x 841mm

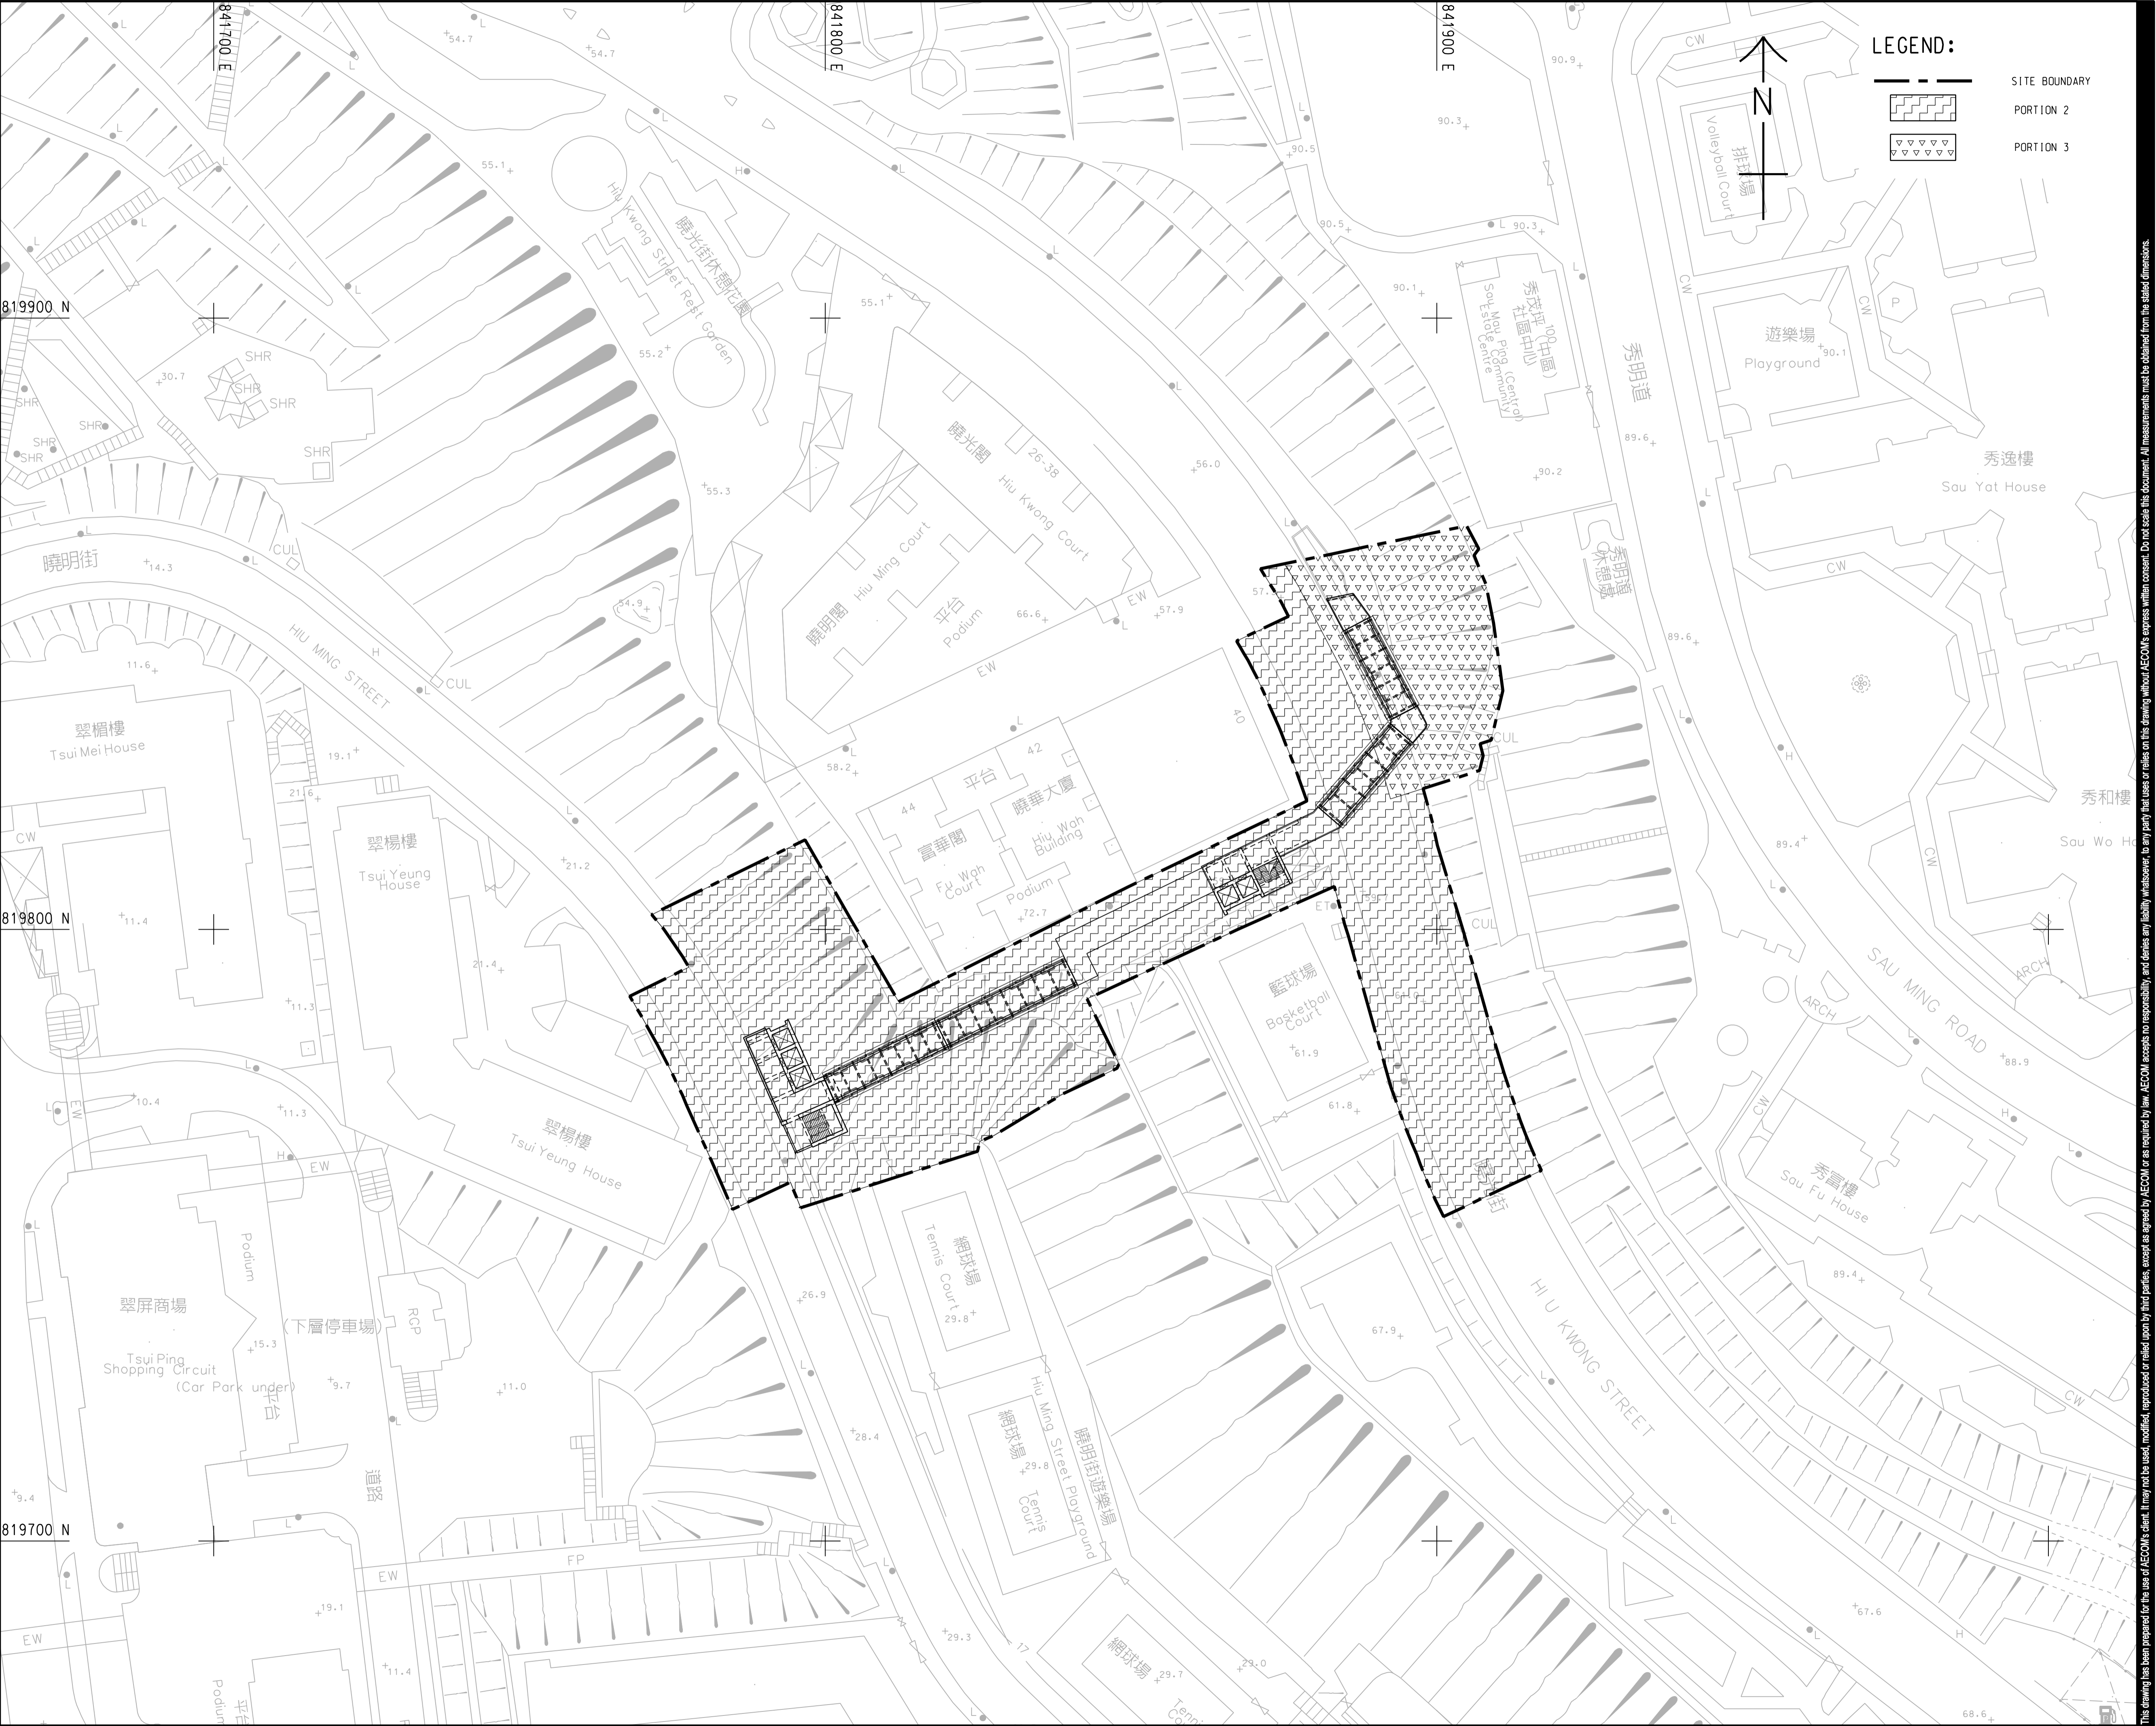

AECOM

PROJECT
項目

**DEVELOPMENT OF
ANDERSON ROAD
QUARRY SITE - INVESTIGATION,
DESIGN AND CONSTRUCTION**

CONTRACT TITLE
PEDESTRIAN CONNECTIVITY
FACILITIES WORKS PHASE 1

CLIENT
業主

CEDD 土木工程拓展署
Civil Engineering and
Development Department

CONSULTANT
工程顧問公司

AECOM Asia Company Ltd.
www.aecom.com

SUB-CONSULTANTS
分判工程顧問公司

ISSUE/REVISION
修訂

I/R	DATE	DESCRIPTION	CHK.
-	OCT. 16	TENDER DRAWING	<i>AL</i> AC

STATUS
階段

SCALE
比例

A1 1 : 500

DIMENSION UNIT
尺寸單位

METRES

KEY PLAN
索引圖

A1 1 : 60000

PROJECT NO.
項目編號

60328348

CONTRACT NO.
合約編號

NE/2016/05

SHEET TITLE
圖紙名稱

E2-C1-E3 - PORTION OF SITE


SHEET NUMBER
圖紙編號

60328348/PC1/2016

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

Project Management Initials:
 Designer:
 PCTK Checked:
 AC
 Approved:
 BW
 ISO A1 594mm x 841mm
 BWCW

Pld File by: WANGGLW 2016/10/25
 PATH P:\Projects\60328348\Drawing\contract\pc1\3000\PC1_3016.dgn

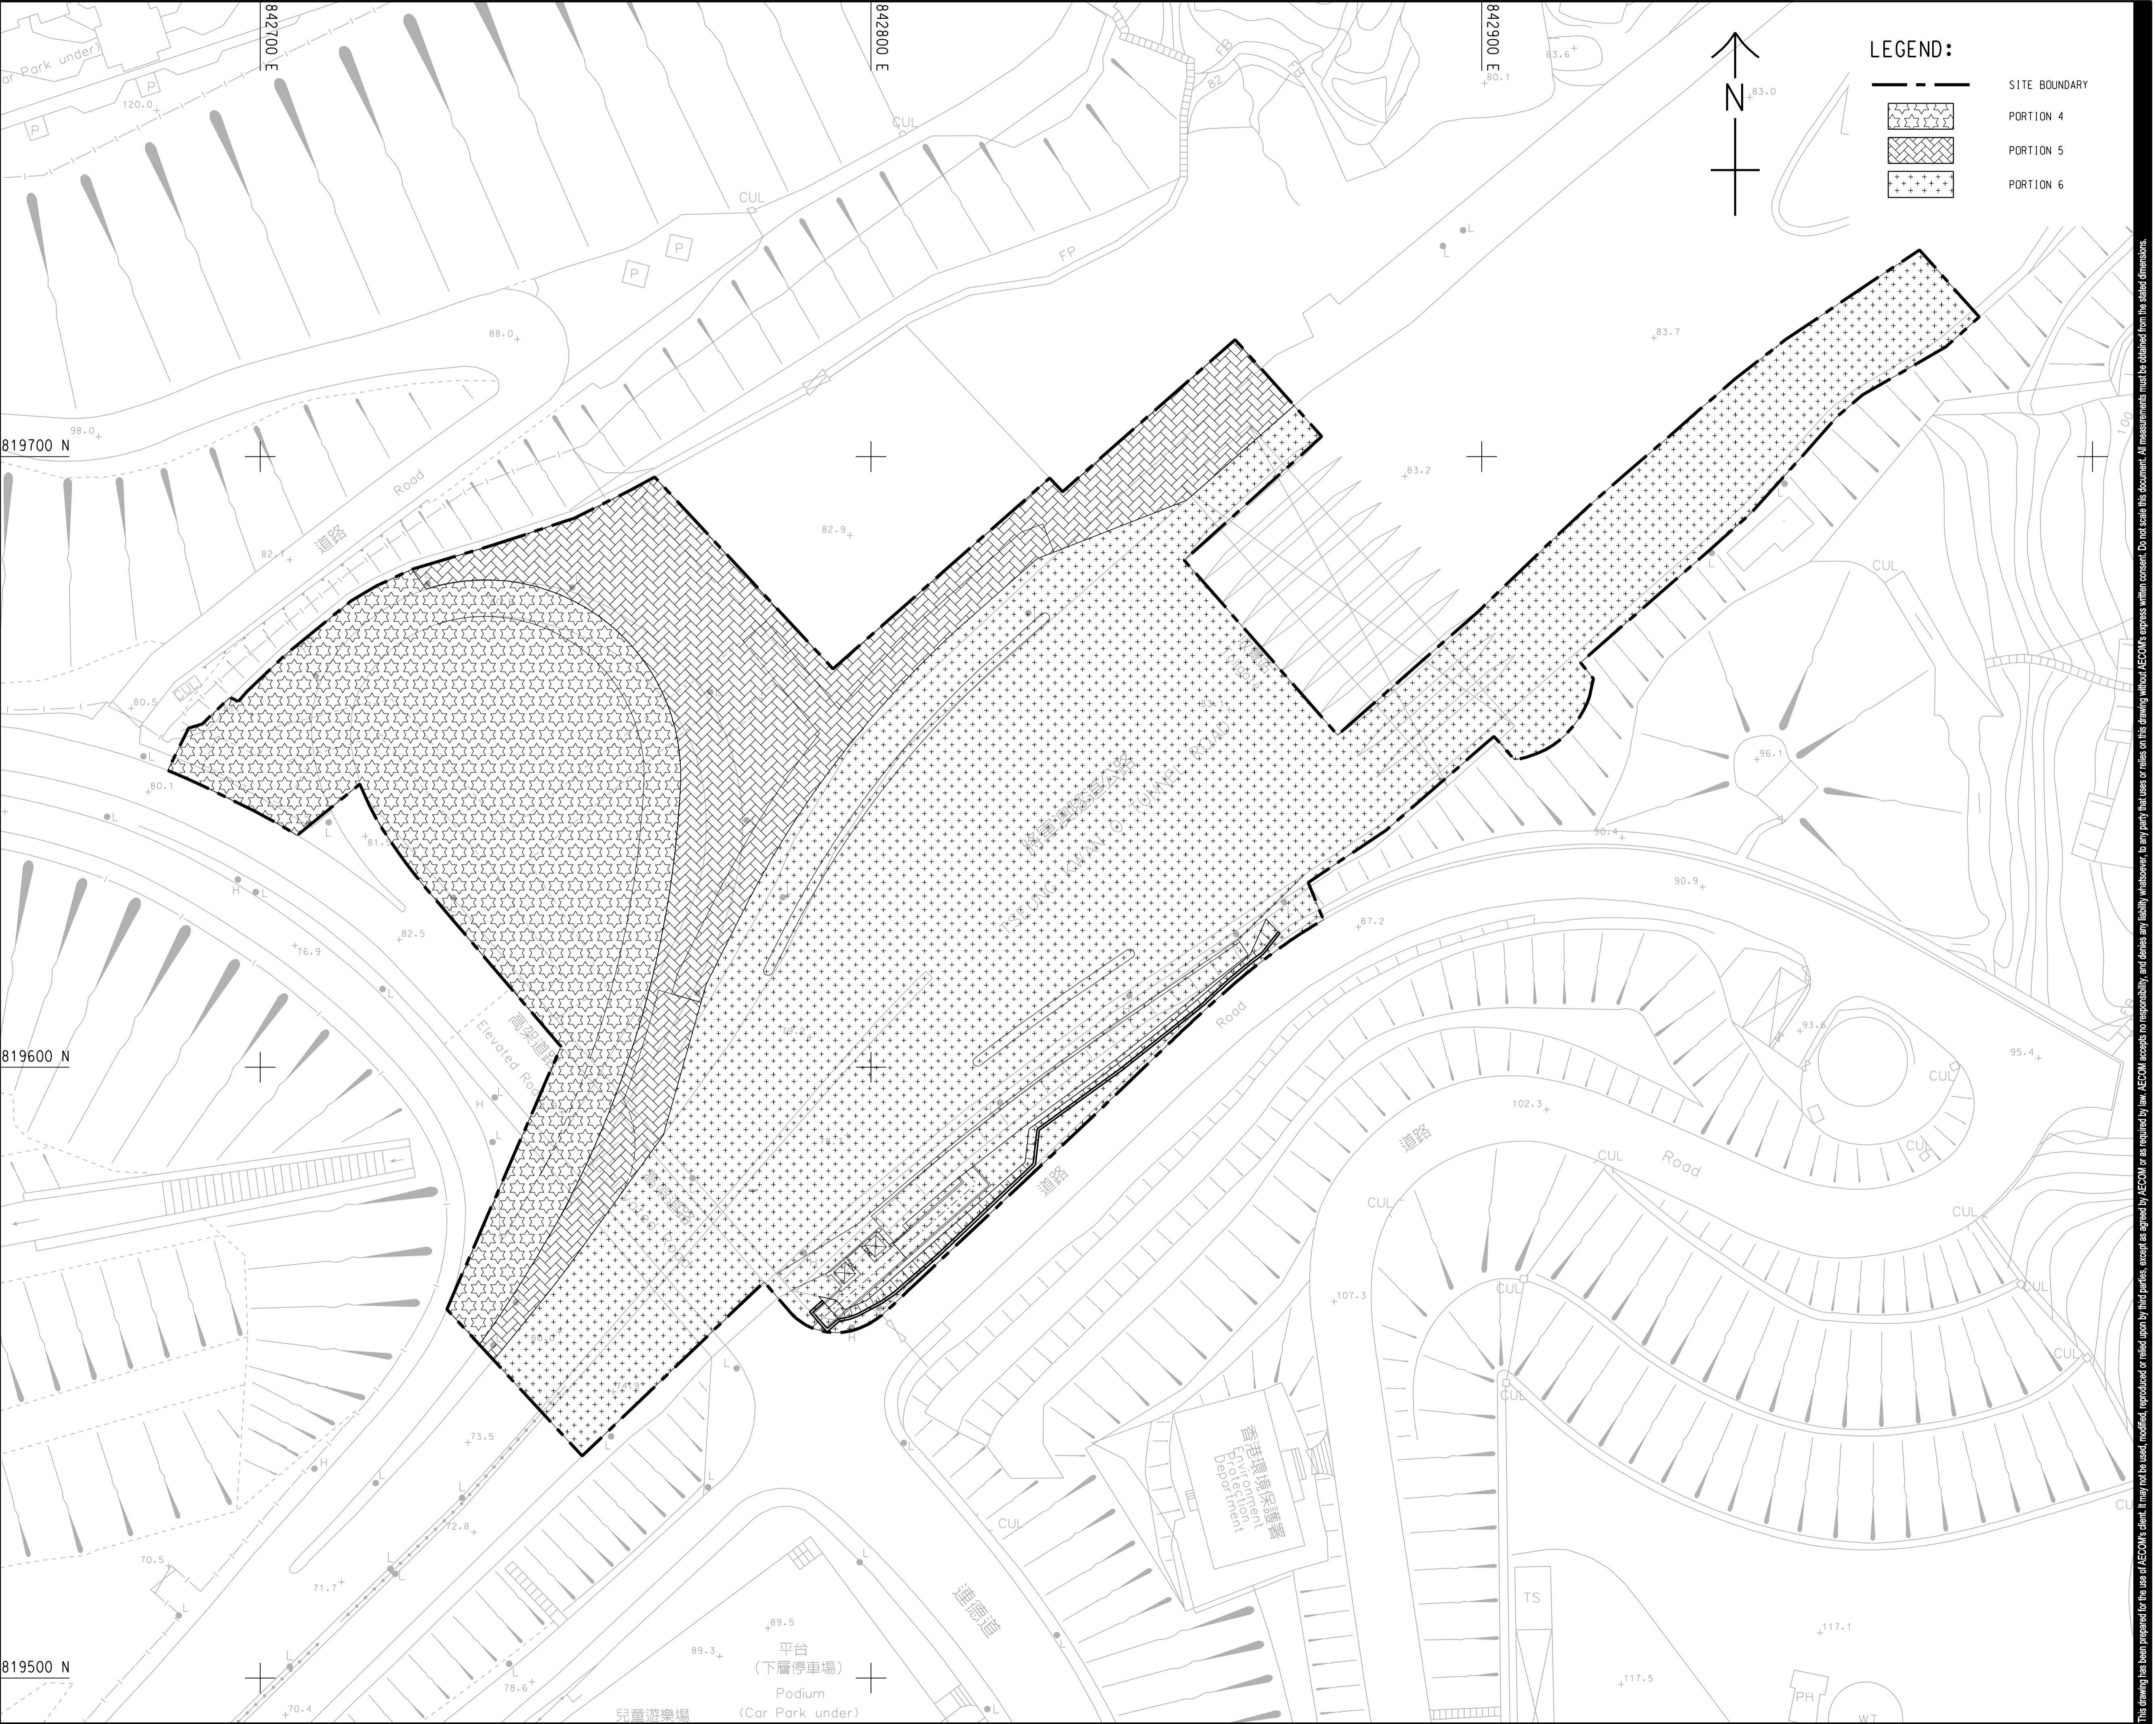

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the related dimensions.


AECOM

PROJECT
項目

**DEVELOPMENT OF
ANDERSON ROAD
QUARRY SITE - INVESTIGATION,
DESIGN AND CONSTRUCTION**

CONTRACT TITLE
PEDESTRIAN CONNECTIVITY
FACILITIES WORKS PHASE 1

CLIENT
業主



土木工程拓展署
Civil Engineering and
Development Department

CONSULTANT
工程顧問公司

AECOM Asia Company Ltd.
www.aecom.com

SUB-CONSULTANTS
分判工程顧問公司

ISSUE/REVISION
修訂

I/R 修訂	DATE 日期	DESCRIPTION 內容摘要	CHK. 覆核
-	OCT. 16	TENDER DRAWING	AC

STATUS
階段


SCALE
比例

DIMENSION UNIT
尺寸單位

A1 1 : 500 METRES

KEY PLAN
索引圖

A1 1 : 60000

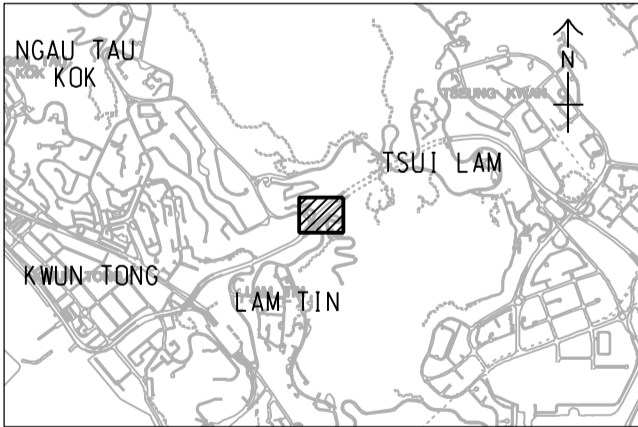

PROJECT NO.
項目編號

CONTRACT NO.
合約編號


60328348 NE/2016/05

SHEET TITLE
圖紙名稱

E12 AND BBI - PORTION OF SITE

SHEET NUMBER
圖紙編號

60328348/PC1/3016

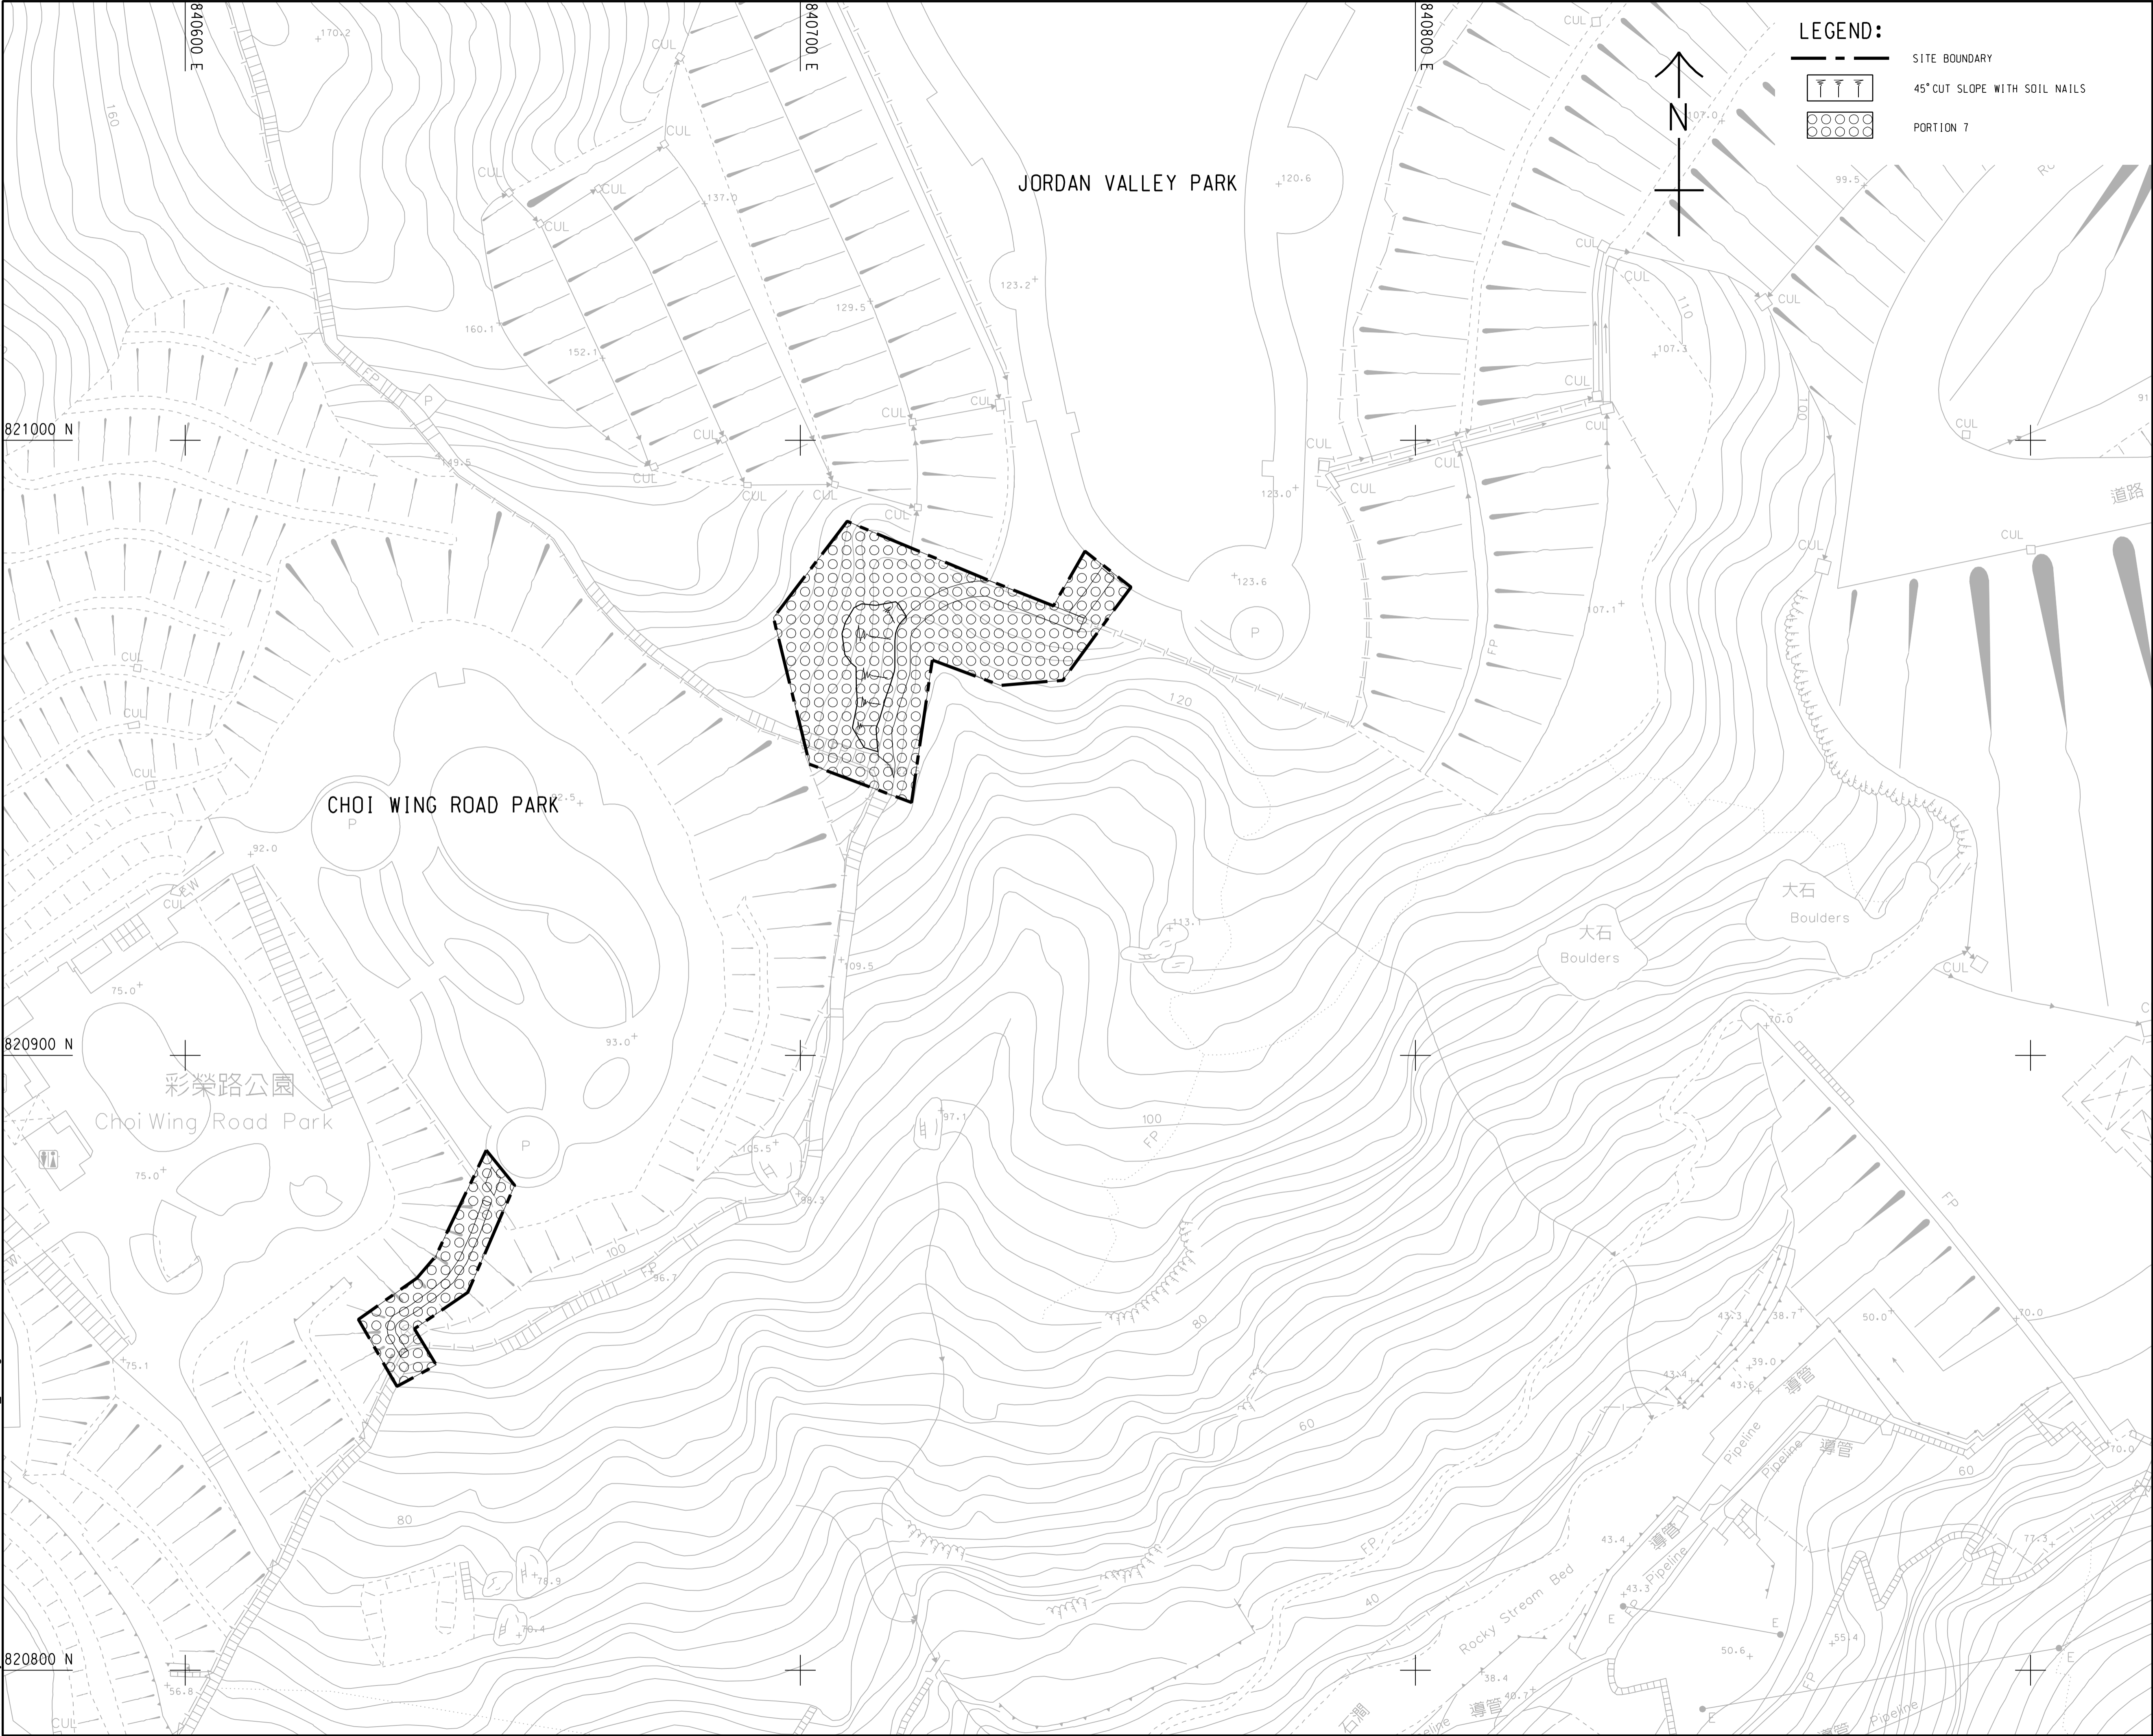

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

DEVELOPMENT OF
ANDERSON ROAD
QUARRY SITE - INVESTIGATION,
DESIGN AND CONSTRUCTION

CONTRACT TITLE
PEDESTRIAN CONNECTIVITY
FACILITIES WORKS PHASE 1

CLIENT

CEDD 土木工程拓展署
Civil Engineering and
Development Department

CONSULTANT

AECOM Asia Company Ltd.
www.aecom.com

SUB-CONSULTANTS

分判工程顧問公司

ISSUE/REVISION

I/R	DATE	DESCRIPTION	CHK.
-	OCT. 16	TENDER DRAWING	AC
1/R	16/10/2016	16/10/2016	AC
2/R	16/10/2016	16/10/2016	AC
3/R	16/10/2016	16/10/2016	AC
4/R	16/10/2016	16/10/2016	AC
5/R	16/10/2016	16/10/2016	AC
6/R	16/10/2016	16/10/2016	AC
7/R	16/10/2016	16/10/2016	AC
8/R	16/10/2016	16/10/2016	AC
9/R	16/10/2016	16/10/2016	AC
10/R	16/10/2016	16/10/2016	AC
11/R	16/10/2016	16/10/2016	AC
12/R	16/10/2016	16/10/2016	AC
13/R	16/10/2016	16/10/2016	AC
14/R	16/10/2016	16/10/2016	AC
15/R	16/10/2016	16/10/2016	AC
16/R	16/10/2016	16/10/2016	AC
17/R	16/10/2016	16/10/2016	AC
18/R	16/10/2016	16/10/2016	AC
19/R	16/10/2016	16/10/2016	AC
20/R	16/10/2016	16/10/2016	AC
21/R	16/10/2016	16/10/2016	AC
22/R	16/10/2016	16/10/2016	AC
23/R	16/10/2016	16/10/2016	AC
24/R	16/10/2016	16/10/2016	AC
25/R	16/10/2016	16/10/2016	AC
26/R	16/10/2016	16/10/2016	AC
27/R	16/10/2016	16/10/2016	AC
28/R	16/10/2016	16/10/2016	AC
29/R	16/10/2016	16/10/2016	AC
30/R	16/10/2016	16/10/2016	AC
31/R	16/10/2016	16/10/2016	AC
32/R	16/10/2016	16/10/2016	AC
33/R	16/10/2016	16/10/2016	AC
34/R	16/10/2016	16/10/2016	AC
35/R	16/10/2016	16/10/2016	AC
36/R	16/10/2016	16/10/2016	AC
37/R	16/10/2016	16/10/2016	AC
38/R	16/10/2016	16/10/2016	AC
39/R	16/10/2016	16/10/2016	AC
40/R	16/10/2016	16/10/2016	AC
41/R	16/10/2016	16/10/2016	AC
42/R	16/10/2016	16/10/2016	AC
43/R	16/10/2016	16/10/2016	AC
44/R	16/10/2016	16/10/2016	AC
45/R	16/10/2016	16/10/2016	AC
46/R	16/10/2016	16/10/2016	AC
47/R	16/10/2016	16/10/2016	AC
48/R	16/10/2016	16/10/2016	AC
49/R	16/10/2016	16/10/2016	AC
50/R	16/10/2016	16/10/2016	AC
51/R	16/10/2016	16/10/2016	AC
52/R	16/10/2016	16/10/2016	AC
53/R	16/10/2016	16/10/2016	AC
54/R	16/10/2016	16/10/2016	AC
55/R	16/10/2016	16/10/2016	AC
56/R	16/10/2016	16/10/2016	AC
57/R	16/10/2016	16/10/2016	AC
58/R	16/10/2016	16/10/2016	AC
59/R	16/10/2016	16/10/2016	AC
60/R	16/10/2016	16/10/2016	AC
61/R	16/10/2016	16/10/2016	AC
62/R	16/10/2016	16/10/2016	AC
63/R	16/10/2016	16/10/2016	AC
64/R	16/10/2016	16/10/2016	AC
65/R	16/10/2016	16/10/2016	AC
66/R	16/10/2016	16/10/2016	AC
67/R	16/10/2016	16/10/2016	AC
68/R	16/10/2016	16/10/2016	AC
69/R	16/10/2016	16/10/2016	AC
70/R	16/10/2016	16/10/2016	AC
71/R	16/10/2016	16/10/2016	AC
72/R	16/10/2016	16/10/2016	AC
73/R	16/10/2016	16/10/2016	AC
74/R	16/10/2016	16/10/2016	AC
75/R	16/10/2016	16/10/2016	AC
76/R	16/10/2016	16/10/2016	AC
77/R	16/10/2016	16/10/2016	AC
78/R	16/10/2016	16/10/2016	AC
79/R	16/10/2016	16/10/2016	AC
80/R	16/10/2016	16/10/2016	AC
81/R	16/10/2016	16/10/2016	AC
82/R	16/10/2016	16/10/2016	AC
83/R	16/10/2016	16/10/2016	AC
84/R	16/10/2016	16/10/2016	AC
85/R	16/10/2016	16/10/2016	AC
86/R	16/10/2016	16/10/2016	AC
87/R	16/10/2016	16/10/2016	AC
88/R	16/10/2016	16/10/2016	AC
89/R	16/10/2016	16/10/2016	AC
90/R	16/10/2016	16/10/2016	AC
91/R	16/10/2016	16/10/2016	AC
92/R	16/10/2016	16/10/2016	AC
93/R	16/10/2016	16/10/2016	AC
94/R	16/10/2016	16/10/2016	AC
95/R	16/10/2016	16/10/2016	AC
96/R	16/10/2016	16/10/2016	AC
97/R	16/10/2016	16/10/2016	AC
98/R	16/10/2016	16/10/2016	AC
99/R	16/10/2016	16/10/2016	AC
100/R	16/10/2016	16/10/2016	AC
101/R	16/10/2016	16/10/2016	AC
102/R	16/10/2016	16/10/2016	AC
103/R	16/10/2016	16/10/2016	AC
104/R	16/10/2016	16/10/2016	AC
105/R	16/10/2016	16/10/2016	AC
106/R	16/10/2016	16/10/2016	AC
107/R	16/10/2016	16/10/2016	AC
108/R	16/10/2016	16/10/2016	AC
109/R	16/10/2016	16/10/2016	AC
110/R	16/10/2016	16/10/2016	AC
111/R	16/10/2016	16/10/2016	AC
112/R	16/10/2016	16/10/2016	AC
113/R	16/10/2016	16/10/2016	AC
114/R	16/10/2016	16/10/2016	AC
115/R	16/10/2016	16/10/2016	AC
116/R	16/10/2016	16/10/2016	AC
117/R	16/10/2016	16/10/2016	AC
118/R	16/10/2016	16/10/2016	AC
119/R	16/10/2016	16/10/2016	AC
120/R	16/10/2016	16/10/2016	AC
121/R	16/10/2016	16/10/2016	AC
122/R	16/10/2016	16/10/2016	AC
123/R	16/10/2016	16/10/2016	AC
124/R	16/10/2016	16/10/2016	AC
125/R	16/10/2016	16/10/2016	AC
126/R	16/10/2016	16/10/2016	AC
127/R	16/10/2016	16/10/2016	AC
128/R	16/10/2016	16/10/2016	AC
129/R	16/10/2016	16/10/2016	AC
130/R	16/10/2016	16/10/2016	AC
131/R	16/10/2016	16/10/2016	AC
132/R	16/10/2016	16/10/2016	AC
133/R	16/10/2016	16/10/2016	AC
134/R	16/10/2016	16/10/2016	AC
135/R	16/10/2016	16/10/2016	AC
136/R	16/10/2016	16/10/2016	AC
137/R	16/10/2016	16/10/2016	AC
138/R	16/10/2016	16/10/2016	AC
139/R	16/10/2016	16/10/2016	AC
140/R	16/10/2016	16/10/2016	AC
141/R	16/10/2016	16/10/2016	AC
142/R	16/10/2016	16/10/2016	AC
143/R	16/10/2016	16/10/2016	AC
144/R	16/10/2016	16/10/2016	AC
145/R	16/10/2016	16/10/2016	AC
146/R	16/10/2016	16/10/2016	AC
147/R	16/10/2016	16/10/2016	AC
148/R	16/10/2016	16/10/2016	AC
149/R	16/10/2016	16/10/2016	AC
150/R	16/10/2016	16/10/2016	AC
151/R	16/10/2016	16/10/2016	AC
152/R	16/10/2016	16/10/2016	AC
153/R	16/10/2016	16/10/2016	AC
154/R	16/10/2016	16/10/2016	AC
155/R	16/10/2016	16/10/2016	AC
156/R	16/10/2016	16/10/2016	AC
157/R	16/10/2016	16/10/2016	AC
158/R	16/10/2016	16/10/2016	AC
159/R	16/10/2016	16/10/2016	AC
160/R	16/10/2016	16/10/2016	AC
161/R	16/10/2016	16/10/2016	AC
162/R	16/10/2016	16/10/2016	AC
163/R	16/10/2016	16/10/2016	AC
164/R	16/10/2016	16/10/2016	AC
165/R	16/10/2016	16/10/2016	AC
166/R	16/10/2016	16/10/2016	AC
167/R	16/10/2016	16/10/2016	AC
168/R	16/10/2016	16/10/2016	AC
169/R	16/10/2016	16/10/2016	AC
170/R	16/10/2016	16/10/2016	AC
171/R	16/10/2016	16/10/2016	AC
172/R	16/10/2016	16/10/2016	AC
173/R	16/10/2016	16/10/2016	AC
174/R	16/10/2016	16/10/2016	AC
175/R	16/10/2016	16/10/2016	AC
176/R	16/10/2016	16/10/2016	AC
177/R	16/10/2016	16/10/2016	AC
178/R	16/10/2016	16/10/2016	AC
179/R	16/10/2016	16/10/2016	AC
180/R	16/10/2016	16/10/2016	AC
181/R	16/10/2016	16/10/2016	AC
182/R	16/10/2016	16/10/2016	AC
183/R	16/10/2016	16/10/2016	AC
184/R	16/10/2016	16/10/2016	AC
185/R	16/10/2016	16/10/2016	AC
186/R	16/10/2016	16/10/2016	AC
187/R	16/10/2016	16/10/2016	AC
188/R	16/10/2016	16/10/2016	AC
189/R	16/10/2016	16/10/2016	AC
190/R	16/10/2016	16/10/2016	AC
191/R	16/10/2016	16/10/2016	AC
192/R	16/10/2016	16/10/2016	AC
193/R	16/10/2016	16/10/2016	AC
194/R	16/10/2016	16/10/2016	AC
195/R	16/10/2016	16/10/2016	AC
196/R	16/10/2016	16/10/2016	AC
197/R	16/10/2016	16/10/2016	AC
198/R	16/10/2016	16/10/2016	AC
199/R	16/10/2016	16/10/2016	AC
200/R	16/10/2016	16/10/2016	AC

STATUS

備註

SCALE

比例

A1 1: 500


DIMENSION UNIT

尺寸單位

METRES

KEY PLAN

索引圖 A1 1: 60000

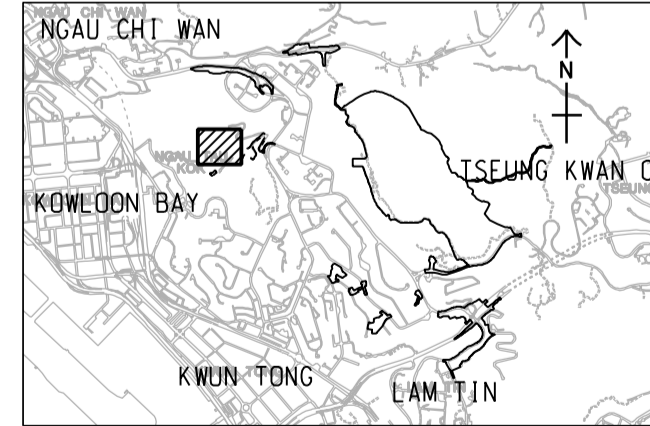

PROJECT NO.

項目編號

60328348

CONTRACT NO.

合約編號

NE/2016/05

SHEET TITLE


圖紙名稱

GREEN ROUTE - PORTION OF SITE

SHEET NUMBER

圖紙編號

60328348/PC1/5007

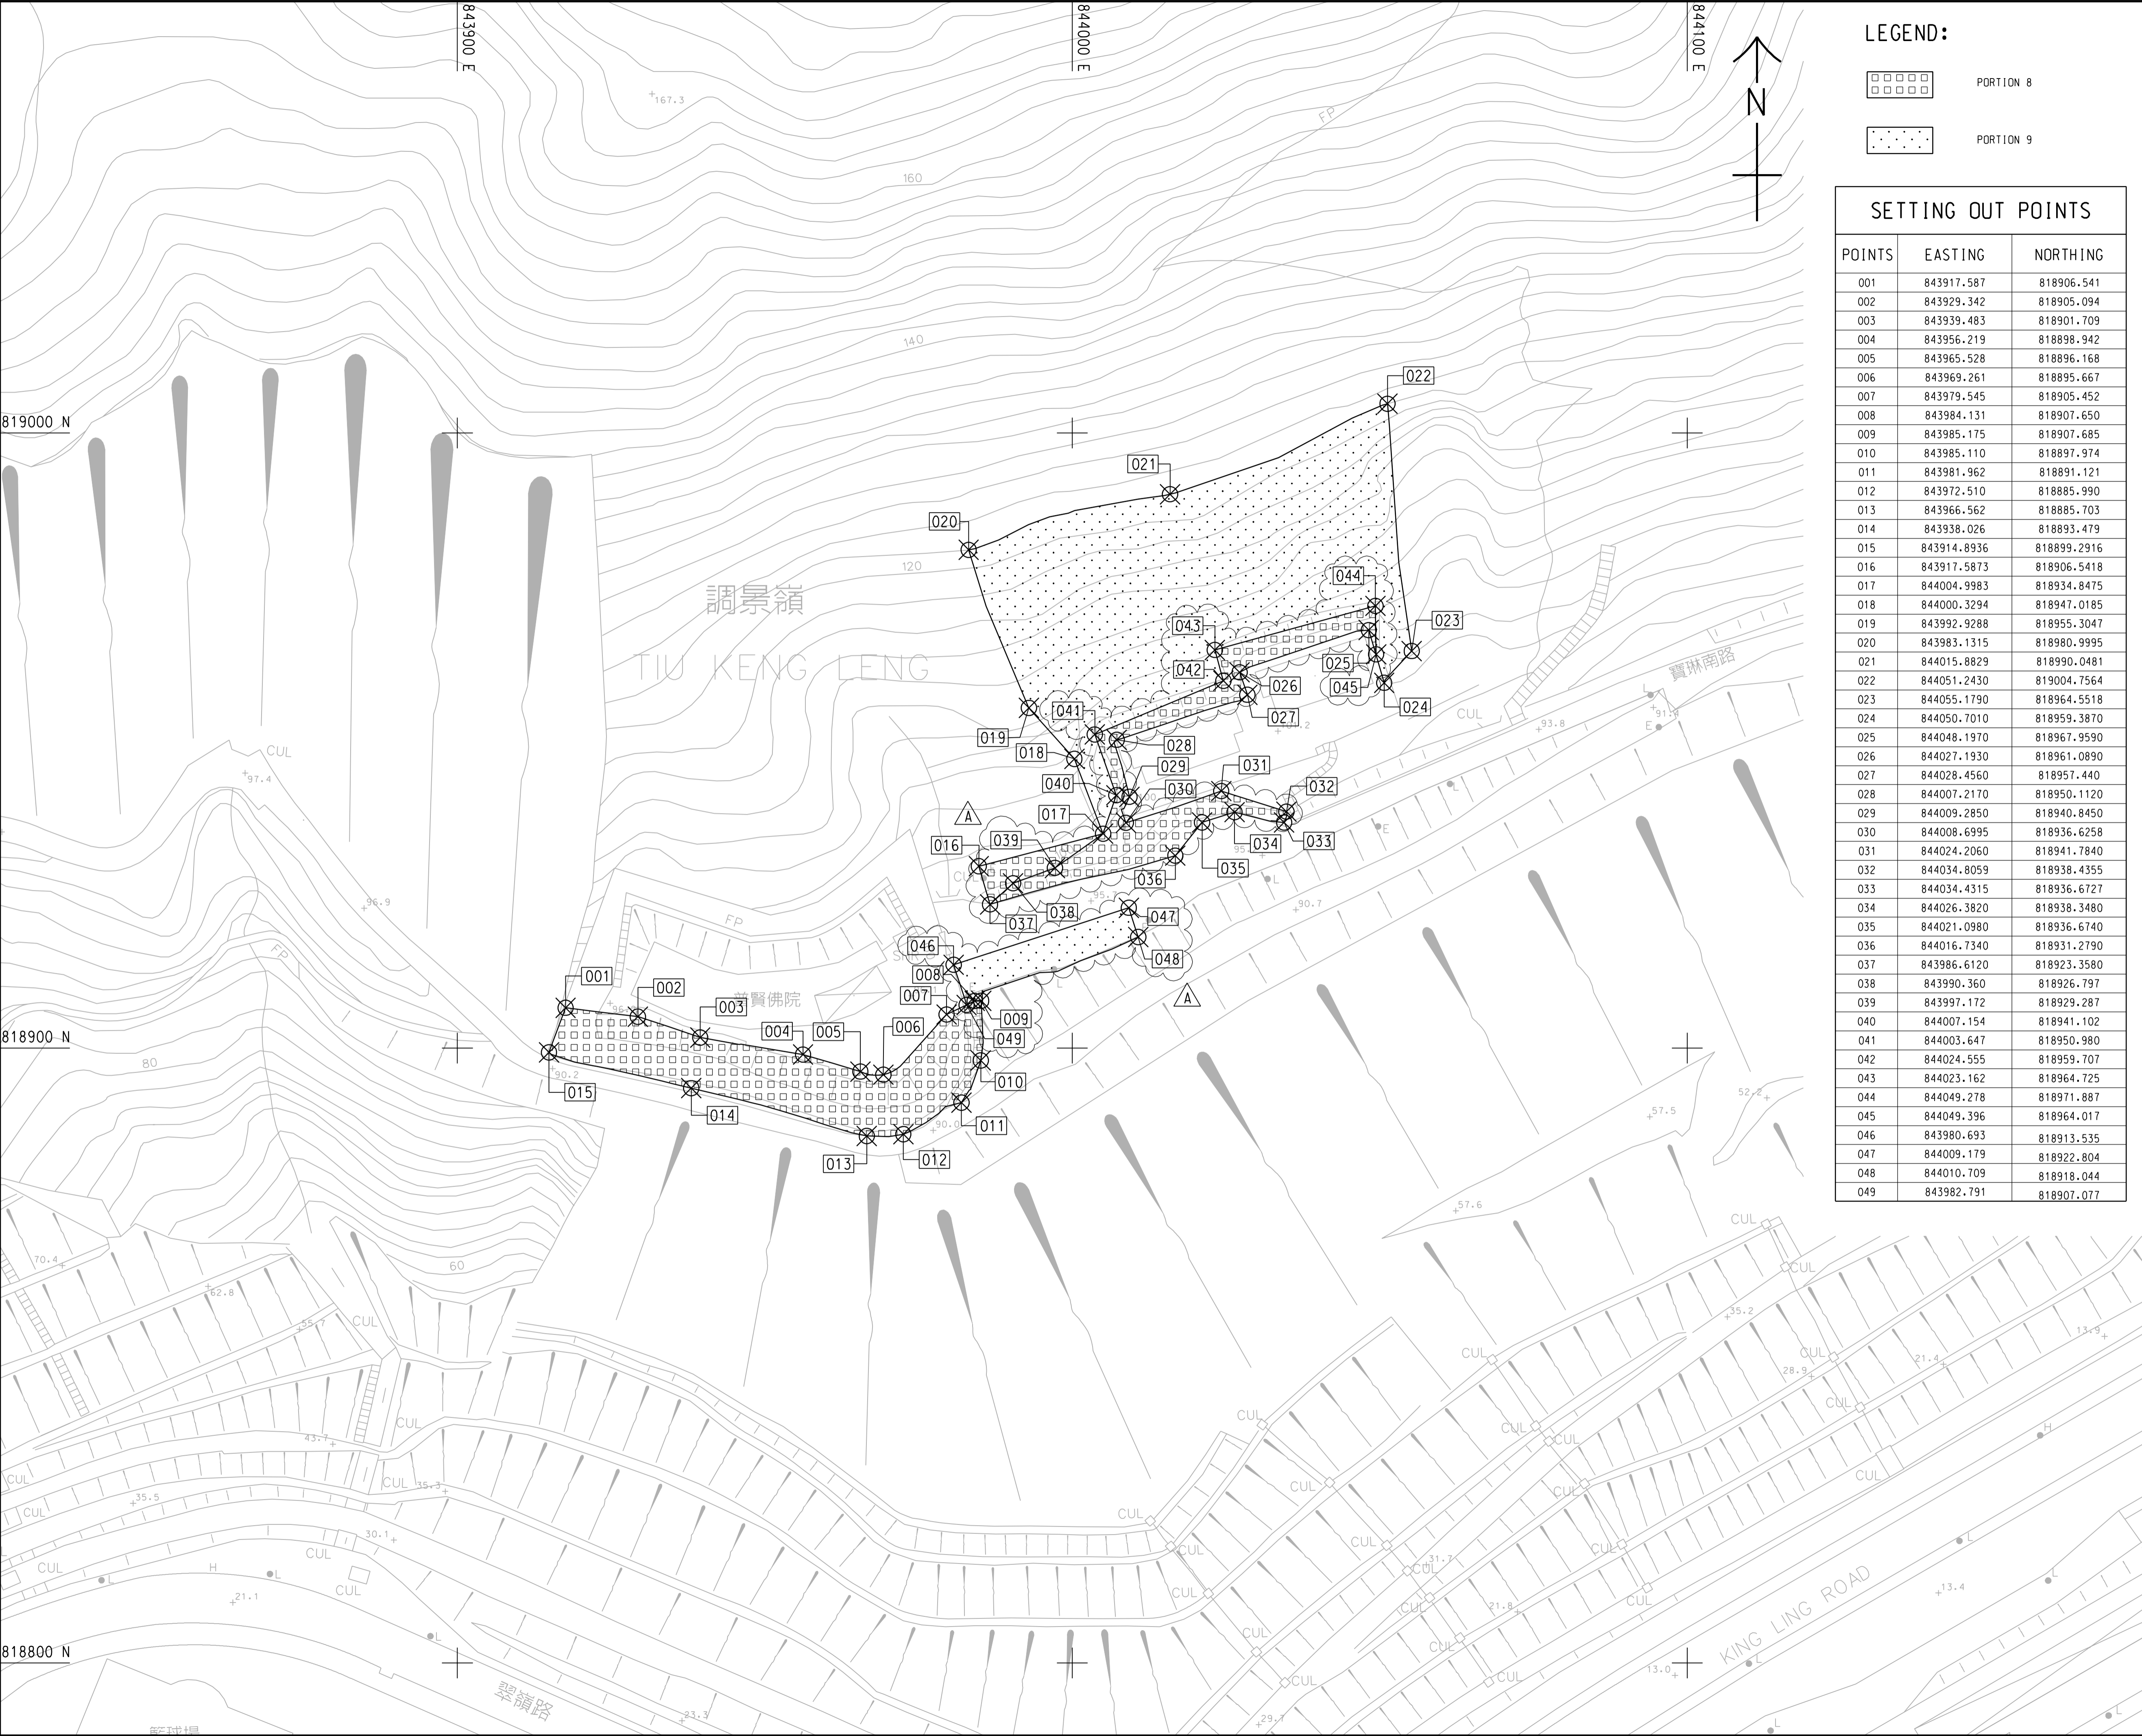

LEGEND:

- PORTION 8
- PORTION 9

SETTING OUT POINTS

POINTS	EASTING	NORTHING
001	843917.587	818906.541
002	843929.342	818905.094
003	843939.483	818901.709
004	843956.219	818898.942
005	843965.528	818896.168
006	843969.261	818895.667
007	843979.545	818905.452
008	843984.131	818907.650
009	843985.175	818907.685
010	843985.110	818897.974
011	843981.962	818891.121
012	843972.510	818885.990
013	843966.562	818885.703
014	843938.026	818893.479
015	843914.8936	818899.2916
016	843917.5873	818906.5418
017	844004.9983	818934.8475
018	844000.3294	818947.0185
019	843992.9288	818955.3047
020	843983.1315	818980.9995
021	844015.8829	818990.0481
022	844051.2430	819004.7564
023	844055.1790	818964.5518
024	844050.7010	818959.3870
025	844048.1970	818967.9590
026	844027.1930	818961.0890
027	844028.4560	818957.440
028	844007.2170	818950.1120
029	844009.2850	818940.8450
030	844008.6995	818936.6258
031	844024.2060	818941.7840
032	844034.8059	818938.4355
033	844034.4315	818936.6727
034	844026.3820	818938.3480
035	844021.0980	818936.6740
036	844016.7340	818931.2790
037	843986.6120	818923.3580
038	843990.360	818926.797
039	843997.172	818929.287
040	844007.154	818941.102
041	844003.647	818950.980
042	844024.555	818959.707
043	844023.162	818964.725
044	844049.278	818971.887
045	844049.396	818964.017
046	843980.693	818913.535
047	844009.179	818922.804
048	844010.709	818918.044
049	843982.791	818907.077

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

DEVELOPMENT OF
ANDERSON ROAD
QUARRY SITE - INVESTIGATION,
DESIGN AND CONSTRUCTION

CONTRACT TITLE
PEDESTRIAN CONNECTIVITY
FACILITIES WORKS PHASE 1

CLIENT

CEDD 土木工程拓展署
Civil Engineering and
Development Department

CONSULTANT

AECOM Asia Company Ltd.
www.aecom.com

SUB-CONSULTANTS

分判工程顧問公司

ISSUE/REVISION

REV	DATE	DESCRIPTION	CHK.
A	NOV. 16	TENDER ADDENDUM NO. 1	AC
-	OCT. 16	TENDER DRAWING	AC
I/R	DATE	DESCRIPTION	CHK.
修訂	日期	內容摘要	校核

STATUS

備版

SCALE

比例

A1 1: 500

DIMENSION UNIT


尺寸單位

METRES

KEY PLAN

索引圖

A1 1: 60000

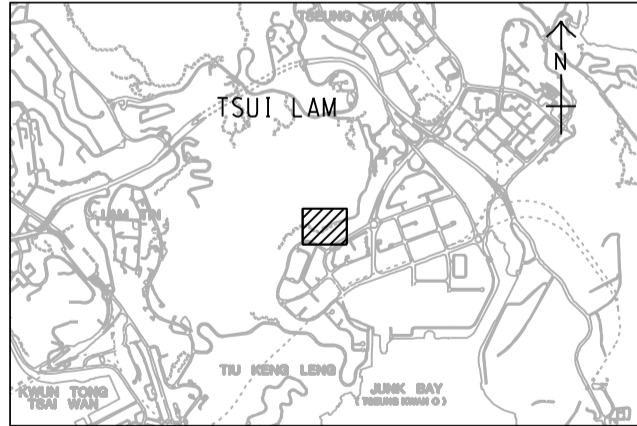

PROJECT NO.

項目編號

60328348

CONTRACT NO.

合約編號

NE/2016/05

SHEET TITLE

圖紙名稱


INFRASTRUCTURAL WORKS AT
PO LAM ROAD SOUTH TIU KENG
LENG – PORTION OF SITE

SHEET NUMBER

圖紙編號

60328348/PC1/9501A

**Layout plan of Contract 3 (NE/2017/03)
(non-designated area)**

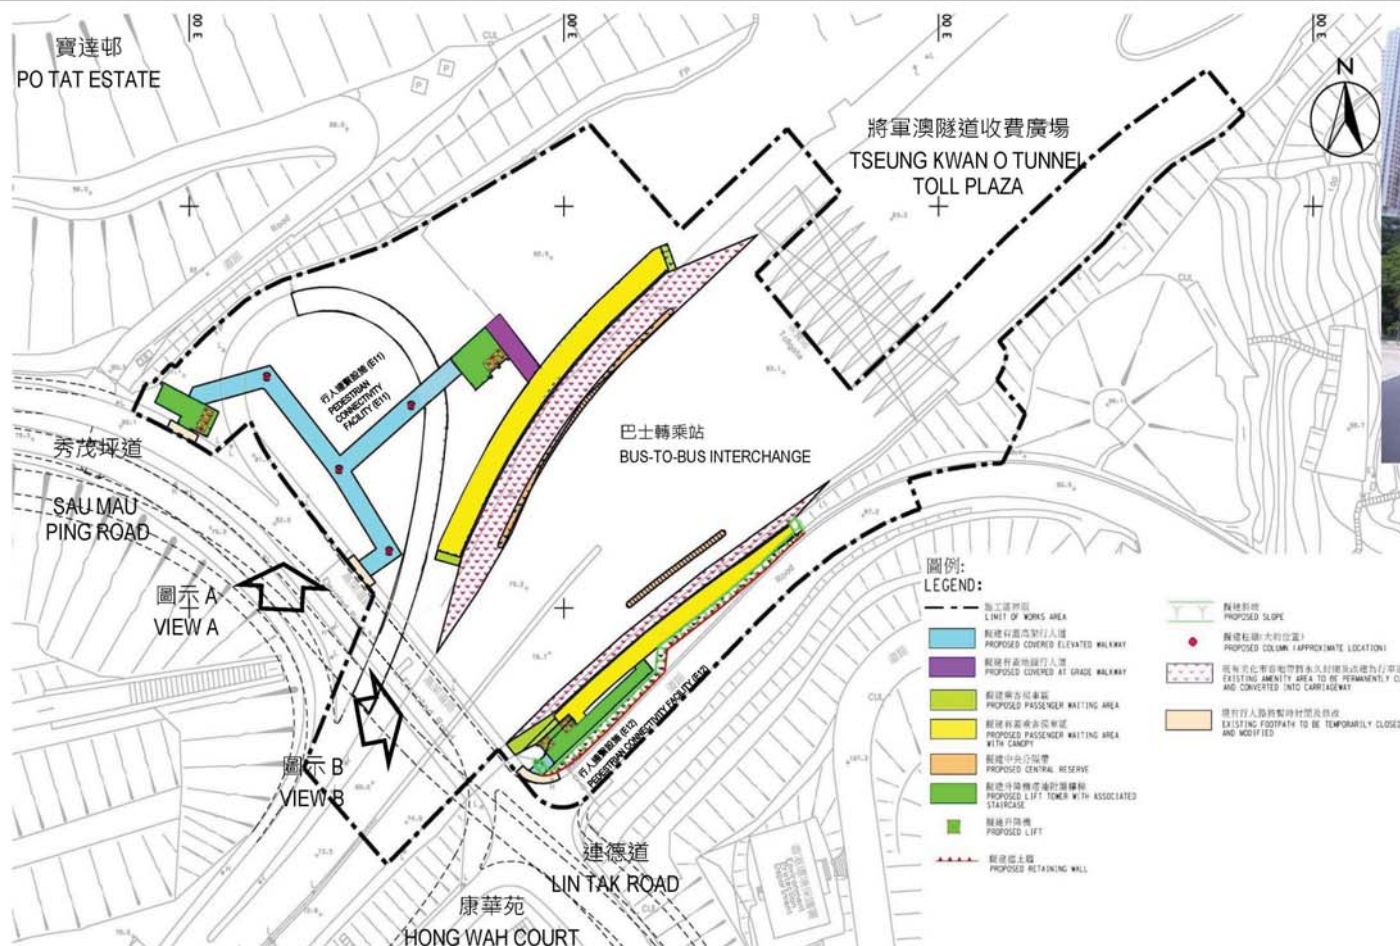

圖示 A

VIEW A



圖示 B

VIEW B

圖則名稱 Drawing Title

行人連繫設施(巴士轉乘站、E11及E12) - 平面圖及構思圖
Pedestrian Connectivity Facilities (Bus-to-Bus Interchange, E11 and E12)
- Layout Plan and Artist's Impression

項目編號 Item No.

765CL

比例 Scale

圖則編號 Drawing No.

附件五 Appendix 5

辦事處 Office



新界東拓展處
NEW TERRITORIES EAST
DEVELOPMENT OFFICE



土木工程拓展署
CIVIL ENGINEERING
AND DEVELOPMENT
DEPARTMENT

Pld File by: WJMT 2017/11/18
PATH P:\Project\60328348\DRAWING\CONTRACT\R&P\1000\R&P_1008.dgn

Project Management Initials: Designer: CCYT Checked: AMVC Approved: HKT ISO A1 594mm x 841mm

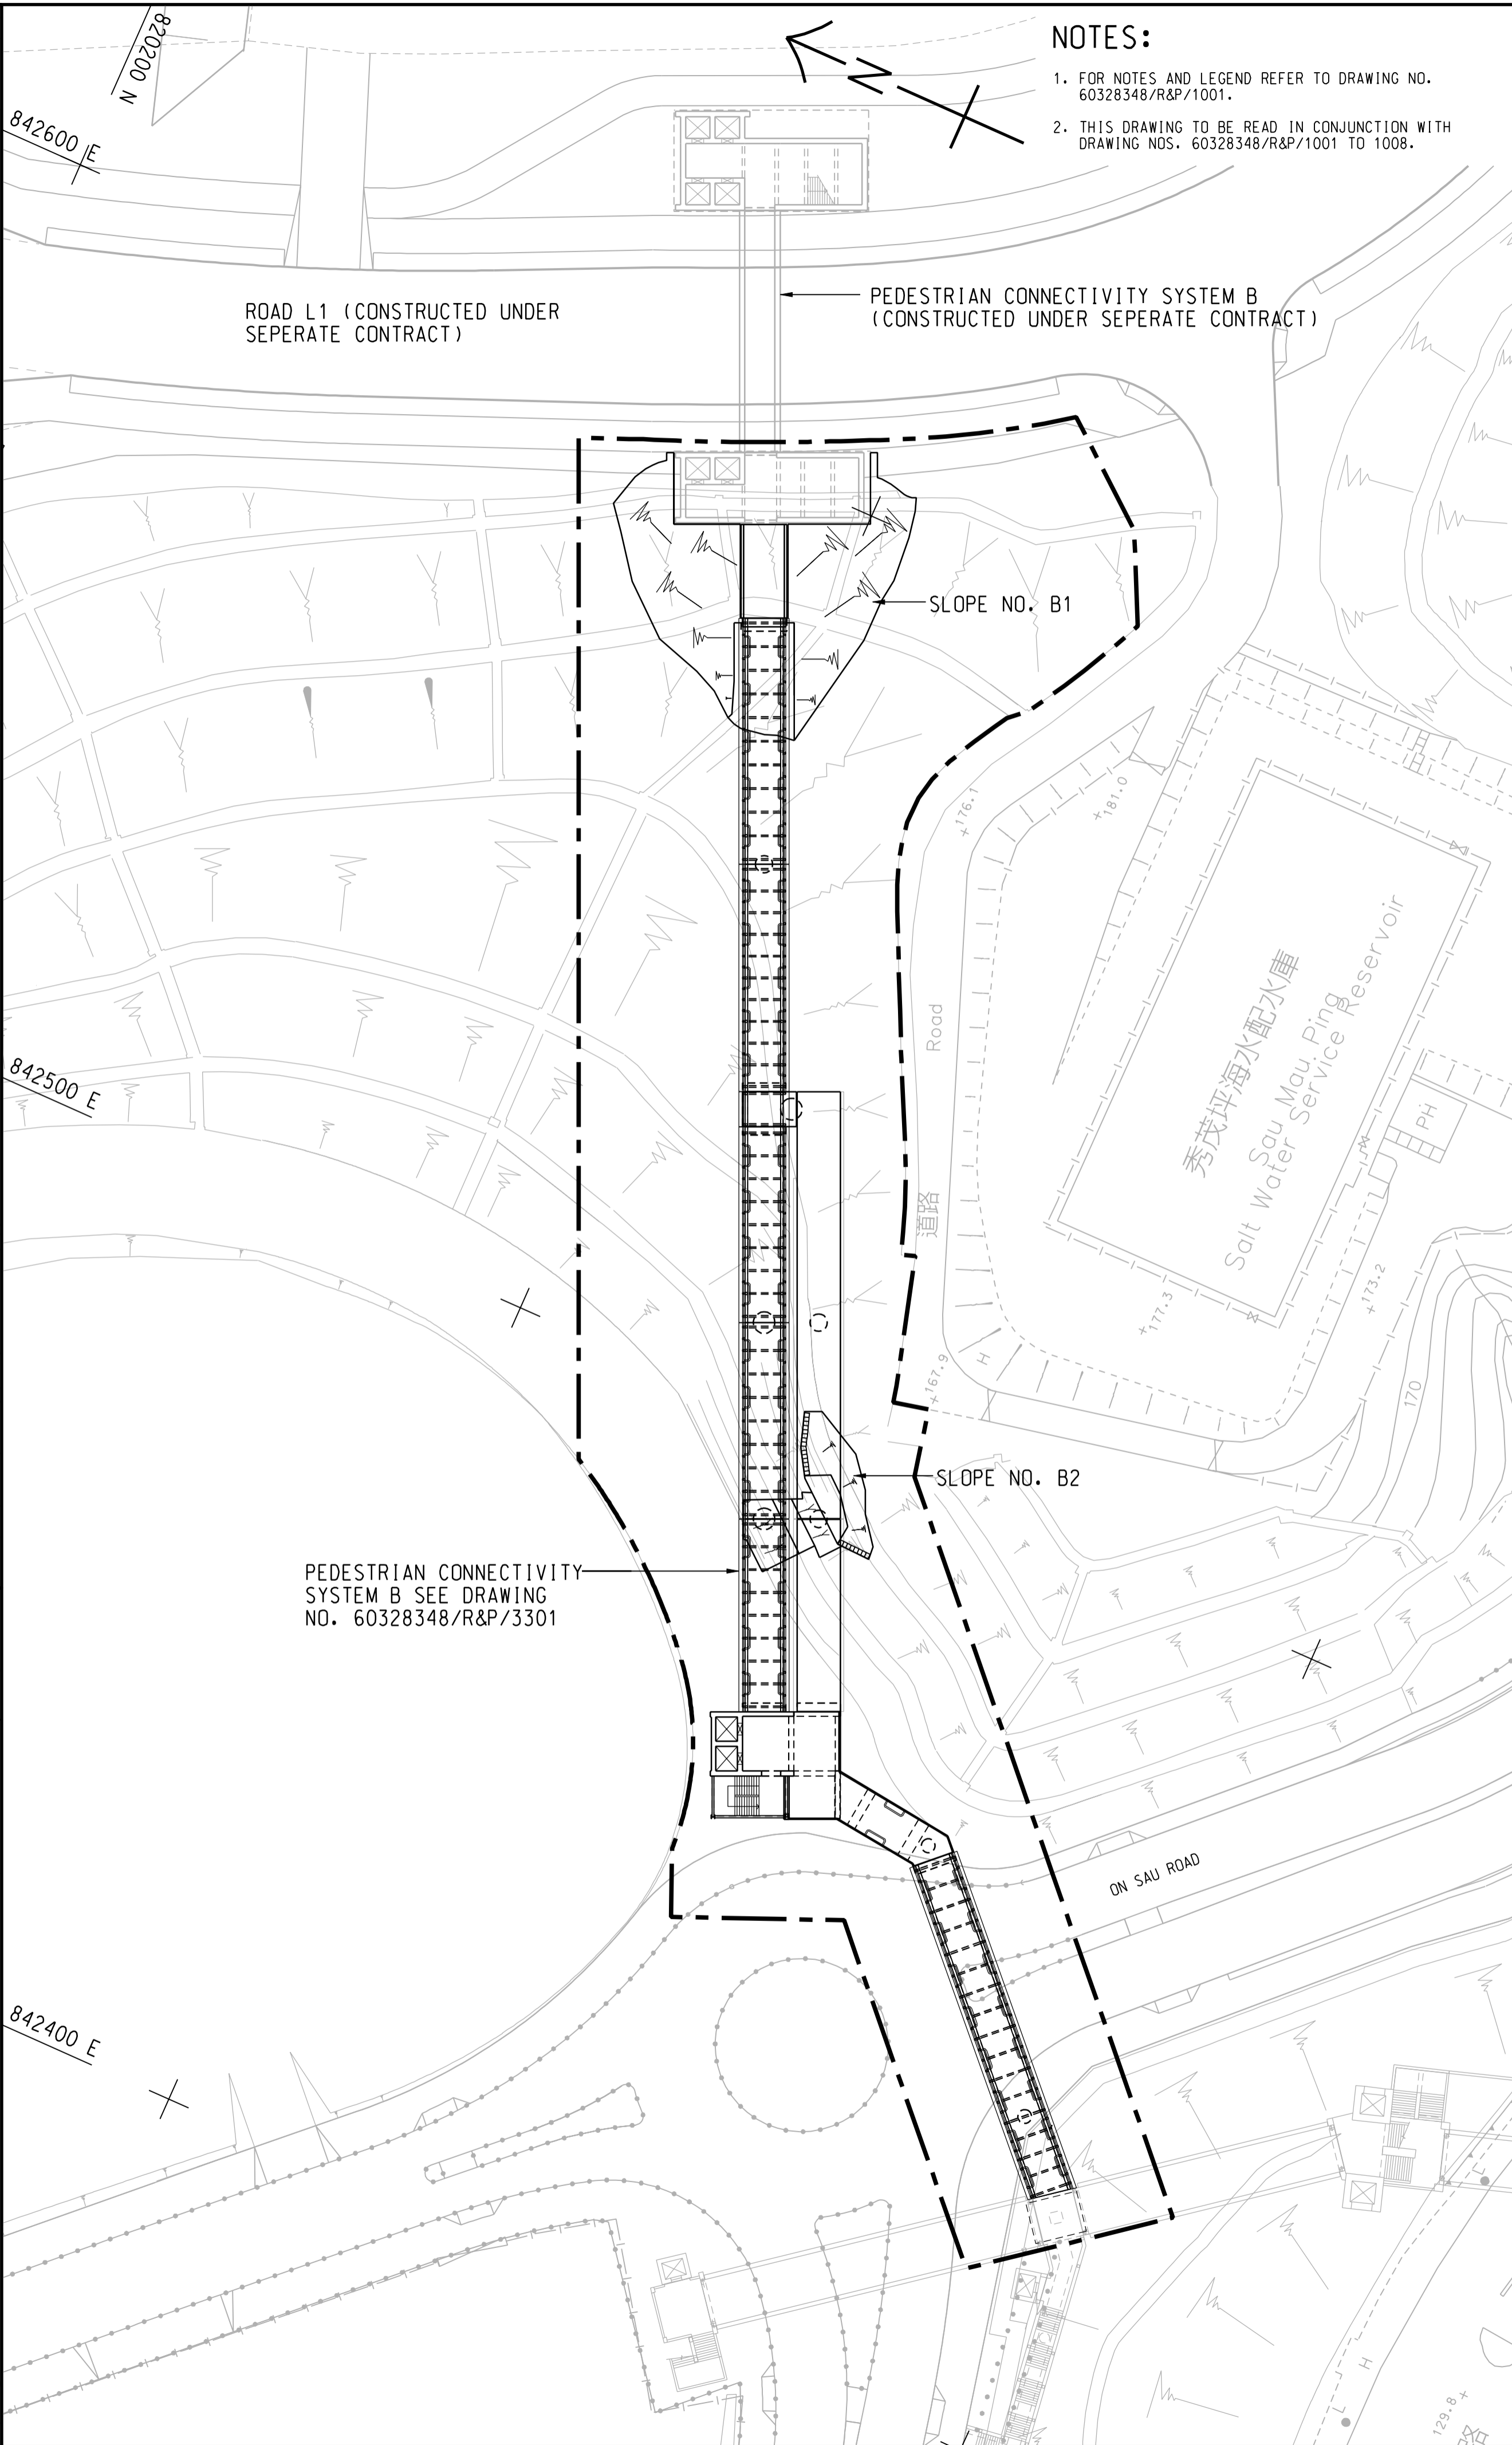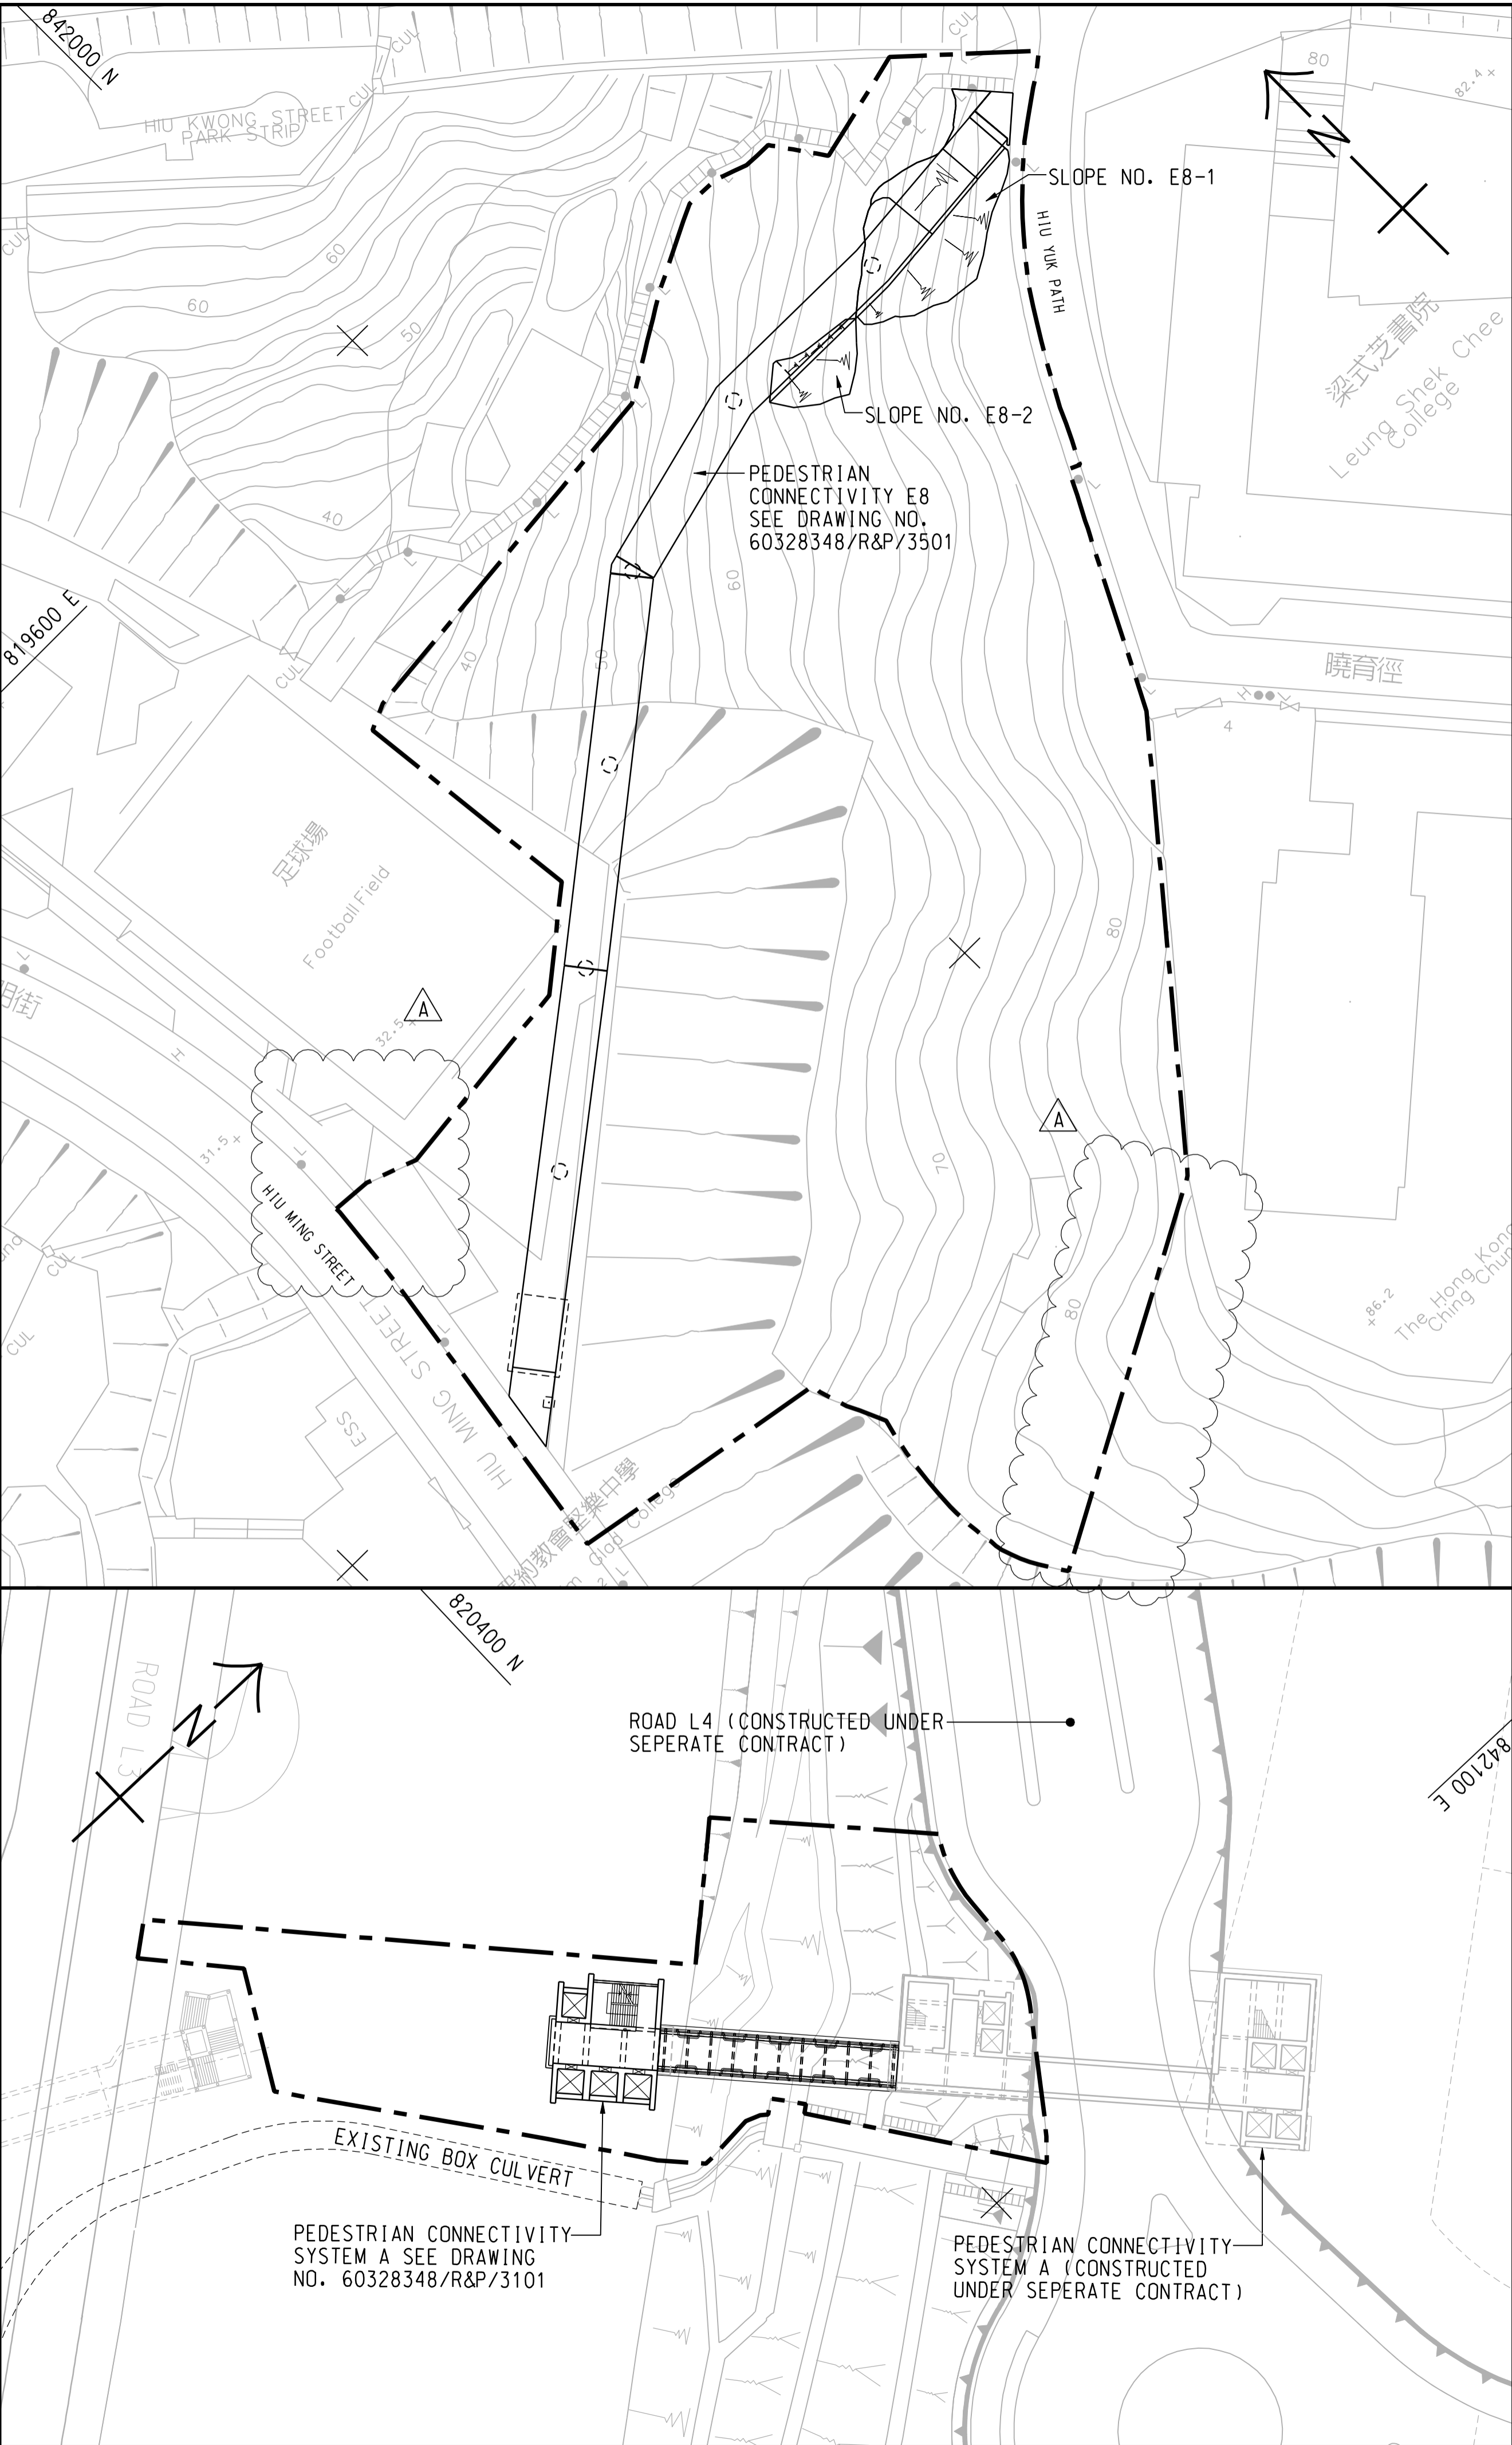

- NOTES:
1. FOR NOTES AND LEGEND REFER TO DRAWING NO. 60328348/R&P/1001.
 2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWING NOS. 60328348/R&P/1001 TO 1008.

AECOM

PROJECT
項目

DEVELOPMENT OF
ANDERSON ROAD
QUARRY SITE - INVESTIGATION,
DESIGN AND CONSTRUCTION

CONTRACT TITLE
DEVELOPMENT OF ANDERSON ROAD
QUARRY SITE - ROAD IMPROVEMENT
WORKS AND PEDESTRIAN CONNECTIVITY
FACILITIES WORKS PHASE 2A

CLIENT
業主

CEDD 土木工程拓展署
Civil Engineering and
Development Department

CONSULTANT
工程顧問公司

AECOM Asia Company Ltd.
www.aecom.com

SUB-CONSULTANTS
分判工程顧問公司

ISSUE/REVISION 修訂				
A	NOV. 17	TENDER ADDENDUM NO. 1	AWYC	Y/C
-	OCT. 17	TENDER DRAWING	AWYC	AWYC
I/R 修訂	DATE 日期	DESCRIPTION 內容摘要	CHK. 校核	

STATUS
階段


SCALE
比例

DIMENSION UNIT
尺寸單位

A1 1 : 500 METRES

KEY PLAN
索引圖

A1 1 : 60000

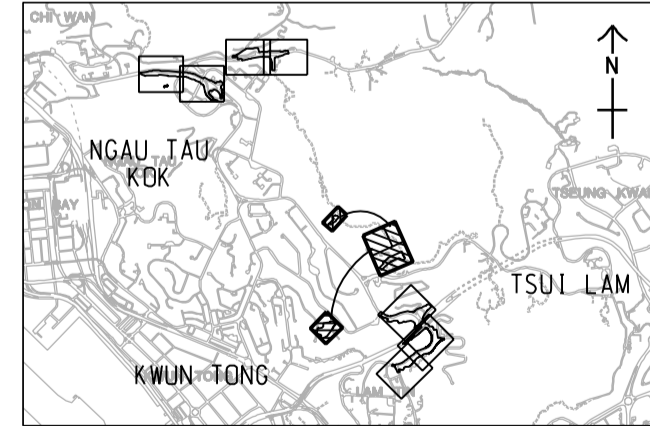

PROJECT NO.
項目編號

CONTRACT NO.
合約編號

60328348 NE/2017/03

SHEET TITLE
圖紙名稱

GENERAL LAYOUT


SHEET NUMBER
圖紙編號

60328348/R&P/1008A

Appendix B

Organization Chart

Project Organization Structure for Contract 1 – NE/2016/01

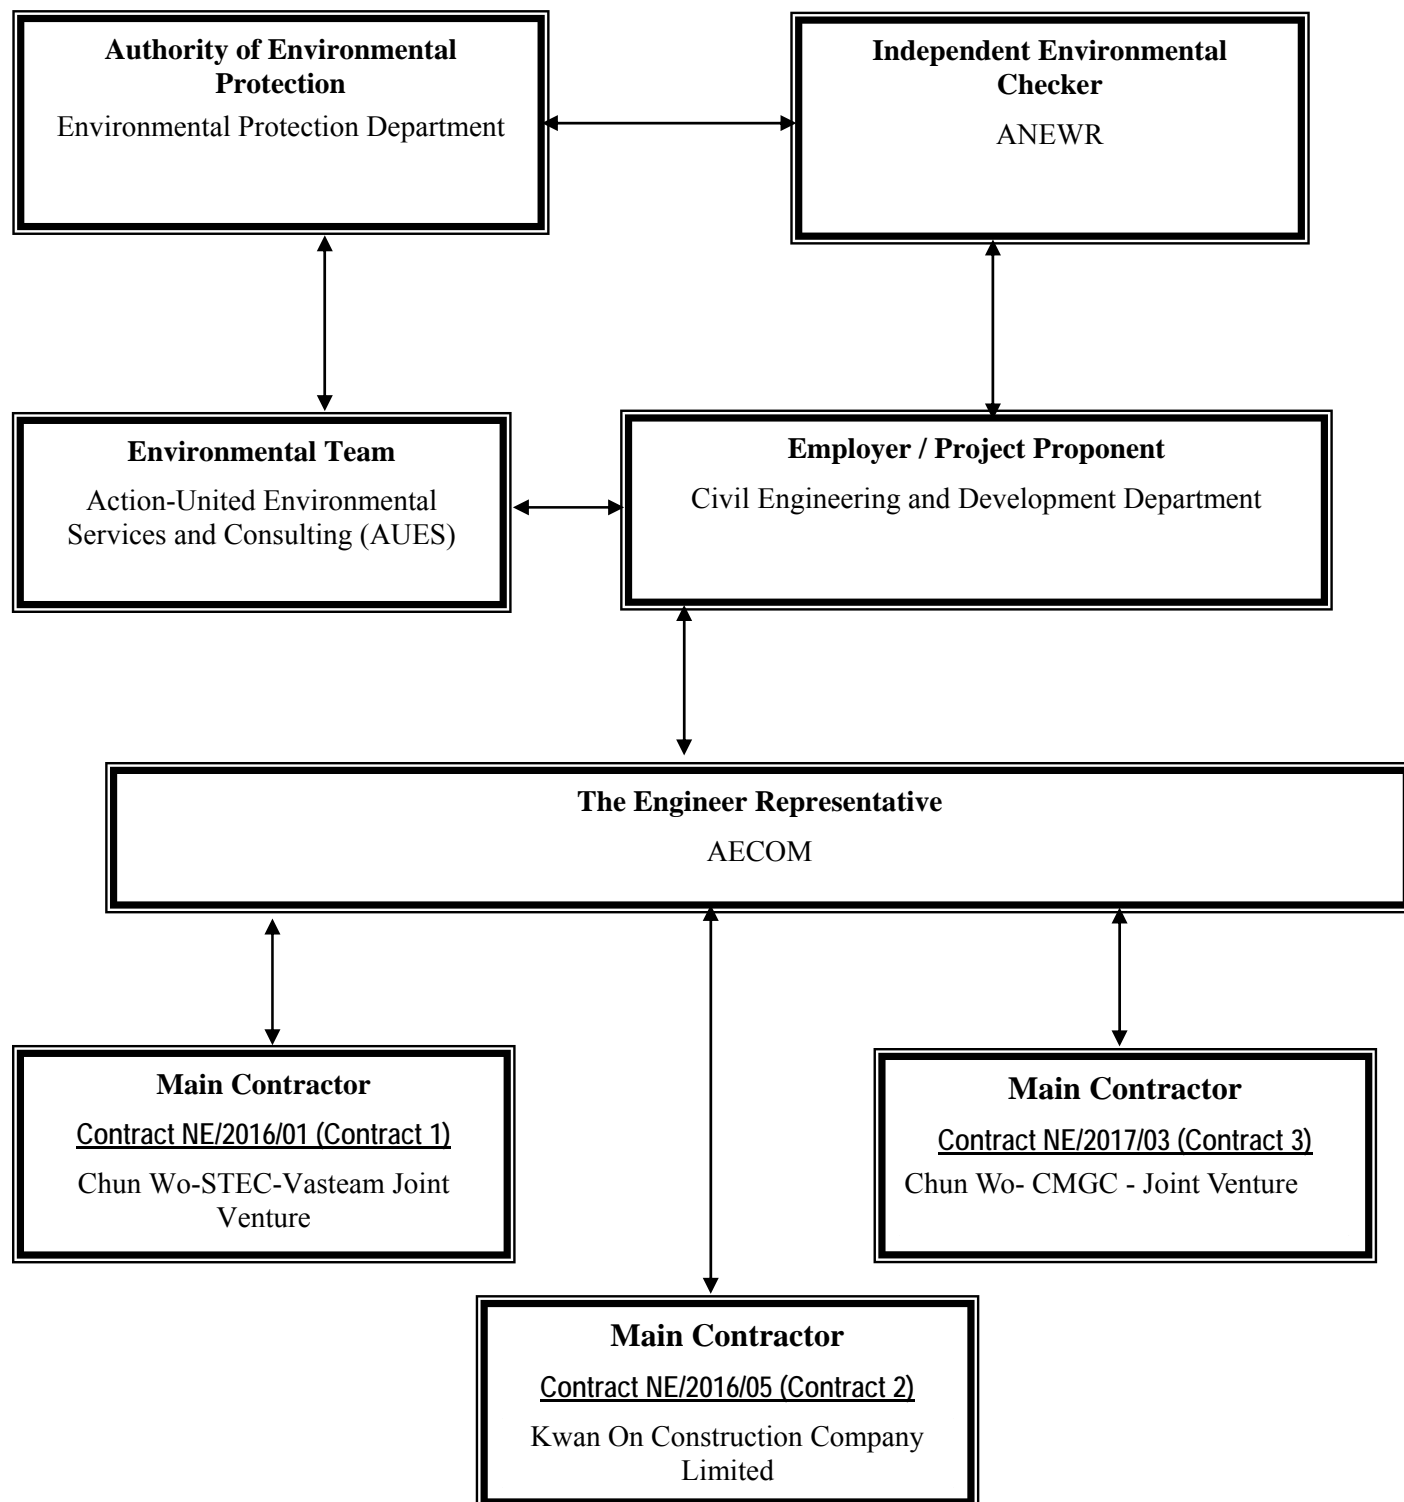

Contact Details of Key Personnel for Contract 1 – NE/2016/01

Organization	Project Role	Name of Key Staff	Tel No.	Fax No.
CEDD	Engineer	Leung Siu Kau, Kelvin	2301 1383	2739 0076
AECOM	Chief Resident Engineer	TBA	TBA	TBA
AECOM	Senior Resident Engineer	Simon Leung	2967 6608	2473 3221
ANWR	Independent Environmental Checker	Adi Lee	2618 2836	3007 8648
CSVJV	Project Manager	William Leung	2638 7181	2744 6937
CSVJV	Site Agent	TY Leung	2638 7181	2744 6937
CSVJV	Project Environmental Manager	Shelton Chan	2638 7181	2744 6937
CSVJV	Environmental Officer	TBA	TBA	TBA
AUES	Environmental Team Leader	T. W. Tam	2959 6059	2959 6079
AUES	Environmental Consultant	Nicola Hon	2959 6059	2959 6079
AUES	Environmental Consultant	Ben Tam	2959 6059	2959 6079

Legend:*CEDD (Employer) – Civil Engineering and Development Department**AECOM (Engineer) – AECOM Asia Co. Ltd.**CSVJV (Main Contractor) – Chun Wo-STECC-Vasteam Joint Venture**ANWR (IEC) – ANewR Consulting Limited**AUES (ET) – Action-United Environmental Services & Consulting*

Contact Details of Key Personnel for Contract 2 – NE/2016/05

Organization	Project Role	Name of Key Staff	Tel No.	Fax No.
CEDD	Engineer	Leung Siu Kau, Kelvin	2301 1383	2739 0076
AECOM	Chief Resident Engineer	TBA	TBA	TBA
AECOM	Senior Resident Engineer	Vincent Yuen	5599 1466	2473 3221
ANWR	Independent Environmental Checker	Adi Lee	2618 2836	3007 8648
KOCCL	Project Director	Ambrose Kwong	2889 2675	2558 6900
KOCCL	Site Agent	Yung, Shui Heng	6012 4284	2558 6900
KOCCL	Safety and Environmental Manager	Joly C K Kwong	6111 5711	2558 6900
KOCCL	Environmental Officer	Lee Kwan Ho, Byron	6671 0383	2558 6900
AUES	Environmental Team Leader	T. W. Tam	2959 6059	2959 6079
AUES	Environmental Consultant	Nicola Hon	2959 6059	2959 6079
AUES	Environmental Consultant	Ben Tam	2959 6059	2959 6079

Legend:*CEDD (Employer) – Civil Engineering and Development Department**AECOM (Engineer) – AECOM Asia Co. Ltd.**KOCCL (Main Contractor) –Kwan On Construction Company Limited**ANWR (IEC) –ANewR Consulting Limited**AUES (ET) – Action-United Environmental Services & Consulting*

Contact Details of Key Personnel for Contract 3 –NE/2017/03

Organization	Project Role	Name of Key Staff	Tel No.	Fax No.
CEDD	Engineer	Leung Siu Kau, Kelvin	2301 1383	2739 0076
AECOM	Chief Resident Engineer	TBA	TBA	TBA
AECOM	Senior Resident Engineer	Brad Chan	5506 0068	2473 3221
ANWR	Independent Environmental Checker	Adi Lee	2618 2836	3007 8648
CW – CMGC - JV	Construction Manager	William Leung	9464 1392	3965 9900
CW – CMGC - JV	Site Agent	Chris Lam	9801 9974	3965 9900
CW – CMGC - JV	Environmental Officer	Tiffany Tang	5117 9020	3965 9900
CW – CMGC - JV	Environmental Supervisor	Belle Mak	6094 1580	3965 9900
AUES	Environmental Team Leader	T. W. Tam	2959 6059	2959 6079
AUES	Environmental Consultant	Nicola Hon	2959 6059	2959 6079
AUES	Environmental Consultant	Ben Tam	2959 6059	2959 6079

Legend:*CEDD (Employer) – Civil Engineering and Development Department**AECOM (Engineer) – AECOM Asia Co. Ltd.**CW – CMGC - JV (Main Contractor) – Chun Wo- CMGC - Joint Venture**ANWR (IEC) –ANewR Consulting Limited**AUES (ET) – Action-United Environmental Services & Consulting*

Appendix C

Construction Programme

- (a) Contract 1 (NE/2016/01)**
- (b) Contract 2 (NE/2016/05)**
- (c) Contract 3 (NE/2017/03)**

Contract 1 (NE/2016/01)

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

<div><div><div><div></div><div>TEC</div></div><div>隧道股份</div></div><div>俊和 - 上隧 - 浩隆 聯營</div><div>CHUN WO - STEC - VASTEAM JOINT VENTURE</div></div>				<div>CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE</div> <div>INVESTIGATION, DESIGN AND CONSTRUCTION</div> <div>3 - MONTH ROLLING PROGRAMME</div>												<div>Page 5 of 24</div> <div>Cut-Off Data Date: 15-Mar-19</div>												
Activity ID	Activity Name	BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	2019				March 2019				April 2019				May 2019				June 2019			
									17	24	03	10	17	24	31	07	14	21	28	05	12	19	26	02	09	16		
A2280	Submission and Approval for Design of Earthing and Lightning Protection System at Underpass	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2340	Submission and Approval for Material of ATS Panel at Underpass	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2350	Submission and Approval for Material of LV Switchboard at Underpass	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2360	Submission and Approval for Material of Lighting System at Underpass	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2370	Submission and Approval for Material of Luminaire at Underpass	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Road Lighting																												
A2250	Submission and Approval for Design of Road Lighting System at Underpass	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Civil Requirement																												
A3398	Submission and Approval for Drawing (Civil Requirement) of Underpass	0			14	23-Apr-19 08:00*	09-May-19 18:00	%																				
Artificial Flood Attenuation Lake																												
Civil Requirement																												
A3399	Submission and Approval for Drawing (Civil Requirement) of Artificial Flood Attenuation Lake	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Underground Stormwater Retention Tank																												
MVAC																												
A2460	Submission and Approval for Design of MVAC at USRT-R0	0			186	04-Aug-18 08:00 A	19-Mar-19 18:00	%																				
A2470	Submission and Approval for Material of MVAC at USRT-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Fire Services																												
A2600	Submission and Approval for Design of FSS at USRT-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2610	Submission and Approval for Material of FSS at USRT-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Electrical																												
A2490	Submission and Approval for Design of Electrical Works at USRT-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2510	Submission and Approval for Design of Motor Control Centre at USRT-R0	0			180	13-Aug-18 08:00 A	20-Mar-19 18:00	%																				
A2550	Submission and Approval for Design of Small Power and ELV at USRT-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2560	Submission and Approval for Material of Motor Control Centre at USRT-R0	0			184	03-Aug-18 08:00 A	15-Mar-19 18:00	%																				
A2590	Submission and Approval for Material of Photovoltaic System at USRT-R0	0			184	03-Aug-18 08:00 A	15-Mar-19 18:00	%																				
A2595	Submission and Approval for Material of Capacitor and Capacitor Panel at USRT-R0	0			184	08-Aug-18 08:00 A	20-Mar-19 18:00	%																				
Pedestrian Connectivity System A																												
MVAC																												
A2640	Submission and Approval for Material of MVAC at SYS-A-R0	0			180	10-Aug-18 08:00 A	18-Mar-19 18:00	%																				
Fire Services																												
A2680	Submission and Approval for Design of FSS at SYS-A-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Building Services - Plumbing and Drainage																												
A3401	Submission and Approval for Design of Lift Sump Pit (Submersible) at SYS-A-R0	0			159	06-Sep-18 08:00 A	20-Mar-19 18:00	%																				
A3402	Submission and Approval for Material of Lift Sump Pit (Submersible) at SYS-A-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
<div><div><div></div>Primary Baseline</div><div><div></div>Forecast Work</div><div><div></div>Actual Work</div><div><div></div>Baseline Milestone</div><div><div></div>Milestone</div></div>									<div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div>									<div>Date</div>	<div>Revision</div>	<div>Checked</div>	<div>Approved</div>							

<div><div><div><div></div><div>TEC</div><div>隧道股份</div></div><div>俊和 - 上隧 - 浩隆 聯營</div><div>CHUN Wo - STEC - VASTEAM JOINT VENTURE</div></div></div>			CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE INVESTIGATION, DESIGN AND CONSTRUCTION 3 - MONTH ROLLING PROGRAMME										Page 6 of 24 Cut-Off Data Date: 15-Mar-19															
Activity ID	Activity Name	BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	y 2019				March 2019				April 2019				May 2019				June 2019			
									17	24	03	10	17	24	31	07	14	21	28	05	12	19	26	02	09	16		
Electrical																												
A2650	Submission and Approval for Design of Power Supply System at SYS-A-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2660	Submission and Approval for Design of Electrical Works at SYS-A-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2670	Submission and Approval for Design of Earthing and Lightning Protection System at SYS-A-R0	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Civil Requirement																												
A3403	Submission and Approval for Drawing (Civil Requirement) of SYS-A	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Pedestrian Connectivity System B																												
MVAC																												
A2910	Submission and Approval for Design of MVAC at SYS-B	0			199	21-Jul-18 08:00 A	20-Mar-19 18:00	%																				
A2920	Submission and Approval for Material of MVAC at SYS-B	0			202	16-Jul-18 08:00 A	18-Mar-19 18:00	%																				
Fire Services																												
A2960	Submission and Approval for Design of FSS at SYS-B	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Building Services - Plumbing and Drainage																												
A3404	Submission and Approval for Design of Lift Sump Pit (Submersible) at SYS-B	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A3405	Submission and Approval for Material of Lift Sump Pit (Submersible) at SYS-B	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Electrical																												
A2930	Submission and Approval for Design of Power Supply System at SYS-B	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2940	Submission and Approval for Design of Electrical Works at SYS-B	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Civil Requirement																												
A3406	Submission and Approval for Drawing (Civil Requirement) of SYS-B	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Common for All Areas																												
MVAC																												
A2970	Submission and Approval for Material of MVAC Thermal Insulation at Common Areas	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A2980	Submission and Approval for Material of MVAC LMCP at Common Areas	0			184	10-Aug-18 08:00 A	22-Mar-19 18:00	%																				
Fire Services																												
A3070	Submission and Approval for Material of Manual Fire Alarm System at Common Areas	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A3080	Submission and Approval for Material of Manual Fire Alarm Control at Common Areas	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A3090	Submission and Approval for Material of Battery and Charger at Common Areas	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Plumbing and Drainage Services																												
A3120	Submission and Approval for Material of Tanks,Pipes,Valves and Fittings for Fresh Water and Cleaning Water Supply System	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A3130	Submission and Approval for Material of Tanks,Pipes,Valves and Fittings for Flushing Water Supply System	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A3140	Submission and Approval for Material of Pipes,Valves and Fittings for Drainage System	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
A3150	Submission and Approval for Material of LMCP for Drainage Pump System	0			14	15-Mar-19 08:00*	30-Mar-19 18:00	%																				
Electrical																												

Primary Baseline

Forecast Work

Actual Work

Baseline Milestone

Milestone

3 Month Rolling Programme

ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)

16-Mar-19

Date	Revision	Checked	Approved

<div><div><div></div><div>Primary Baseline</div></div><div><div></div><div>Forecast Work</div></div></div> <div><div></div><div>Actual Work</div></div> <div><div><div></div><div>Baseline Milestone</div></div><div><div></div><div>Milestone</div></div></div>	<div><h3>3 Month Rolling Programme</h3><p>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</p><p>16-Mar-19</p></div>	<table><tr><th>Date</th><th>Revision</th><th>Checked</th><th>Approved</th></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr></table>	Date	Revision	Checked	Approved												
Date	Revision	Checked	Approved															



**CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE
INVESTIGATION, DESIGN AND CONSTRUCTION
3 - MONTH ROLLING PROGRAMME**


Page 8 of 24
Cut-Off Data Date: 15-Mar-19

Activity ID	Activity Name	BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	March 2019					April 2019					May 2019					June 2019			
									17	24	03	10	17	24	31	07	14	21	28	05	12	19	26	02	09	16	
ACU2050A025	D1 - Stage 5 - Removal of 4th Row Concrete Block at +168.5mPD to +167mPD (At East Portal Entrance)	0			1	02-Apr-19 08:00	02-Apr-19 18:00	%																			
ACU2050A026	D1 - Stage 5 - Excavation from +167mPD to +165.5mPD (At East Portal Entrance)	0			3	03-Apr-19 08:00	05-Apr-19 18:00	%																			
ACU2050A027	D1 - Stage 5 - Removal of 3rd Row Concrete Block at +167mPD to +165.5mPD (At East Portal Entrance)	0			1	06-Apr-19 08:00	06-Apr-19 18:00	%																			
ACU2050A028	D1 - Stage 5 - Excavation from +165.5mPD to +164mPD (At East Portal Entrance)	0			3	07-Apr-19 08:00	09-Apr-19 18:00	%																			
ACU2050A029	D1 - Stage 5 - Removal of 2nd Row Concrete Block at +165.5mPD to +164mPD (At East Portal Entrance)	0			1	10-Apr-19 08:00	10-Apr-19 18:00	%																			
ACU2050A030	D1 - Stage 5 - Excavation from +164mPD to +162.5mPD (At East Portal Entrance)	0			3	11-Apr-19 08:00	13-Apr-19 18:00	%																			
ACU2050A031	D1 - Stage 5 - Removal of Bottom Row Concrete Block at +164mPD to +162.5mPD (At East Portal Entrance)	0			1	14-Apr-19 08:00	14-Apr-19 18:00	%																			
Underpass Tunnel																											
Tunnel Construction																											
Tunnel Construction from West Portal																											
CH2460 to CH2499 (Support Type C: 39m) 1m/ cycle for Top Head																											
ACU3010C290	C - (CH2469 to CH2470) - Shotcrete and Mesh Installation	0			2	15-Feb-19 08:00 A	16-Feb-19 18:00 A	%																			
ACU3010C300	C - (CH2469 to CH2470) - Lattice Girder Installation, Shotcrete & Invert Beam	0			3	17-Feb-19 08:00 A	19-Feb-19 18:00 A	%																			
ACU3010C310	C - (CH2470 to CH2471) - Top Head Excavation	0			2	20-Feb-19 08:00 A	21-Feb-19 18:00 A	%																			
ACU3010C320	C - (CH2470 to CH2471) - Shotcrete and Mesh Installation	0			2	22-Feb-19 08:00 A	23-Feb-19 18:00 A	%																			
ACU3010C330	C - (CH2470 to CH2471) - Lattice Girder Installation, Shotcrete & Invert Beam	0			2	24-Feb-19 08:00 A	25-Feb-19 18:00 A	%																			
ACU3010C340	C - (CH2471 to CH2472) - Top Head Excavation	0			1	27-Feb-19 18:00 A	28-Feb-19 18:00 A	%																			
ACU3010C350	C - (CH2471 to CH2472) - Shotcrete and Mesh Installation	0			2	01-Mar-19 08:00 A	02-Mar-19 18:00 A	%																			
ACU3010C360	C - (CH2471 to CH2472) - Lattice Girder Installation, Shotcrete & Invert Beam	0			2	03-Mar-19 08:00 A	04-Mar-19 18:00 A	%																			
ACU3010C370	C - (CH2472 to CH2473) - Top Head Excavation	0			2	06-Mar-19 08:00 A	07-Mar-19 18:00 A	%																			
ACU3010C380	C - (CH2472 to CH2473) - Shotcrete and Mesh Installation	0			1	08-Mar-19 08:00 A	08-Mar-19 18:00 A	%																			
ACU3010C390	C - (CH2472 to CH2473) - Lattice Girder Installation, Shotcrete & Invert Beam	0			3	09-Mar-19 08:00 A	11-Mar-19 18:00 A	%																			
ACU3010C400	C - (CH2473 to CH2474) - Top Head Excavation	0			1	12-Mar-19 08:00 A	12-Mar-19 18:00 A	%																			
ACU3010C410	C - (CH2473 to CH2474) - Shotcrete and Mesh Installation	0			1	13-Mar-19 08:00 A	13-Mar-19 18:00 A	%																			
ACU3010C420	C - (CH2473 to CH2474) - Lattice Girder Installation, Shotcrete & Invert Beam	0			2	14-Mar-19 08:00 A	15-Mar-19 18:00 A	%																			
ACU3010C430	C - (CH2474 to CH2475) - Top Head Excavation	0			1	15-Mar-19 08:00	15-Mar-19 18:00	%																			
ACU3010C440	C - (CH2474 to CH2475) - Shotcrete and Mesh Installation	0			1	16-Mar-19 08:00	16-Mar-19 18:00	%																			
ACU3010C450	C - (CH2474 to CH2475) - Lattice Girder Installation, Shotcrete & Invert Beam	0			2	17-Mar-19 08:00	18-Mar-19 18:00	%																			
ACU3010C460	C - (CH2475 to CH2476) - Top Head Excavation	0			1	19-Mar-19 08:00	19-Mar-19 18:00	%																			
ACU3010C470	C - (CH2475 to CH2476) - Shotcrete and Mesh Installation	0			1	20-Mar-19 08:00	20-Mar-19 18:00	%																			
ACU3010C480	C - (CH2475 to CH2476) - Lattice Girder Installation, Shotcrete & Invert Beam	0			2	21-Mar-19 08:00	22-Mar-19 18:00	%																			
ACU3010C490	C - (CH2476 to CH2477) - Top Head Excavation	0			1	23-Mar-19 08:00	23-Mar-19 18:00	%																			
ACU3010C500	C - (CH2476 to CH2477) - Shotcrete and Mesh Installation	0			1	24-Mar-19 08:00	24-Mar-19 18:00	%																			
ACU3010C510	C - (CH2476 to CH2477) - Lattice Girder Installation, Shotcrete & Invert Beam	0			2	25-Mar-19 08:00	26-Mar-19 18:00	%																			

<div> <div>Primary Baseline</div> <div>Forecast Work</div> <div>Actual Work</div> <div>Baseline Milestone</div> <div>Milestone</div> </div>	<div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div>	Date	Revision	Checked	Approved

<div><div><div><div></div><div>TEC</div><div>隧道股份</div></div><div>俊和 - 上隧 - 浩隆 联营</div><div>CHUN Wo - STEC - VASTEAM JOINT VENTURE</div></div></div>			<div>CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE</div> <div>INVESTIGATION, DESIGN AND CONSTRUCTION</div> <div>3 - MONTH ROLLING PROGRAMME</div>										<div>Page 9 of 24</div> <div>Cut-Off Data Date: 15-Mar-19</div>																																				
Activity ID		Activity Name		BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	y	2019				March 2019				April 2019				May 2019				June 2019																					
													17	24		03	10	17	24	31	07	14	21	28	05	12	19	26	02	09	16																		
	ACU3010C520	C - (CH2477 to CH2478) - Top Head Excavation		0			1	27-Mar-19 08:00	27-Mar-19 18:00	%																																							
	ACU3010C530	C - (CH2477 to CH2478) - Shotcrete and Mesh Installation		0			1	28-Mar-19 08:00	28-Mar-19 18:00	%																																							
	ACU3010C540	C - (CH2477 to CH2478) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	29-Mar-19 08:00	30-Mar-19 18:00	%																																							
	ACU3010C550	C - (CH2478 to CH2479) - Top Head Excavation		0			1	31-Mar-19 08:00	31-Mar-19 18:00	%																																							
	ACU3010C560	C - (CH2478 to CH2479) - Shotcrete and Mesh Installation		0			1	01-Apr-19 08:00	01-Apr-19 18:00	%																																							
	ACU3010C570	C - (CH2478 to CH2479) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	02-Apr-19 08:00	03-Apr-19 18:00	%																																							
	ACU3010C580	C - (CH2479 to CH2480) - Top Head Excavation		0			1	04-Apr-19 08:00	04-Apr-19 18:00	%																																							
	ACU3010C590	C - (CH2479 to CH2480) - Shotcrete and Mesh Installation		0			1	05-Apr-19 08:00	05-Apr-19 18:00	%																																							
	ACU3010C600	C - (CH2479 to CH2480) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	06-Apr-19 08:00	07-Apr-19 18:00	%																																							
	ACU3010C610	C - (CH2480 to CH2481) - Top Head Excavation		0			1	08-Apr-19 08:00	08-Apr-19 18:00	%																																							
	ACU3010C620	C - (CH2480 to CH2481) - Shotcrete and Mesh Installation		0			1	09-Apr-19 08:00	09-Apr-19 18:00	%																																							
	ACU3010C630	C - (CH2480 to CH2481) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	10-Apr-19 08:00	11-Apr-19 18:00	%																																							
	ACU3010C640	C - (CH2481 to CH2482) - Top Head Excavation		0			1	12-Apr-19 08:00	12-Apr-19 18:00	%																																							
	ACU3010C650	C - (CH2481 to CH2482) - Shotcrete and Mesh Installation		0			1	13-Apr-19 08:00	13-Apr-19 18:00	%																																							
	ACU3010C660	C - (CH2481 to CH2482) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	14-Apr-19 08:00	15-Apr-19 18:00	%																																							
	ACU3010C670	C - (CH2482 to CH2483) - Top Head Excavation		0			1	16-Apr-19 08:00	16-Apr-19 18:00	%																																							
	ACU3010C680	C - (CH2482 to CH2483) - Shotcrete and Mesh Installation		0			1	17-Apr-19 08:00	17-Apr-19 18:00	%																																							
	ACU3010C690	C - (CH2482 to CH2483) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	18-Apr-19 08:00	19-Apr-19 18:00	%																																							
	ACU3010C700	C - (CH2483 to CH2484) - Top Head Excavation		0			1	20-Apr-19 08:00	20-Apr-19 18:00	%																																							
	ACU3010C710	C - (CH2483 to CH2484) - Shotcrete and Mesh Installation		0			1	21-Apr-19 08:00	21-Apr-19 18:00	%																																							
	ACU3010C720	C - (CH2483 to CH2484) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	22-Apr-19 08:00	23-Apr-19 18:00	%																																							
	ACU3010C730	C - (CH2484 to CH2485) - Top Head Excavation		0			1	24-Apr-19 08:00	24-Apr-19 18:00	%																																							
	ACU3010C740	C - (CH2484 to CH2485) - Shotcrete and Mesh Installation		0			1	25-Apr-19 08:00	25-Apr-19 18:00	%																																							
	ACU3010C750	C - (CH2484 to CH2485) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	26-Apr-19 08:00	27-Apr-19 18:00	%																																							
	ACU3010C760	C - (CH2485 to CH2486) - Top Head Excavation		0			1	28-Apr-19 08:00	28-Apr-19 18:00	%																																							
	ACU3010C770	C - (CH2485 to CH2486) - Shotcrete and Mesh Installation		0			1	29-Apr-19 08:00	29-Apr-19 18:00	%																																							
	ACU3010C780	C - (CH2485 to CH2486) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	30-Apr-19 08:00	01-May-19 18:00	%																																							
	ACU3010C790	C - (CH2486 to CH2487) - Top Head Excavation		0			1	02-May-19 08:00	02-May-19 18:00	%																																							
	ACU3010C800	C - (CH2486 to CH2487) - Shotcrete and Mesh Installation		0			1	03-May-19 08:00	03-May-19 18:00	%																																							
	ACU3010C810	C - (CH2486 to CH2487) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	04-May-19 08:00	05-May-19 18:00	%																																							
	ACU3010C820	C - (CH2487 to CH2488) - Top Head Excavation		0			1	06-May-19 08:00	06-May-19 18:00	%																																							
	ACU3010C830	C - (CH2487 to CH2488) - Shotcrete and Mesh Installation		0			1	07-May-19 08:00	07-May-19 18:00	%																																							
	ACU3010C840	C - (CH2487 to CH2488) - Lattice Girder Installation, Shotcrete & Invert Beam		0			2	08-May-19 08:00	09-May-19 18:00	%																																							
	ACU3010C850	C - (CH2488 to CH2489) - Top Head Excavation		0			1	10-May-19 08:00	10-May-19 18:00	%																																							
<div><div><div>Primary Baseline</div><div>Actual Work</div></div><div><div>Baseline Milestone</div><div>Milestone</div></div></div>										<div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div>										<table><tr><td>Date</td><td>Revision</td><td>Checked</td><td>Approved</td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr></table>										Date	Revision	Checked	Approved																
Date	Revision	Checked	Approved																																														

<div><div><div><div></div><div>TEC</div><div>隧道股份</div></div><div>俊和 - 上隧 - 浩隆 聯營</div><div>CHUN Wo - STEC - VASTEAM JOINT VENTURE</div></div></div>			<div>CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE</div> <div>INVESTIGATION, DESIGN AND CONSTRUCTION</div> <div>3 - MONTH ROLLING PROGRAMME</div>										<div>Page 10 of 24</div> <div>Cut-Off Data Date: 15-Mar-19</div>																																															
Activity ID		Activity Name				BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	y 2019				March 2019				April 2019				May 2019				June 2019																															
														17	24		03	10	17	24		31	07	14	21		28	05	12	19	26		02	09	16																									
ACU3010C860		C - (CH2488 to CH2489) - Shotcrete and Mesh Installation				0			1	11-May-19 08:00	11-May-19 18:00	%																																																
ACU3010C870		C - (CH2488 to CH2489) - Lattice Girder Installation, Shotcrete & Invert Beam				0			2	12-May-19 08:00	13-May-19 18:00	%																																																
ACU3010C880		C - (CH2489 to CH2490) - Top Head Excavation				0			1	14-May-19 08:00	14-May-19 18:00	%																																																
ACU3010C890		C - (CH2489 to CH2490) - Shotcrete and Mesh Installation				0			1	15-May-19 08:00	15-May-19 18:00	%																																																
ACU3010C900		C - (CH2489 to CH2490) - Lattice Girder Installation, Shotcrete & Invert Beam				0			2	16-May-19 08:00	17-May-19 18:00	%																																																
ACU3010C910		C - (CH2490 to CH2491) - Top Head Excavation				0			1	18-May-19 08:00	18-May-19 18:00	%																																																
ACU3010C920		C - (CH2490 to CH2491) - Shotcrete and Mesh Installation				0			1	19-May-19 08:00	19-May-19 18:00	%																																																
ACU3010C930		C - (CH2490 to CH2491) - Lattice Girder Installation, Shotcrete & Invert Beam				0			2	20-May-19 08:00	21-May-19 18:00	%																																																
ACU3010C940		C - (CH2491 to CH2492) - Top Head Excavation				0			1	22-May-19 08:00	22-May-19 18:00	%																																																
ACU3010C950		C - (CH2491 to CH2492) - Shotcrete and Mesh Installation				0			1	23-May-19 08:00	23-May-19 18:00	%																																																
ACU3010C960		C - (CH2491 to CH2492) - Lattice Girder Installation, Shotcrete & Invert Beam				0			2	24-May-19 08:00	25-May-19 18:00	%																																																
Tunnel Construction from East Portal																																																												
CH2520 to CH2499 (21m) - Assume 10 days/ 2m Cycle																																																												
ACU3065A001		1st Cycle (CH2520 to CH2518) - Survey Setting Out and Drilling for Cut Hole/ Non-Cut Hole (102mm Dia.)				0			4	15-Apr-19 08:00	18-Apr-19 18:00	%																																																
ACU3065A002		1st Cycle (CH2520 to CH2518) - Rock Breaking for Non-cut Hole (102mm Dia.) and Insert Wedge into Non-cut Hole				0			2	19-Apr-19 08:00	20-Apr-19 18:00	%																																																
ACU3065A003		1st Cycle (CH2520 to CH2518) - Drilling for Tunnel Crown (76mm Dia.) and Rock Breaking				0			2	21-Apr-19 08:00	22-Apr-19 18:00	%																																																
ACU3065A004		1st Cycle (CH2520 to CH2518) - Rock Scaling for Underbreak Zone and Rock Mapping for Temporary Support (CAT III)				0			1	23-Apr-19 08:00	23-Apr-19 18:00	%																																																
ACU3065A005		1st Cycle (CH2520 to CH2518) - Drill, Install and Gout Rock Dowels (46mm Dia.) incl. Shotcrete for Temporary Support				0			1	24-Apr-19 08:00	24-Apr-19 18:00	%																																																
ACU3065A006		2nd Cycle (CH2518 to CH2516) - Survey Setting Out and Drilling for Cut Hole/ Non-Cut Hole (102mm Dia.)				0			4	25-Apr-19 08:00	28-Apr-19 18:00	%																																																
ACU3065A007		2nd Cycle (CH2518 to CH2516) - Rock Breaking for Non-cut Hole (102mm Dia.) and Insert Wedge into Non-cut Hole				0			2	29-Apr-19 08:00	30-Apr-19 18:00	%																																																
ACU3065A008		2nd Cycle (CH2518 to CH2516) - Drilling for Tunnel Crown (76mm Dia.) and Rock Breaking				0			2	01-May-19 08:00	02-May-19 18:00	%																																																
ACU3065A009		2nd Cycle (CH2518 to CH2516) - Rock Scaling for Underbreak Zone and Rock Mapping for Temporary Support (CAT III)				0			1	03-May-19 08:00	03-May-19 18:00	%																																																
ACU3065A010		2nd Cycle (CH2518 to CH2516) - Drill, Install and Gout Rock Dowels (46mm Dia.) incl. Shotcrete for Temporary Support				0			1	04-May-19 08:00	04-May-19 18:00	%																																																
ACU3065A011		3rd Cycle (CH2516 to CH2514) - Survey Setting Out and Drilling for Cut Hole/ Non-Cut Hole (102mm Dia.)				0			4	05-May-19 08:00	08-May-19 18:00	%																																																
ACU3065A012		3rd Cycle (CH2516 to CH2514) - Rock Breaking for Non-cut Hole (102mm Dia.) and Insert Wedge into Non-cut Hole				0			2	09-May-19 08:00	10-May-19 18:00	%																																																
ACU3065A013		3rd Cycle (CH2516 to CH2514) - Drilling for Tunnel Crown (76mm Dia.) and Rock Breaking				0			2	11-May-19 08:00	12-May-19 18:00	%																																																
ACU3065A014		3rd Cycle (CH2516 to CH2514) - Rock Scaling for Underbreak Zone and Rock Mapping for Temporary Support (CAT III)				0			1	13-May-19 08:00	13-May-19 18:00	%																																																
ACU3065A015		3rd Cycle (CH2516 to CH2514) - Drill, Install and Gout Rock Dowels (46mm Dia.) incl. Shotcrete for Temporary Support				0			1	14-May-19 08:00	14-May-19 18:00	%																																																
ACU3065A016		4th Cycle (CH2514 to CH2512) - Survey Setting Out and Drilling for Cut Hole/ Non-Cut Hole (102mm Dia.)				0			4	15-May-19 08:00	18-May-19 18:00	%																																																
ACU3065A017		4th Cycle (CH2514 to CH2512) - Rock Breaking for Non-cut Hole (102mm Dia.) and Insert Wedge into Non-cut Hole				0			2	19-May-19 08:00	20-May-19 18:00	%																																																
ACU3065A018		4th Cycle (CH2514 to CH2512) - Drilling for Tunnel Crown (76mm Dia.) and Rock Breaking				0			2	21-May-19 08:00	22-May-19 18:00	%																																																
ACU3065A019		4th Cycle (CH2514 to CH2512) - Rock Scaling for Underbreak Zone and Rock Mapping for Temporary Support (CAT III)				0			1	23-May-19 08:00	23-May-19 18:00	%																																																
ACU3065A020		4th Cycle (CH2514 to CH2512) - Drill, Install and Gout Rock Dowels (46mm Dia.) incl. Shotcrete for Temporary Support				0			1	24-May-19 08:00	24-May-19 18:00	%																																																
ACU3065A021		5th Cycle (CH2512 to CH2510) - Survey Setting Out and Drilling for Cut Hole/ Non-Cut Hole (102mm Dia.)				0			4	25-May-19 08:00	28-May-19 18:00	%																																																
<div><div><div><div></div><div>Primary Baseline</div></div><div><div></div><div>Actual Work</div></div><div><div></div><div>Baseline Milestone</div></div><div><div></div><div>Milestone</div></div></div><div><div></div><div>Forecast Work</div></div></div>									<div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div>										<table><tr><td>Date</td><td colspan="3">Revision</td><td>Checked</td><td colspan="3">Approved</td></tr><tr><td></td><td colspan="3"></td><td></td><td colspan="3"></td></tr><tr><td></td><td colspan="3"></td><td></td><td colspan="3"></td></tr><tr><td></td><td colspan="3"></td><td></td><td colspan="3"></td></tr></table>										Date	Revision			Checked	Approved																										
Date	Revision			Checked	Approved																																																							

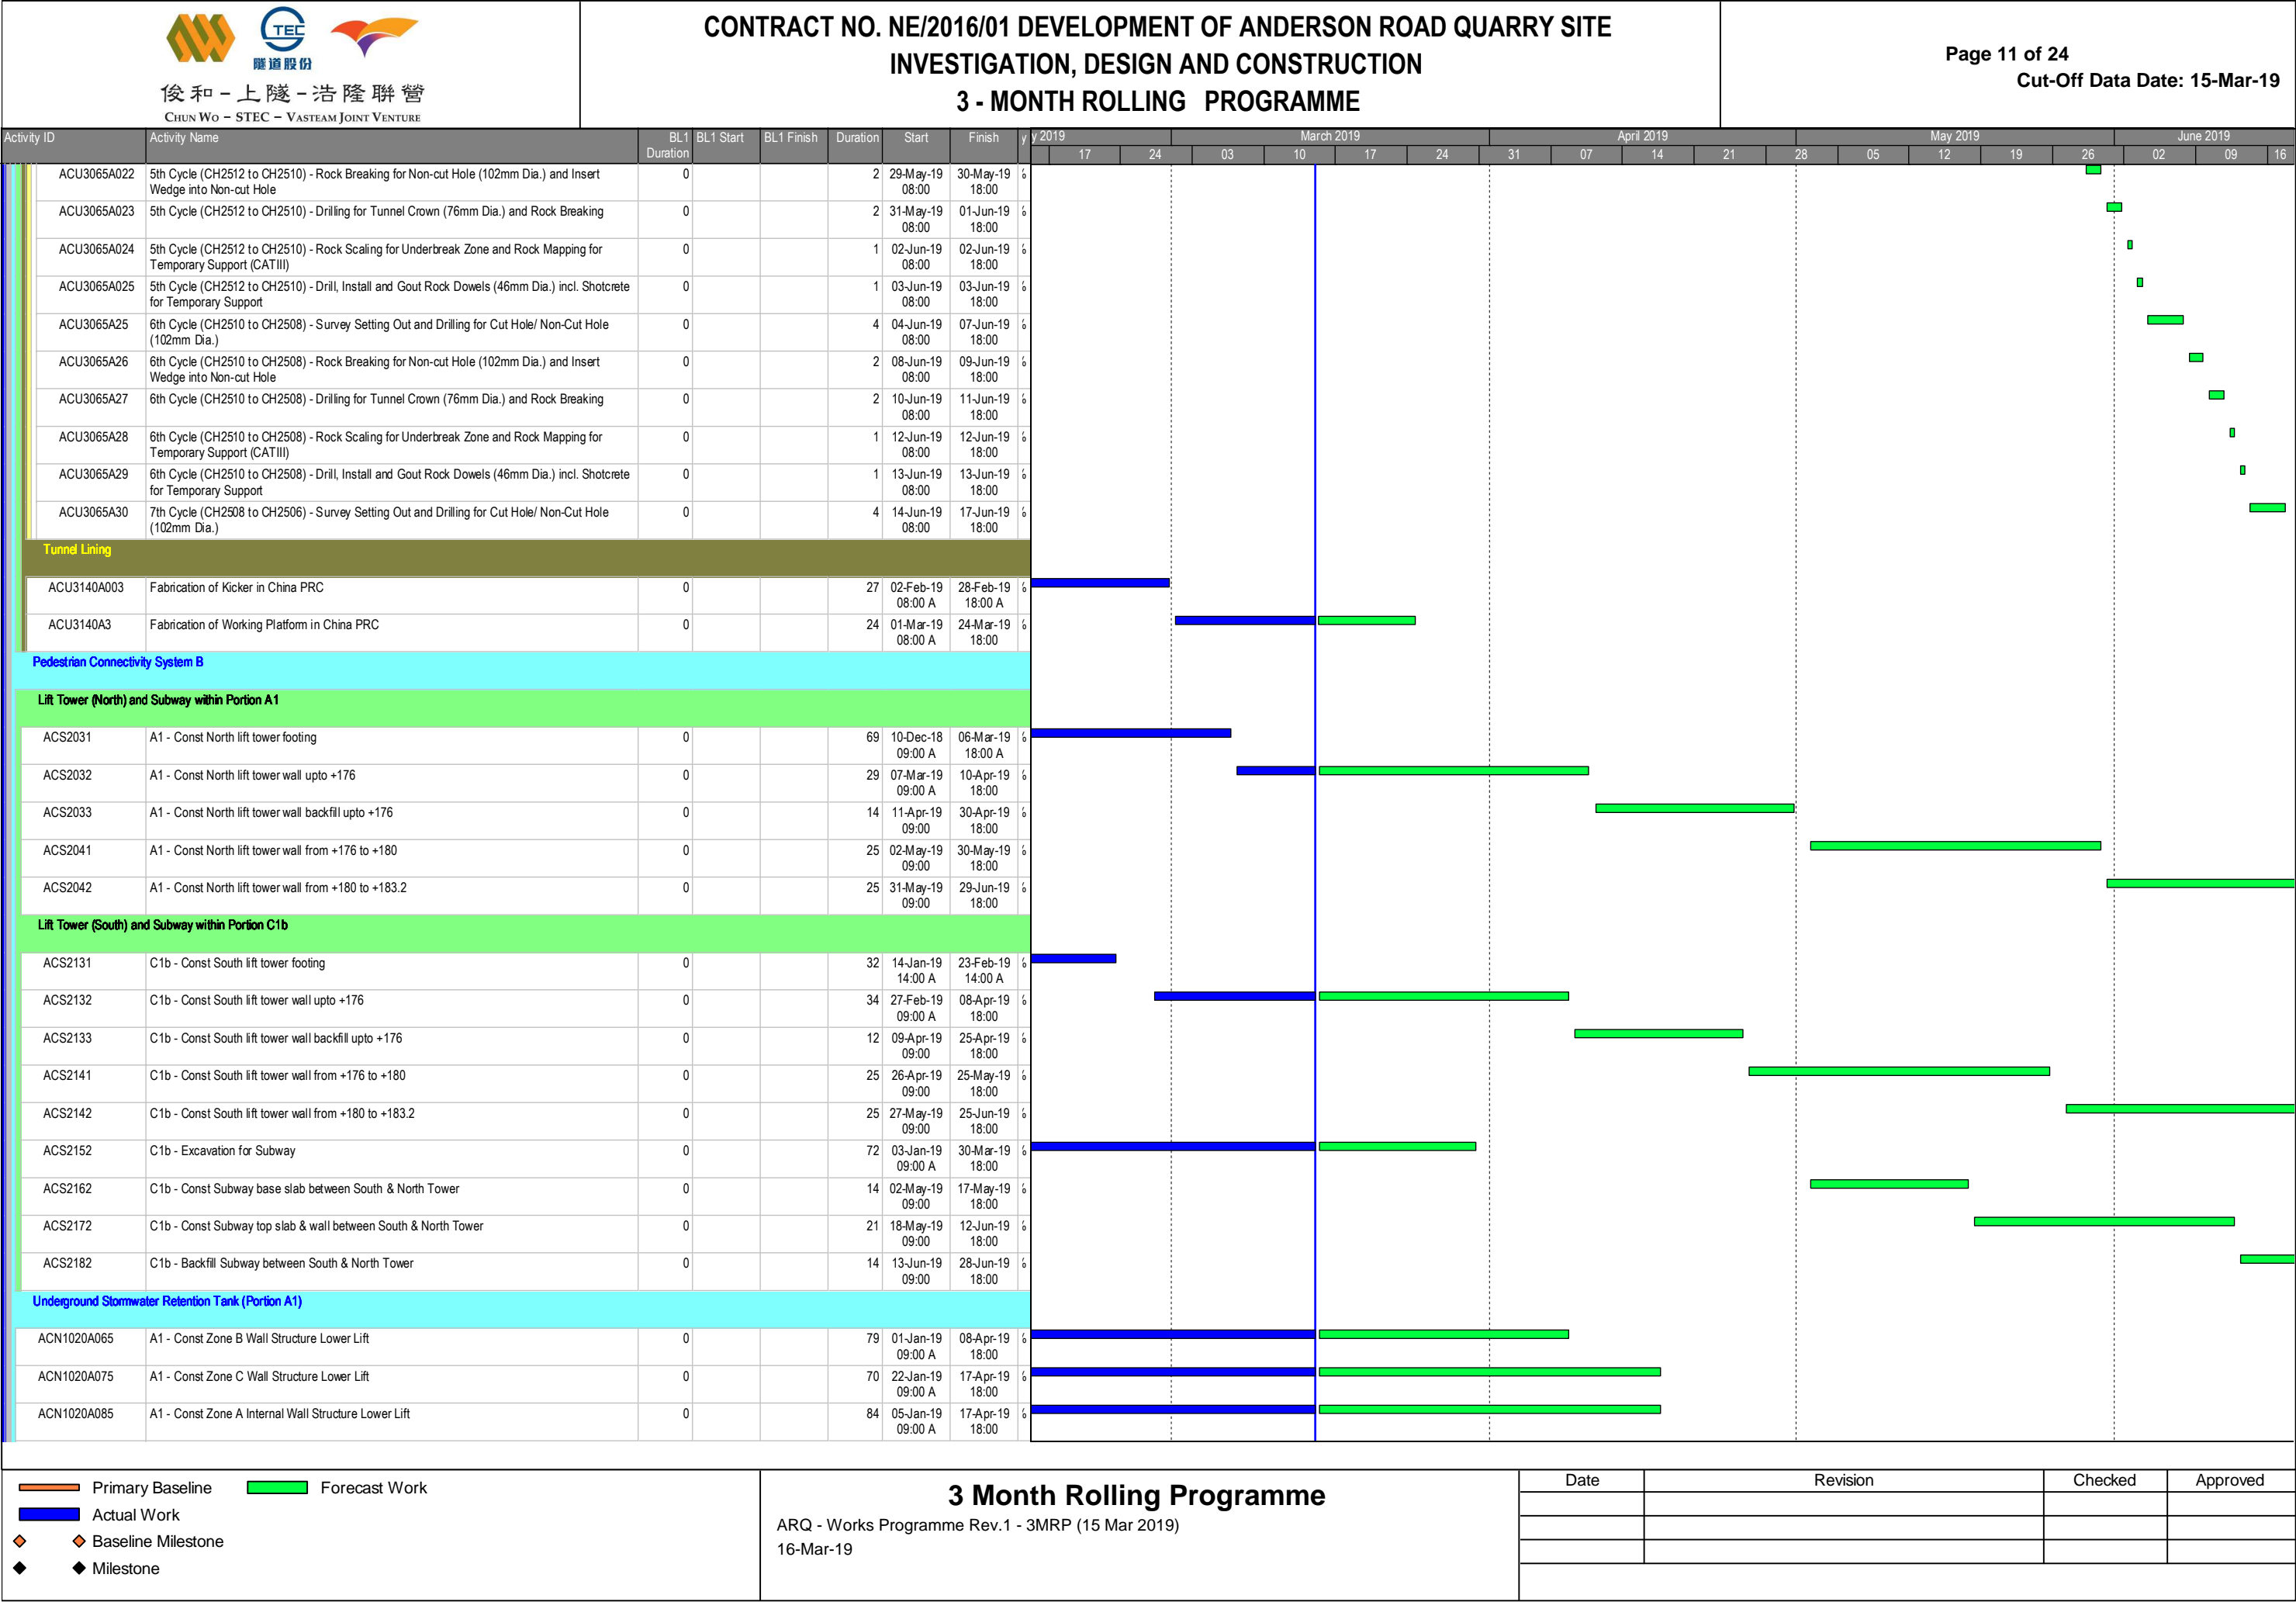

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

<div><div><div><div></div><div>TEC</div><div>隧道股份</div></div><div>俊和 - 上隧 - 浩隆 聯營</div><div>CHUN Wo - STEC - VASTEAM JOINT VENTURE</div></div></div>			<div>CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE</div> <div>INVESTIGATION, DESIGN AND CONSTRUCTION</div> <div>3 - MONTH ROLLING PROGRAMME</div>										<div>Page 14 of 24</div> <div>Cut-Off Data Date: 15-Mar-19</div>															
Activity ID	Activity Name	BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	2019				March 2019				April 2019				May 2019				June 2019			
										17	24		03	10	17	24	31	07	14	21	28	05	12	19	26	02	09	16
ACL10050A064	Concrete Pouring for Wall andTop Slab of Box Culvert BC2 Bay 5 (CHB48 to CHB58)	0			1	15-Mar-19 08:00	15-Mar-19 18:00	%																				
ACL10050A070	Fomwork and Rebar Fixing for Wall and Top Slab of Box Culvert BC2 Bay 6 (CHB58 to CHB72)	0			11	16-Mar-19 08:00	28-Mar-19 18:00	%																				
ACL10050A071	Concrete Pouring for Wall andTop Slab of Box Culvert BC2 Bay 6 (CHB58 to CHB72)	0			1	29-Mar-19 08:00	29-Mar-19 18:00	%																				
ACL10050A077	Fomwork and Rebar Fixing for Wall and Top Slab of Box Culvert BC2 Bay 7 (CHB72 to CHB84)	0			77	26-Nov-18 00:00 A	01-Mar-19 18:00 A	%																				
ACL10050A078	Concrete Pouring for Wall andTop Slab of Box Culvert BC2 Bay 7 (CHB72 to CHB84)	0			1	02-Mar-19 08:00 A	02-Mar-19 18:00 A	%																				
ACL10050A104	Concrete Pouring for Base Slab of Box Culvert BBC2 Bay 11 (CHB120 to CHB128)	0			1	15-Mar-19 08:00*	15-Mar-19 18:00	%																				
ACL10050A105	Fomwork and Rebar Fixing for Wall and Top Slab of Box Culvert BC2 Bay 11 (CHB120 to CHB128)	0			11	16-Mar-19 08:00	28-Mar-19 18:00	%																				
ACL10050A106	Concrete Pouring for Wall andTop Slab of Box Culvert BC2 Bay 11 (CHB120 to CHB128)	0			1	29-Mar-19 08:00	29-Mar-19 18:00	%																				
ACL10050A107	Excavation of Box Culvert BC2 Bay 12 (CHB128 to CHB144)	0			5	05-Jun-19 08:00*	11-Jun-19 18:00	%																				
ACL10050A108	Laying Geotextile Filter and Rockfilling for BC2 Bay 12 (CHB128 to CHB144)	0			4	12-Jun-19 08:00*	15-Jun-19 18:00	%																				
ACL10050A114	Excavation of Box Culvert BC2 Bay 13 (CHB144 to CHB156)	0			5	30-Mar-19 08:00*	04-Apr-19 18:00	%																				
ACL10050A115	Laying Geotextile Filter and Rockfilling for BC2 Bay 13 (CHB144 to CHB156)	0			4	06-Apr-19 08:00*	10-Apr-19 18:00	%																				
ACL10050A116	Blinding Layer for Box Culvert BC2 Bay 13 (CHB144 to CHB156)	0			1	11-Apr-19 08:00	11-Apr-19 18:00	%																				
ACL10050A117	Fomwork,Rebar Fixing and Water Stop for Base Slab of Box Culvert BC2 Bay 13 (CHB144 to CHB156)	0			9	12-Apr-19 08:00	25-Apr-19 18:00	%																				
ACL10050A118	Concrete Pouring for Base Slab of Box Culvert BBC2 Bay 13 (CHB144 to CHB156)	0			1	26-Apr-19 08:00	26-Apr-19 18:00	%																				
ACL10050A119	Fomwork and Rebar Fixing for Wall and Top Slab of Box Culvert BC2 Bay 13 (CHB144 to CHB156)	0			11	22-May-19 08:00	03-Jun-19 18:00	%																				
ACL10050A120	Concrete Pouring for Wall andTop Slab of Box Culvert BC2 Bay 13 (CHB144 to CHB156)	0			1	04-Jun-19 08:00	04-Jun-19 18:00	%																				
ACL10050A121	Excavation of Box Culvert BC2 Bay 14 (CHB156 to CHB168)	0			5	06-Apr-19 08:00	11-Apr-19 18:00	%																				
ACL10050A122	Laying Geotextile Filter and Rockfilling for BC2 Bay 14 (CHB156 to CHB168)	0			4	12-Apr-19 08:00*	16-Apr-19 18:00	%																				
ACL10050A123	Blinding Layer for Box Culvert BC2 Bay 14 (CHB156 to CHB168)	0			1	17-Apr-19 08:00	17-Apr-19 18:00	%																				
ACL10050A124	Fomwork,Rebar Fixing and Water Stop for Base Slab of Box Culvert BC2 Bay 14 (CHB156 to CHB168)	0			9	10-May-19 08:00	20-May-19 18:00	%																				
ACL10050A125	Concrete Pouring for Base Slab of Box Culvert BBC2 Bay 14 (CHB156 to CHB168)	0			1	21-May-19 08:00	21-May-19 18:00	%																				
ACL10050A128	Excavation of Box Culvert BC2 Bay 15 (CHB168 to CHB180)	0			5	12-Apr-19 08:00	17-Apr-19 18:00	%																				
ACL10050A129	Laying Geotextile Filter and Rockfilling for BC2 Bay 15 (CHB168 to CHB180)	0			4	18-Apr-19 08:00*	25-Apr-19 18:00	%																				
ACL10050A130	Blinding Layer for Box Culvert BC2 Bay 15 (CHB168 to CHB180)	0			1	26-Apr-19 08:00	26-Apr-19 18:00	%																				
ACL10050A131	Fomwork,Rebar Fixing and Water Stop for Base Slab of Box Culvert BC2 Bay 15 (CHB168 to CHB180)	0			9	27-Apr-19 08:00	08-May-19 18:00	%																				
ACL10050A132	Concrete Pouring for Base Slab of Box Culvert BBC2 Bay 15 (CHB168 to CHB180)	0			1	09-May-19 08:00	09-May-19 18:00	%																				
ACL10050A135	Excavation of Box Culvert BC2 Bay 16 (CHB180 to CHB192)	0			5	22-May-19 08:00	27-May-19 18:00	%																				
ACL10050A136	Laying Geotextile Filter and Rockfilling for BC2 Bay 16 (CHB180 to CHB192)	0			4	28-May-19 08:00*	31-May-19 18:00	%																				
ACL10050A137	Blinding Layer for Box Culvert BC2 Bay 16 (CHB180 to CHB192)	0			1	01-Jun-19 08:00	01-Jun-19 18:00	%																				
ACL10050A142	Excavation of Box Culvert BC2 Bay 17 (CHB192 to CHB201.096)	0			5	28-May-19 08:00	01-Jun-19 18:00	%																				
ACL10050A143	Laying Geotextile Filter and Rockfilling for BC2 Bay 17 (CHB192 to CHB201.096)	0			4	03-Jun-19 08:00*	06-Jun-19 18:00	%																				
ACL10050A144	Blinding Layer for Box Culvert BC2 Bay 17 (CHB192 to CHB201.096)	0			1	08-Jun-19 08:00	08-Jun-19 18:00	%																				
ACL10050A145	Fomwork,Rebar Fixing and Water Stop for Base Slab of Box Culvert BC2 Bay 17 (CHB192 to CHB201.096)	0			9	10-Jun-19 08:00	19-Jun-19 18:00	%																				
<div><div><div>Primary Baseline</div><div>Actual Work</div></div><div><div>Baseline Milestone</div><div>Milestone</div></div></div>					<div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div>									Date		Revision				Checked		Approved						

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <h3>3 Month Rolling Programme</h3> <p>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</p> <p>16-Mar-19</p> </div>	Date	Revision	Checked	Approved

<div><div><div><div></div><div>TEC</div><div>隧道股份</div></div><div>俊和 - 上隧 - 浩隆 聯營</div><div>CHUN WO - STEC - VASTEAM JOINT VENTURE</div></div></div>			<div>CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE</div> <div>INVESTIGATION, DESIGN AND CONSTRUCTION</div> <div>3 - MONTH ROLLING PROGRAMME</div>										<div>Page 16 of 24</div> <div>Cut-Off Data Date: 15-Mar-19</div>																		
Activity ID		Activity Name		BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	y 2019				March 2019				April 2019				May 2019				June 2019				
												17	24		03	10	17	24	31	07	14	21	28	05	12	19	26	02	09	16	
ACL401363	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #2 (1st Stage)			0			2	17-Apr-19 08:00	18-Apr-19 18:00	%																					
ACL401364	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #2 (1st Stage)			0			3	23-Apr-19 08:00	25-Apr-19 18:00	%																					
ACL401365	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #2 (1st Stage)			0			1	26-Apr-19 08:00	26-Apr-19 18:00	%																					
ACL401372	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #3 (1st Stage)			0			2	06-Apr-19 08:00	08-Apr-19 18:00	%																					
ACL401373	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #3 (1st Stage)			0			3	09-Apr-19 08:00	11-Apr-19 18:00	%																					
ACL401374	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #3 (1st Stage)			0			1	12-Apr-19 08:00	12-Apr-19 18:00	%																					
ACL401381	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #4 (1st Stage)			0			2	22-Mar-19 08:00	23-Mar-19 18:00	%																					
ACL401382	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #4 (1st Stage)			0			3	25-Mar-19 08:00	27-Mar-19 18:00	%																					
ACL401383	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #4 (1st Stage)			0			1	28-Mar-19 08:00	28-Mar-19 18:00	%																					
ACL401390	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #5 (1st Stage)			0			2	29-Mar-19 08:00	30-Mar-19 18:00	%																					
ACL401391	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #5 (1st Stage)			0			3	01-Apr-19 08:00	03-Apr-19 18:00	%																					
ACL401392	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #5 (1st Stage)			0			1	04-Apr-19 08:00	04-Apr-19 18:00	%																					
ACL401399	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #6 (1st Stage)			0			2	15-Mar-19 08:00	16-Mar-19 18:00	%																					
ACL401400	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #6 (1st Stage)			0			3	18-Mar-19 08:00	20-Mar-19 18:00	%																					
ACL401401	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #6 (1st Stage)			0			1	21-Mar-19 08:00	21-Mar-19 18:00	%																					
ACL401408	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #7 (1st Stage)			0			2	26-Mar-19 08:00	27-Mar-19 18:00	%																					
ACL401409	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #7 (1st Stage)			0			3	28-Mar-19 08:00	30-Mar-19 18:00	%																					
ACL401410	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #7 (1st Stage)			0			1	01-Apr-19 08:00	01-Apr-19 18:00	%																					
ACL401417	C1a - Installation of Formworks for Base Slab of Noise Barrier - Bay #8 (1st Stage)			0			2	02-Apr-19 08:00	03-Apr-19 18:00	%																					
ACL401418	C1a - Rebar Placement for Base Slab of Noise Barrier - Bay #8 (1st Stage)			0			3	04-Apr-19 08:00	08-Apr-19 18:00	%																					
ACL401419	C1a - Concreting Pouring for Base Slab of Noise Barrier - Bay #8 (1st Stage)			0			1	09-Apr-19 08:00*	09-Apr-19 18:00	%																					
ACL401420	C1a - Rebar Placement for 3600mm HT Wall of Noise Barrier - Bay #8 (2nd Stage)			0			2	10-Jun-19 08:00	11-Jun-19 18:00	%																					
ACL401421	C1a - Installation of Temporary Platform and Formworks for 3600mm HT Wall of Noise Barrier - Bay #8 (2nd Stage)			0			2	12-Jun-19 08:00	13-Jun-19 18:00	%																					
ACL401422	C1a - Concreting Pouring for 3600mm HT Wall of Noise Barrier - Bay #8 (2nd Stage)			0			1	14-Jun-19 08:00	14-Jun-19 18:00	%																					
ACL401429	C1a - Rebar Placement for 3600mm HT Wall of Noise Barrier - Bay #9 (2nd Stage)			0			2	14-Jun-19 08:00	15-Jun-19 18:00	%																					
ACL401438	C1a - Rebar Placement for 3600mm HT Wall of Noise Barrier - Bay #10 (2nd Stage)			0			2	06-Jun-19 08:00	08-Jun-19 18:00	%																					
ACL401439	C1a - Installation of Temporary Platform and Formworks for 3600mm HT Wall of Noise Barrier - Bay #10 (2nd Stage)			0			2	10-Jun-19 08:00	11-Jun-19 18:00	%																					
ACL401440	C1a - Concreting Pouring for 3600mm HT Wall of Noise Barrier - Bay #10 (2nd Stage)			0			1	12-Jun-19 08:00	12-Jun-19 18:00	%																					
ACL401447	C1a - Rebar Placement for 3600mm HT Wall of Noise Barrier - Bay #11 (2nd Stage)			0			2	12-Jun-19 08:00	13-Jun-19 18:00	%																					
ACL401448	C1a - Installation of Temporary Platform and Formworks for 3600mm HT Wall of Noise Barrier - Bay #11 (2nd Stage)			0			2	14-Jun-19 08:00	15-Jun-19 18:00	%																					
ACL401456	C1a - Rebar Placement for 3600mm HT Wall of Noise Barrier - Bay #12 (2nd Stage)			0			2	30-May-19 08:00	31-May-19 18:00	%																					
ACL401457	C1a - Installation of Temporary Platform and Formworks for 3600mm HT Wall of Noise Barrier - Bay #12 (2nd Stage)			0			2	01-Jun-19 08:00	03-Jun-19 18:00	%																					
ACL401458	C1a - Concreting Pouring for 3600mm HT Wall of Noise Barrier - Bay #12 (2nd Stage)			0			1	04-Jun-19 08:00	04-Jun-19 18:00	%																					
ACL401465	C1a - Rebar Placement for 3600mm HT Wall of Noise Barrier - Bay #13 (2nd Stage)			0			2	04-Jun-19 08:00	05-Jun-19 18:00	%																					
<div><div><div>Primary Baseline</div><div>Actual Work</div><div>Baseline Milestone</div><div>Milestone</div></div><div><div>Forecast Work</div></div></div>							<div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div>										Date		Revision				Checked		Approved						



<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<h2>3 Month Rolling Programme</h2> <p>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</p> <p>16-Mar-19</p>	Date	Revision	Checked	Approved






**CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE
INVESTIGATION, DESIGN AND CONSTRUCTION
3 - MONTH ROLLING PROGRAMME**

Page 18 of 24
Cut-Off Data Date: 15-Mar-19

[illegible]

 Primary Baseline
  Forecast Work

 Actual Work

 Baseline Milestone
  Milestone

3 Month Rolling Programme

ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)

16-Mar-19

3 Month Rolling Programme

ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)

16-Mar-19

Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<h2>3 Month Rolling Programme</h2> <p>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</p> <p>16-Mar-19</p>	Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<h2>3 Month Rolling Programme</h2> <p>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</p> <p>16-Mar-19</p>	Date	Revision	Checked	Approved



<div> <div>Primary Baseline</div> <div>Forecast Work</div> <div>Actual Work</div> <div> <div>Baseline Milestone</div> <div>Milestone</div> </div> </div>	<div> <h3>3 Month Rolling Programme</h3> <p>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</p> <p>16-Mar-19</p> </div>	Date	Revision	Checked	Approved





**CONTRACT NO. NE/2016/01 DEVELOPMENT OF ANDERSON ROAD QUARRY SITE
INVESTIGATION, DESIGN AND CONSTRUCTION
3 - MONTH ROLLING PROGRAMME**


Page 22 of 24
Cut-Off Data Date: 15-Mar-19

Activity ID	Activity Name	BL1 Duration	BL1 Start	BL1 Finish	Duration	Start	Finish	y	y 2019			March 2019			April 2019			
									17	24	03	10	17	24	31	07	14	
	ACB50230	B5 - JV Prepare and Submit Detailed Design of RSSM for Slope 11NE-D/C982 (1600 sqm) (Provisional Work)	6	17-Jun-19 08:00	22-Jun-19 18:00	6	30-May-19 08:00	05-Jun-19 18:00	%									
	ACB50240	B5 - RE Review and Approve Detailed Design of RSSM for Slope 11NE-D/C982 (1600 sqm) (Provisional Work)	6	24-Jun-19 08:00	29-Jun-19 18:00	6	06-Jun-19 08:00	13-Jun-19 18:00	%									
	ACB50260	B5 - Anchorage Installation of Scaffold for Slope 11NE-D/C983 (800 sqm)	12	17-Jun-19 08:00	29-Jun-19 18:00	12	30-May-19 08:00	13-Jun-19 18:00	%									
	ACB50270	B5 - Erection of Scaffold for Slope 11NE-D/C983 (800 sqm) - 150sqm/d	6	02-Jul-19 08:00	08-Jul-19 18:00	6	14-Jun-19 08:00	20-Jun-19 18:00	%									
	ACB50470A001	B5 - Rock Scaling and Vegetation Stripping for Slope 11NE-D/C989	0			90	05-Dec-18 08:00 A	26-Mar-19 18:00	%									
	ACB50590	B5 - Erection of Scaffold for Slope 11NE-B/C1013 (700 sqm) - 150sqm/d	10	05-Feb-20 08:00	15-Feb-20 18:00	10	15-Mar-19 08:00	26-Mar-19 18:00	%									
	ACB50600	B5 - Rock Slope Mapping (Instructed by RE) for Slope 11NE-B/C1013 (700 sqm) - 80sqm/d (Provisional Work)	18	17-Feb-20 08:00	07-Mar-20 18:00	18	27-Mar-19 08:00	17-Apr-19 18:00	%									
	ACB50610	B5 - JV Prepare and Submit Detailed Design of RSSM for Slope 11NE-B/C1013 (700 sqm) (Provisional Work)	6	09-Mar-20 08:00	14-Mar-20 18:00	6	18-Apr-19 08:00	27-Apr-19 18:00	%									
	ACB50620	B5 - RE Review and Approve Detailed Design of RSSM for Slope 11NE-B/C1013 (700 sqm) (Provisional Work)	6	16-Mar-20 08:00	21-Mar-20 18:00	6	29-Apr-19 08:00	06-May-19 18:00	%									
Portion B8																		
Site Formation																		
ACB80040	B8 - Construct New U-Channel 375U (approx 66m) and Catchpit TC6d	26	19-Dec-17 08:00	20-Jan-18 18:00	148	29-Aug-18 08:00 A	28-Feb-19 11:36 A	%										
ACB80050	B8 - Construct New U-Channel 450U (approx 73m) and Catchpit TC6a	30	22-Jan-18 08:00	28-Feb-18 18:00	54	01-Jan-19 08:00 A	08-Mar-19 18:00 A	%										
ACB80060	B8 - Construct New U-Channel 525U (approx 80m) and Catchpit TC6c	36	01-Mar-18 08:00	16-Apr-18 18:00	71	04-Jan-19 08:00 A	30-Mar-19 18:00	%										
ACB80070	B8 - Construct New U-Channel 450U (approx 100m) and Catchpit TC6	40	17-Apr-18 08:00	04-Jun-18 18:00	42	01-Mar-19 08:00 A	23-Apr-19 18:00	%										
ACB80080	B8 - Construct New U-Channel 525U (approx 77m) and Catchpit TC6b	40	05-Jun-18 08:00	23-Jul-18 18:00	40	02-Apr-19 08:00	23-May-19 18:00	%										
Portion B10																		
Site Formation																		
ACB100030	B10 - Construct New U-Channel (450U,525U and 675U; approx 90m) and Catchpits (3nos)	40	22-Dec-17 08:00	09-Feb-18 18:00	40	15-Mar-19 08:00*	06-May-19 18:00	%										
Portion C1b																		
Site Formation																		
ACC10009A004	C1b - Excavate for 1350 dia. Drainage Pipes Laying from an existing manhole X4 to a new manhole X3A	0			110	13-Oct-18 08:00 A	26-Feb-19 18:00 A	%										
ACC10009A4	C1b - 1350 dia. Drainage Pipes Laying from an existing manhole X4 to a new manhole X3A	0			48	01-Feb-19 08:00 A	01-Apr-19 18:00	%										
ACC100110	C1b - Construct Surface Drainage, Catch Pits and Stairway at Slope A5 1	0			12	02-Apr-19 08:00	16-Apr-19 18:00	%										
ACC100120	C1b - Construct Surface Drainage, Catch Pits and Stairway at Slope A5 2	0			12	17-Apr-19 08:00	04-May-19 18:00	%										
ACC100130	C1b - Construct Surface Drainage, Catch Pits and Stairway at Slope A5 3	0			12	06-May-19 08:00	18-May-19 18:00	%										
ACC100140	C1b - Construct Surface Drainage, Catch Pits and Stairway at Slope A5 1	0			12	20-May-19 08:00	01-Jun-19 18:00	%										
ACC100150	C1b - Construct Surface Drainage, Catch Pits and Stairway at Slope A5 1	0			12	03-Jun-19 08:00	17-Jun-19 18:00	%										
ACC100210	C1b - Construct Manholes (5nos) and associated Sewerage Pipes 1	0			12	02-Apr-19 08:00	16-Apr-19 18:00	%										
ACC100220	C1b - Construct Manholes (5nos) and associated Sewerage Pipes 2	0			12	17-Apr-19 08:00	04-May-19 18:00	%										
ACC100230	C1b - Construct Manholes (5nos) and associated Sewerage Pipes 3	0			12	06-May-19 08:00	18-May-19 18:00	%										
ACC100240	C1b - Construct Manholes (5nos) and associated Sewerage Pipes 4	0			12	20-May-19 08:00	01-Jun-19 18:00	%										
ACC100250	C1b - Construct Manholes (5nos) and associated Sewerage Pipes 5	0			12	10-Jun-19 08:00	22-Jun-19 18:00	%										
ACC10030	C1b - Upgrading Existing 225 to 450mm dia. and Re-construct Existing Manholes (5nos)	60	08-Dec-18 08:00	22-Feb-19 18:00	60	24-May-19 08:00	03-Aug-19 18:00	%										

 Primary Baseline
  Forecast Work

 Actual Work

 Baseline Milestone

 Milestone

Primary Baseline

Forecast Work

Actual Work

Baseline Milestone

Milestone

3 Month Rolling Programme


ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)

16-Mar-19


Date	Revision	Checked	Approved

<div> <div> <div></div> <div>Primary Baseline</div> </div> <div> <div></div> <div>Forecast Work</div> </div> <div> <div></div> <div>Actual Work</div> </div> <div> <div></div> <div>Baseline Milestone</div> </div> <div> <div></div> <div>Milestone</div> </div> </div>	<div> <div>3 Month Rolling Programme</div> <div>ARQ - Works Programme Rev.1 - 3MRP (15 Mar 2019)</div> <div>16-Mar-19</div> </div>	Date	Revision	Checked	Approved

Contract 2 (NE/2016/05)

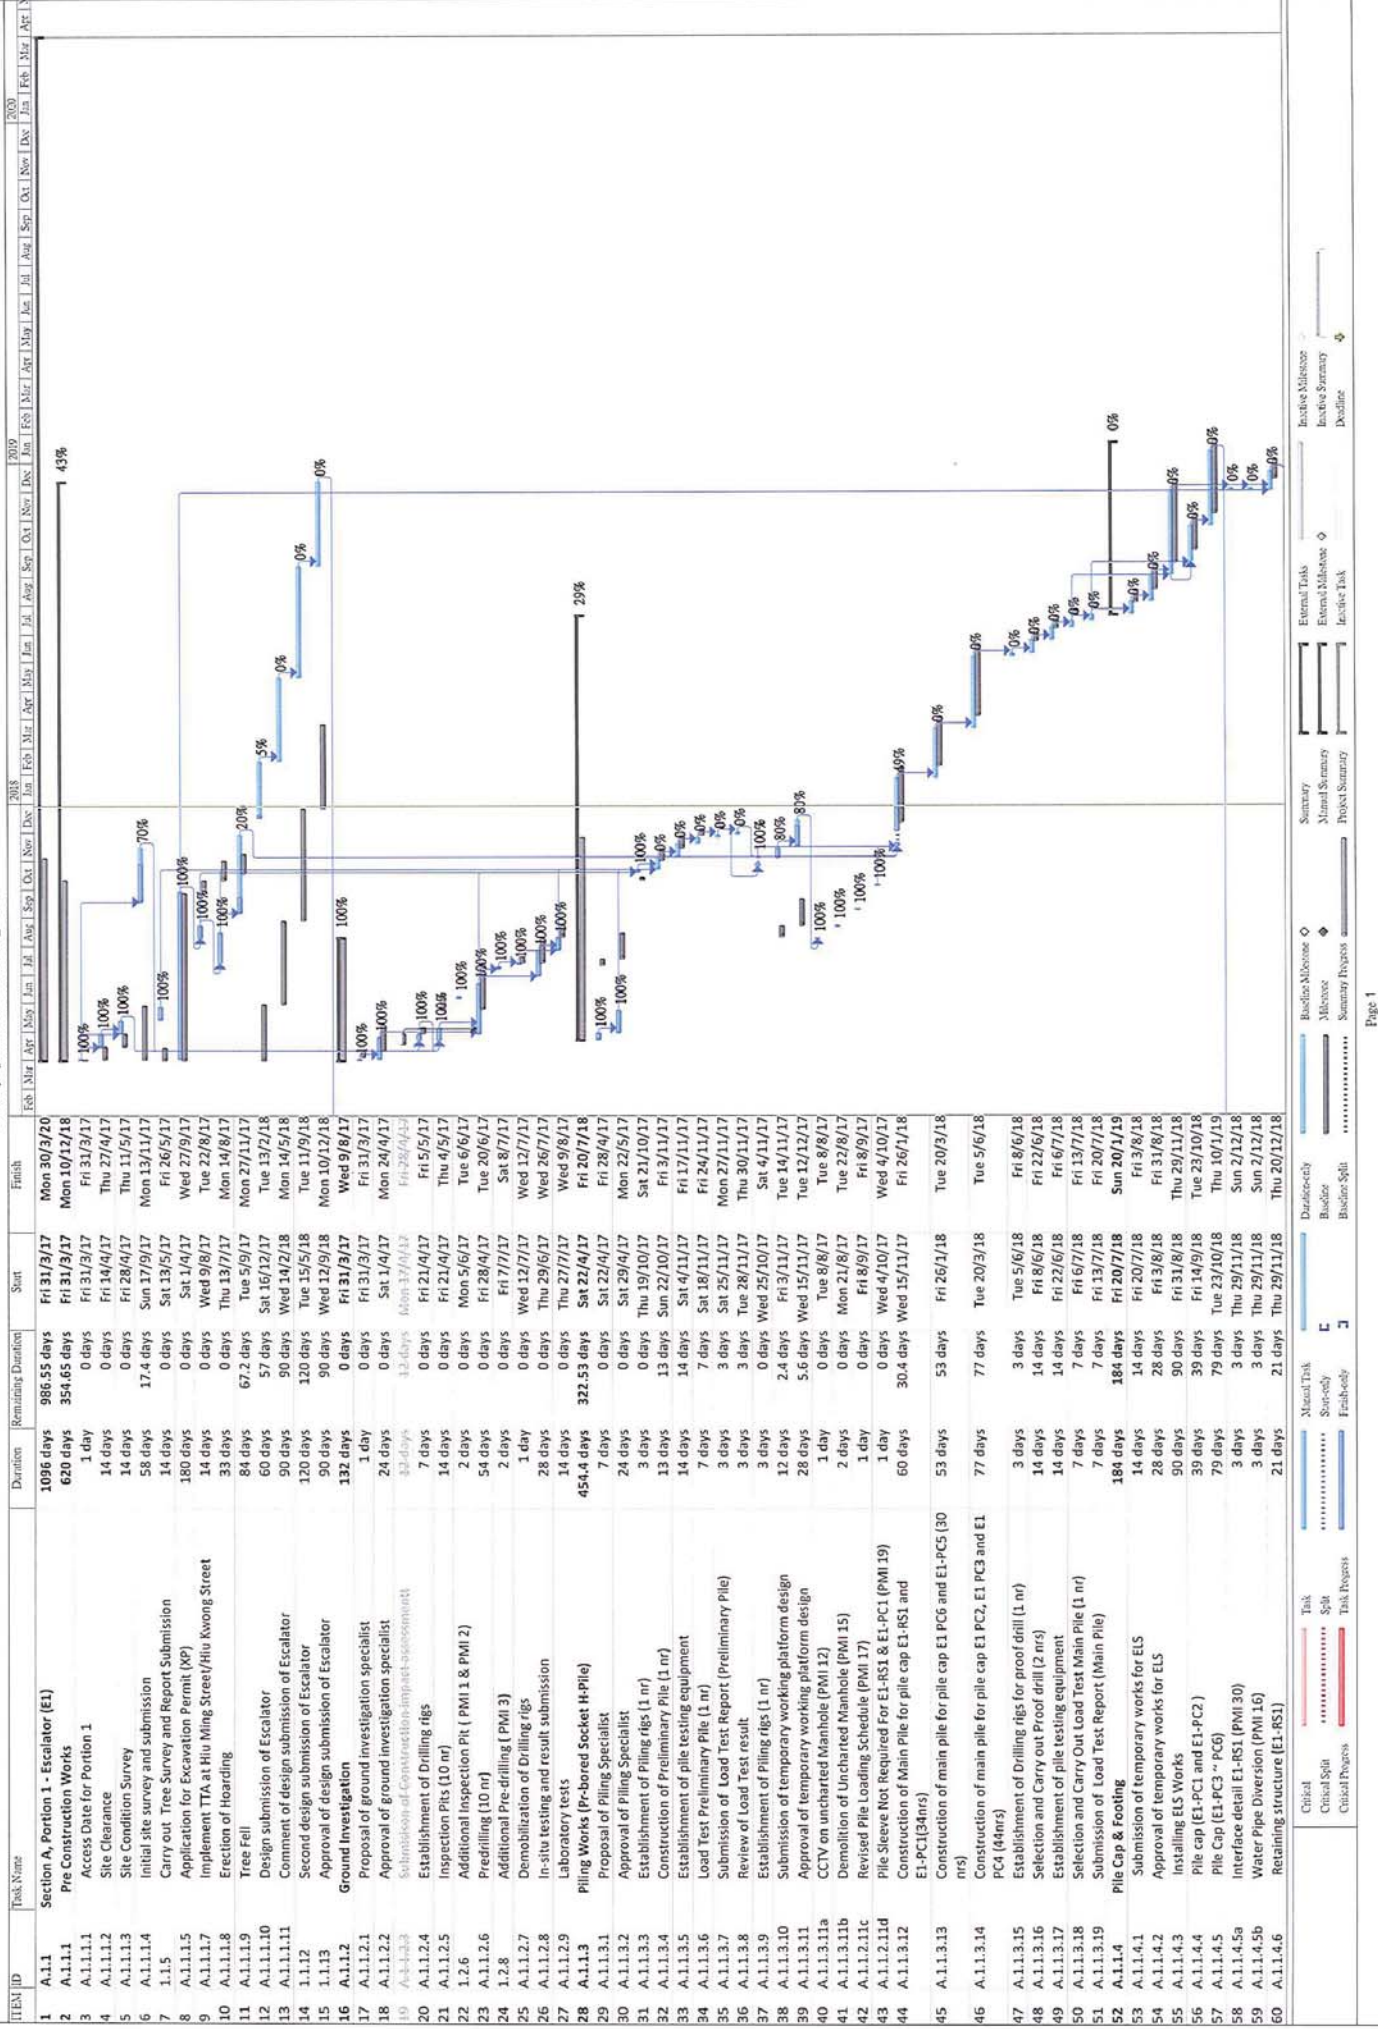

Revised programme for Section A-E1_Dn 17

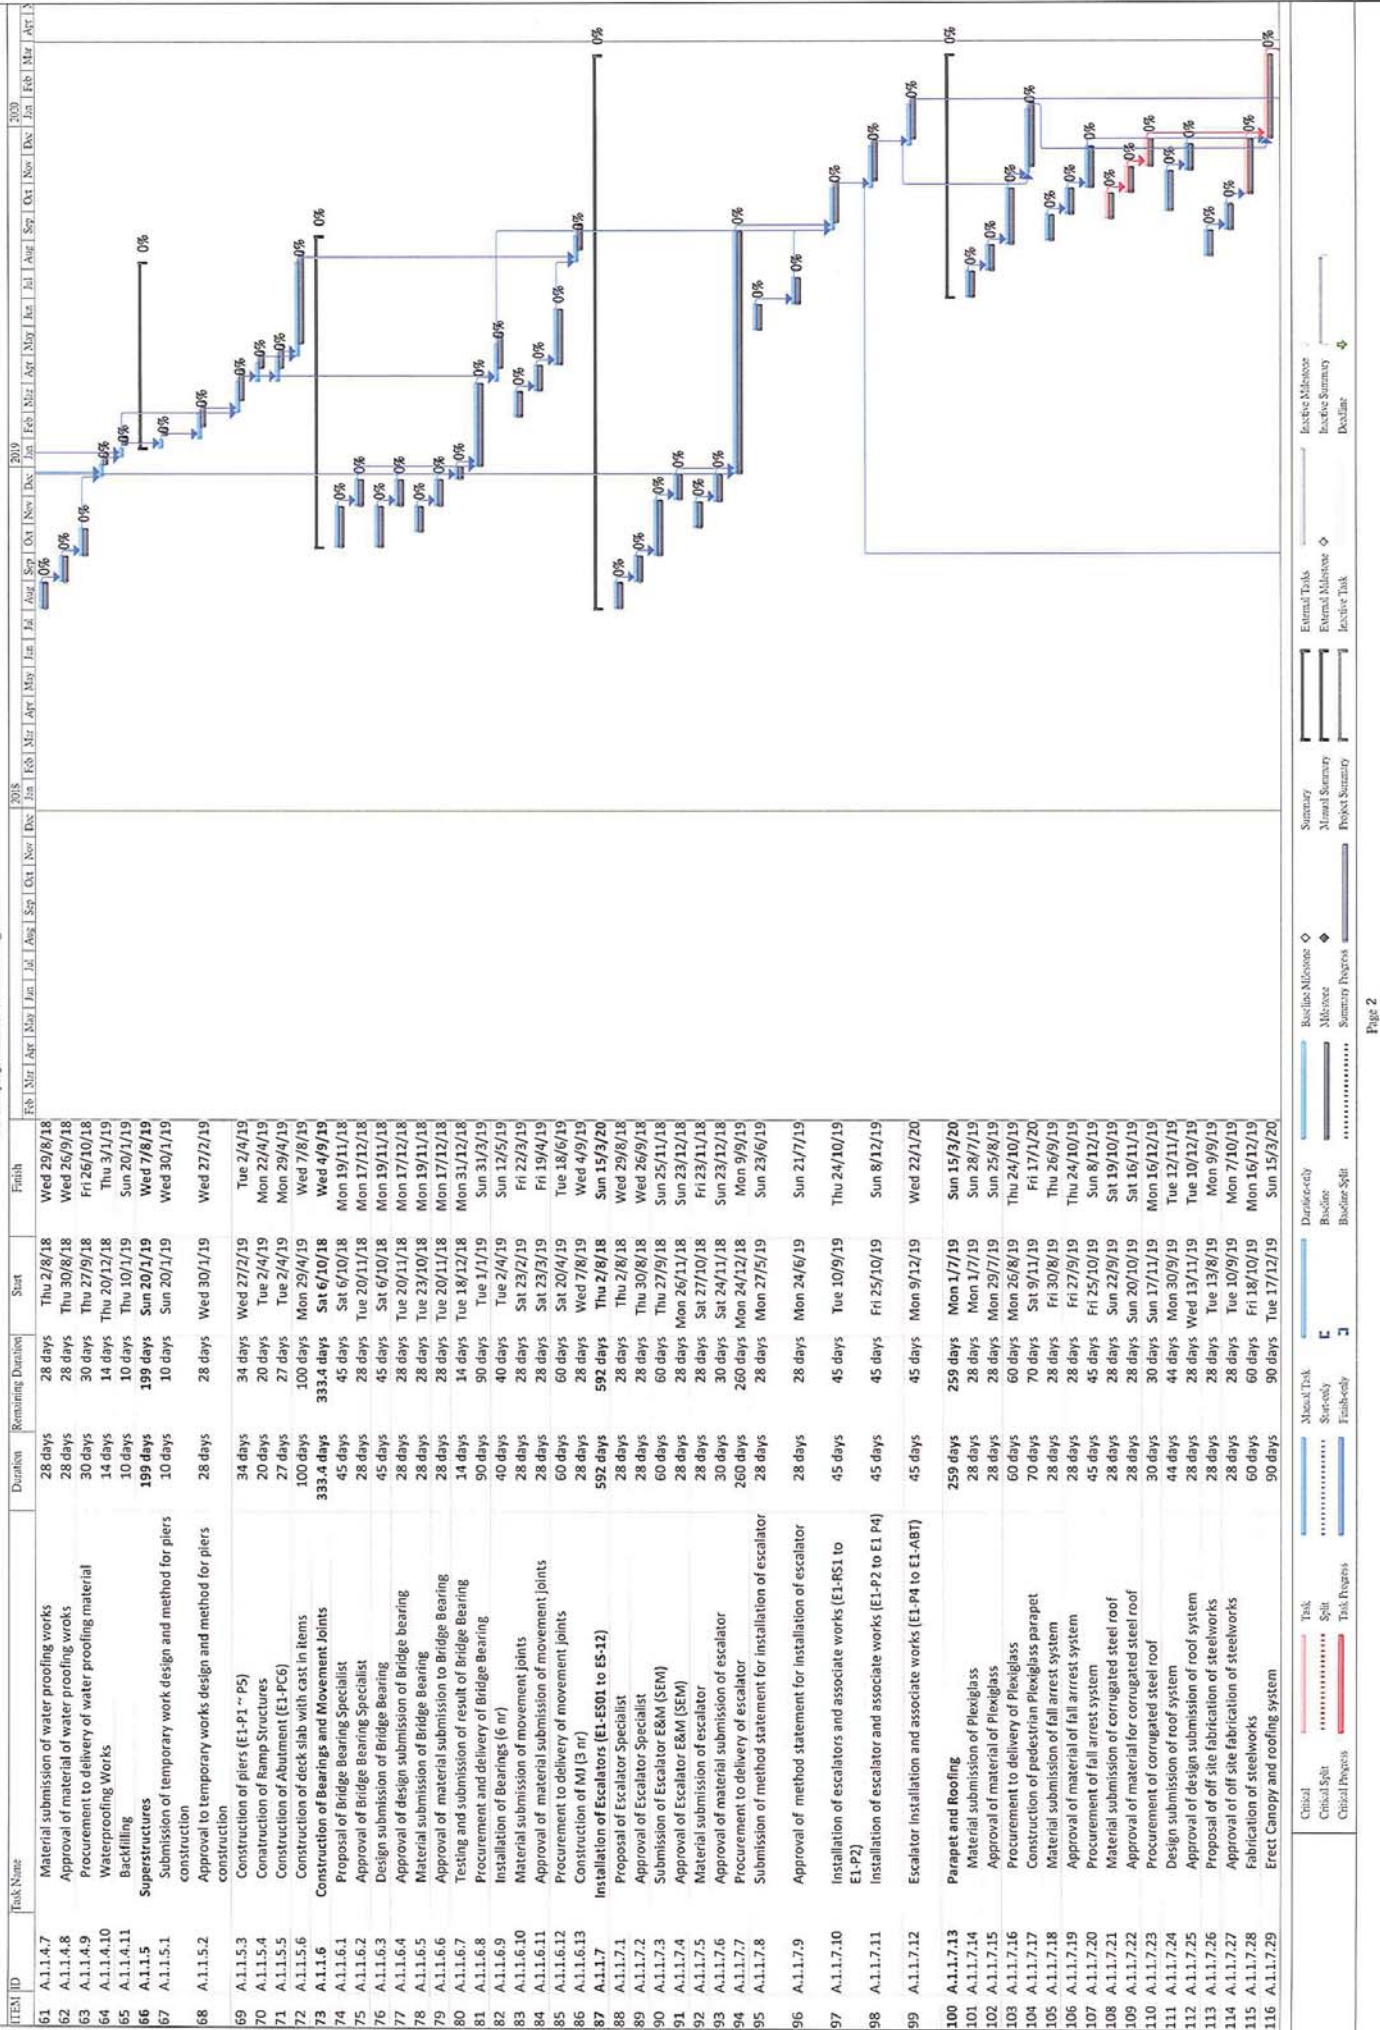

Task Name		Duration	Remaining Duration	Start	Finish	2018												2019												2020																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																										
Task Name		Duration	Remaining Duration	Start	Finish	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																															
117	A.1.1.7.30 Decking construction connecting to existing footpath	20 days	20 days	Tue 4/2/20	Sun 23/2/20																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			

Revised programme for Section A-E1 Dec 17

ITEM ID	Task Name	Duration	Remaining Duration	Start	Finish	2018	2019	2020
						Jan	Feb	Mar
173 A.1.1.12.6	Material submission of paint	14 days	14 days	Sun 8/9/19	Sat 21/9/19			
174 A.1.1.12.7	Comment of material submission of paint	14 days	14 days	Sun 22/9/19	Sat 5/10/19			
175 A.1.1.12.8	2nd submission of paints	14 days	14 days	Sun 6/10/19	Sat 19/10/19			
176 A.1.1.12.9	Approval of material submission of paints	14 days	14 days	Sun 20/10/19	Sat 2/11/19			
177 A.1.1.12.10	Procurement to delivery of paints	30 days	30 days	Sun 3/11/19	Mon 2/12/19			
178 A.1.1.12.11	Construction of Tactile/Ceramic/Concrete Tiles	30 days	30 days	Sat 19/10/19	Sun 17/11/19			
179 A.1.1.12.12	Texture Spray/Fungus Resistant Paint	80 days	80 days	Tue 3/12/19	Thu 20/2/20			
180 A.1.1.13	Construction of Sau Mau Ping Memorial Park	152 days	152 days	Wed 2/10/19	Sun 1/3/20			
181 A.1.1.13.1	Slope improvement work (LINE-D/CER222)	21 days	21 days	Tue 10/12/19	Mon 30/12/19			
182 A.1.1.13.2	Material submission of Pavillion	28 days	28 days	Wed 2/10/19	Tue 29/10/19			
183 A.1.1.13.3	Approval of material submission of Pavillion	28 days	28 days	Wed 30/10/19	Tue 26/11/19			
184 A.1.1.13.4	Procurement to delivery of Pavillion	45 days	45 days	Wed 27/11/19	Fri 10/1/20			
185 A.1.1.13.5	Material submission of Bench	28 days	28 days	Wed 2/10/19	Tue 29/10/19			
186 A.1.1.13.6	Approval to material submission of Bench	28 days	28 days	Wed 30/10/19	Tue 26/11/19			
187 A.1.1.13.7	Procurement to delivery of Bench	30 days	30 days	Wed 27/11/19	Thu 26/12/19			
188 A.1.1.13.8	Material submission of Pole Light	28 days	28 days	Wed 2/10/19	Tue 29/10/19			
189 A.1.1.13.9	Approval of material submission of Pole Light	28 days	28 days	Wed 30/10/19	Tue 26/11/19			
190 A.1.1.13.10	Procurement to delivery of Pole light	45 days	45 days	Wed 27/11/19	Fri 10/1/20			
191 A.1.1.13.11	Construction of Pavillion/Bench/Pole Light with ducting	21 days	21 days	Sat 11/1/20	Fri 31/1/20			
192 A.1.1.13.12	Construction of Pavers	30 days	30 days	Sat 1/2/20	Sun 1/3/20			
193 A.1.1.14	General Inspection and Tidy up of Portion 1	25 days	25 days	Fri 6/3/20	Mon 30/3/20			
194 A.1.1.14.1	General Inspection and tidy up of Portion 1	5 days	5 days	Mon 16/3/20	Fri 20/3/20			
195 A.1.1.14.2	Allowable Terminal Float	10 days	10 days	Sat 21/3/20	Mon 30/3/20			
196 A.1.1.14.3	Completion of works	0 days	0 days	Mon 30/3/20	Mon 30/3/20			

Critical

Critical Split

Critical Progress

Task

Split

Task Progress

Material Task

Start-only

Finish-only

Disturbance

Baseline

Baseline Split

Booklet Milestone

Milestone

Summary Progress

Summary

Material Summary

Project Summary

External Task

External Milestone

External Task

Inactive Milestone

Inactive Summary

Deadline

ID	Task Name	Duration	Remaining	Start	Finish	2018												2019																						
						Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Section A																																								
A.2.1	E3 and E2 Footbridge and lift Tower	1175 days	1039.17 days	Fri 13/12/17	Wed 17/6/20																																			
A.2.1.1	Access Date of Portion 2	1164 days	994.66 days	Fri 31/3/17	Sat 6/6/20																																			
A.2.1.1.1	Initial Site survey	1 day	0 days	Fri 31/3/17	Fri 31/3/17																																			
A.2.1.1.2	Initial Tree survey	60 days	3 days	Tue 17/10/17	Fri 15/12/17																																			
A.2.1.1.3	Design submission of lift	15 days	0.75 days	Sat 13/5/17	Wed 13/12/17																																			
A.2.1.1.4	Comment of design submission of lift	60 days	57 days	Sat 16/12/17	Tue 13/2/18																																			
A.2.1.1.5	Second design submission of lift	90 days	90 days	Wed 14/2/18	Mon 14/5/18																																			
A.2.1.1.5a	Approval of design submission of lift	120 days	90 days	Tue 15/5/18	Tue 11/9/18																																			
A.2.1.1.5b	Design submission of lighting at footbridge	90 days	90 days	Wed 12/9/18	Mon 10/12/18																																			
A.2.1.1.6	Approval of design submission of lighting for footbridge	41 days	41 days	Tue 2/7/19	Sun 11/8/19																																			
A.2.1.1.7	Proposal of Concrete Batching Plant and mixers	28 days	28 days	Mon 12/8/19	Sun 8/9/19																																			
A.2.1.1.8	Submission of shop drawing for irrigation system and submersible pump for the footbridge	90 days	90 days	Tue 3/10/17	Sun 31/12/17																																			
A.2.1.1.9	Acceptance of shop drawing for irrigation system and submersible pump system	60 days	60 days	Wed 1/5/19	Sat 29/6/19																																			
A.2.1.1.10		28 days	28 days	Sun 30/6/19	Sat 27/7/19																																			
A.2.1.1.11	Method Statement submission for excavation of rock for bridge tower E3-ST1 and approval	126 days	12.6 days	Wed 9/8/17	Tue 12/12/17																																			
A.2.1.1.12	Approval of method statement of excavation of rock	28 days	8.4 days	Wed 13/12/17	Tue 9/1/18																																			
A.2.1.1.13	Method Statement Submission for Installation and Temporary works design for concreting of bridge tower E3-ST1	72 days	72 days	Thu 5/10/17	Fri 15/12/17																																			
A.2.1.1.14	Approval of method statement of temporary works design for concreting of bridge tower of bridge tower E3-ST1	28 days	28 days	Sat 16/12/17	Fri 12/1/18																																			
A.2.1.1.15	Method Statement submission for installation of socket H piles including predrill location and Proof Drill location	52 days	5.2 days	Tue 28/11/17	Thu 18/1/18																																			
A.2.1.1.16	Approval of method statement for installation of socket H piles including predrill and proof drill location	28 days	2.8 days	Tue 28/11/17	Thu 1/2/18																																			
A.2.1.1.17	Submission of Method statement for testing of socket H piles	52 days	52 days	Mon 5/3/18	Wed 25/4/18																																			
A.2.1.1.18	Approval of method statement for testing of socket H piles	28 days	28 days	Thu 26/4/18	Wed 23/5/18																																			
A.2.1.1.19	Submission of construction impact assessment	14 days	14 days	Fri 16/2/18	Thu 1/3/18																																			
A.2.1.1.20	Submission of method statement for formwork design for casting the bridge piers footing and bridge piers	52 days	52 days	Mon 4/6/18	Wed 25/7/18																																			
A.2.1.1.21	Approval of method statement for formwork design for casting bridge piers footing and piers	28 days	28 days	Thu 26/7/18	Wed 22/8/18																																			
A.2.1.1.22	Design and Material Submission of proposed bridge bearings	52 days	52 days	Tue 24/7/18	Thu 13/9/18																																			
A.2.1.1.23	Approval of design and material of bridge bearing	28 days	28 days	Fri 14/9/18	Thu 11/10/18																																			
A.2.1.1.24	Testing and result submission of bridge bearing	15 days	15 days	Fri 12/10/18	Fri 26/10/18																																			
A.2.1.1.25	Procurement, ordering and delivery of bridge bearings	45 days	45 days	Sat 27/10/18	Mon 10/12/18																																			
A.2.1.1.26	Submission of method statement for erection of steel truss	52 days	52 days	Mon 10/9/18	Mon 30/10/18																																			
A.2.1.1.27	Approval of method statement for erection of steel truss	28 days	28 days	Thu 1/11/18	Wed 28/11/18																																			
A.2.1.1.28	Method Statement submission for proposed lift installation	80 days	80 days	Fri 9/3/18	Sun 27/5/18																																			
A.2.1.1.29	Material Submission of Proposed Lift	60 days	60 days	Mon 28/5/18	Thu 26/7/18																																			
A.2.1.1.30	Procurement, ordering & delivery of proposed lift	124 days	124 days	Tue 11/12/18	Sat 13/4/19																																			
A.2.1.1.31	Design and Material Submission of glazing and louvres	80 days	80 days	Fri 24/8/18	Sun 11/11/18																																			
A.2.1.1.32	Method Statement of glazing and louvre installation	80 days	80 days	Mon 12/11/18	Wed 30/1/19																																			
A.2.1.1.33	Procurement, ordering and delivery of louvres & glazing	60 days	60 days	Tue 31/1/19	Sun 31/3/19																																			
A.2.1.1.35	Approval of TTA to block FP of Hiu Ming St and Hiu Kwong Street for erection of Hoarding	76 days	0 days	Thu 20/7/17	Tue 3/10/17																																			
A.2.1.1.36	Road Works Advice	14 days	14 days	Wed 4/10/17	Tue 17/10/17																																			
A.2.1.1.37	Implementation of TTA	1 day	1 day	Wed 18/10/17	Wed 18/10/17																																			
A.2.1.1.38	Application of Excavation permit	180 days	0 days	Sat 1/4/17	Wed 27/9/17																																			
A.2.1.1.39	Erection of Hoardings for footbridge E3, E2	26 days	10.4 days	Sat 16/12/17	Wed 10/1/18																																			
A.2.1.1.40	Mobilisation of excavator for breaking of rock for escalator tower E3-ST1	14 days	12.6 days	Thu 11/1/18	Wed 24/1/18																																			
A.2.1.1.41	Breaking of 50% of rock for escalator tower E3-ST1	60 days	60 days	Thu 25/1/18	Sun 25/3/18																																			
A.2.1.1.42	Breaking of remaining 50% of rock for escalator tower E3-ST1	60 days	60 days	Mon 26/3/18	Thu 24/5/18																																			
A.2.1.1.43	Construction of E3-ST1 substructure E3-PC1	67 days	67 days	Fri 25/5/18	Mon 30/7/18																																			
A.2.1.1.44	Construction E3 superstructure E3-ST1 up to level 34mPD	45 days	45 days	Tue 31/7/18	Thu 13/9/18																																			
A.2.1.1.45	Construction of E3 superstructure E3-ST1 from 34mPD to 43.6mPD	45 days	45 days	Fri 14/9/18	Sun 28/10/18																																			
A.2.1.1.46	Infill the space with no fine concrete between rock slope and edge of E3-ST1	30 days	30 days	Mon 29/10/18	Tue 27/11/18																																			
A.2.1.1.47	Erect tubular platform for rock slope survey	10 days	10 days	Wed 28/11/18	Fri 7/12/18																																			

Critical

Critical Split

Summary Progress

Summary Task

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone

Summary Milestone


Summary Milestone

Summary Milestone

Revised programme for Section A E3 to E2 Dec 17

ID	Task Name	Duration	Remaining Duration	Start	Finish
A.2.1.1.48	Rock slope survey	20 days	20 days	Sat 8/12/18	Thu 27/12/18
A.2.1.1.49	Rock slope stabilization works to be instructed	30 days	30 days	Sat 26/1/19	Sat 26/1/19
A.2.1.1.50	Construction of E3 Superstructure E3-ST1 from 43.6mPD to 59.7mPD	70 days	70 days	Wed 28/11/18	Tue 5/2/19
A.2.1.1.51	Construction of E3 Superstructure E3-ST1 from 59.7mPD to 71.2mPD	80 days	80 days	Wed 6/2/19	Fri 26/4/19
A.2.1.1.52	Installation of bridge bearing	7 days	7 days	Sat 20/4/19	Fri 26/4/19
A.2.1.1.53	Installation of lift (3mrs)	90 days	90 days	Sat 27/4/19	Thu 25/7/19
A.2.1.1.54	Design of glazing and tower	28 days	28 days	Sat 12/1/19	Fri 8/2/19
A.2.1.1.55	Approval of design for glazing and tower	28 days	28 days	Sat 9/2/19	Fri 8/3/19
A.2.1.1.56	Procurement to delivery of glazing and tower	60 days	60 days	Sat 9/3/19	Tue 7/5/19
A.2.1.1.57	Installation of glazing and tower	90 days	90 days	Fri 26/7/19	Wed 23/10/19
A.2.1.1.58	Application of telecommunications lines	100 days	100 days	Fri 29/3/19	Sat 6/7/19
A.2.1.1.59	Installation of E&M for the lift towers	90 days	90 days	Tue 24/9/19	Sun 22/12/19
A.2.1.1.60	Positioning, construction, installation and connection of pillar box	90 days	90 days	Mon 23/12/19	Sat 21/3/20
A.2.1.1.61	Application and connection of power supply	90 days	90 days	Mon 10/6/19	Sat 7/9/19
A.2.1.1.62	Testing and commissioning of lifts and submission of form IES to EMSD	75 days	75 days	Sun 22/3/20	Thu 4/6/20
A.2.1.1.63	Decoration and Finishings works for E3-ST1	90 days	90 days	Sun 8/9/19	Fri 6/12/19
A.2.1.1.64	Application of XP for Drainage works at Hiu Ming Street	90 days	90 days	Wed 25/9/19	Mon 23/12/19
A.2.1.1.65	Approval of TTA for construction of Drainage works at Hiu Ming Street	60 days	60 days	Wed 25/9/19	Sat 23/11/19
A.2.1.1.66	Road Works Advice	14 days	14 days	Sun 24/11/19	Sat 7/12/19
A.2.1.1.67	Implementation of TTA	1 day	1 day	Sun 8/12/19	Sun 8/12/19
A.2.1.1.68	Drainage works at Hiu Ming Street	75 days	75 days	Tue 24/12/19	Sat 7/3/20
A.2.1.1.69	General tidy up	2 days	2 days	Fri 5/6/20	Sat 6/6/20
A.2.1.2	Pile Cap E3-PC3 and E3 Abutment	392 days	379.8 days	Thu 9/11/17	Wed 5/12/18
A.2.1.2.1	Set up tubular platform for removal of soil nails at Slope E3b	7 days	7 days	Fri 16/2/18	Thu 22/2/18
A.2.1.2.2	Removal of soil nails (19mrs) at slope E3b	10 days	10 days	Fri 23/2/18	Sun 4/3/18
A.2.1.2.3	Removal of tubular platform	3 days	3 days	Mon 5/3/18	Wed 7/3/18
A.2.1.2.4	Mobilisation of plants for predrilling for pile cap E3-PC3	2 days	2 days	Fri 3/3/18	Thu 1/3/18
A.2.1.2.5	Setting up of plants for predrill for pile cap E3-PC3	0 days	0 days	Thu 9/11/17	Fri 10/11/17
A.2.1.2.6	Predrill for pile cap E3-PC3	6 days	6 days	Fri 10/11/17	Wed 15/11/17
A.2.1.2.7	Mobilisation of plants for drilling for installation of pre-bored socket H piles (9 mrs) for pile cap E3-PC3	4 days	4 days	Thu 16/11/17	Sun 19/11/17
A.2.1.2.8	Drilling and installation of pre-bored socket H piles (9 mrs) for pile cap E3-PC3	45 days	45 days	Fri 2/12/18	Sun 18/3/18
A.2.1.2.9	Testing of piles	45 days	45 days	Thu 24/5/18	Sat 7/7/18
A.2.1.2.10	Proof Drilling	9 days	9 days	Sun 8/7/18	Mon 16/7/18
A.2.1.2.11	Excavation with temporary shoring for pile cap E3-PC3	21 days	21 days	Tue 17/7/18	Mon 6/8/18
A.2.1.2.12	Construction of Pile caps E3-PC3	45 days	45 days	Thu 23/8/18	Sat 6/10/18
A.2.1.2.13	Construction of E3 Abutment	60 days	60 days	Sun 7/10/18	Wed 5/12/18
A.2.1.3	Substructure of Covered Walkway	122 days	122 days	Wed 14/2/18	Fri 15/6/18
A.2.1.3.1	Excavation of footing of covered walkway footing	52 days	52 days	Wed 14/2/18	Fri 6/4/18
A.2.1.3.2	Construction of footing of covered walkway footing	60 days	60 days	Sat 7/4/18	Tue 5/6/18
A.2.1.3.3	Backfill the footing of the covered walkway	10 days	10 days	Wed 6/6/18	Fri 15/6/18
A.2.1.4	Pile Cap E3-PC2 and column	266 days	266 days	Thu 16/11/17	Wed 8/8/18
A.2.1.4.1	Mobilisation of plants for predrilling for pile cap E3-PC2	7 days	7 days	Thu 16/11/17	Wed 22/11/17
A.2.1.4.2	Setting up of plants for predrill for pile cap E3-PC2	7 days	7 days	Thu 23/11/17	Wed 29/11/17
A.2.1.4.3	Predrill for pile cap E3-PC2	9 days	9 days	Thu 30/11/17	Fri 8/12/17
A.2.1.4.4	Demobilisation of predrill rig	1 day	1 day	Sat 9/12/17	Sat 9/12/17
A.2.1.4.5	Site clearance for soil nails for zone 1	5 days	5 days	Thu 16/11/17	Mon 20/11/17
A.2.1.4.6	Erection of tubular scaffold platform for soil nails for zone 1	10 days	10 days	Tue 21/11/17	Thu 30/11/17
A.2.1.4.7	Setting out of soil nails	2 days	2 days	Fri 1/12/17	Sat 2/12/17
A.2.1.4.8	Construction of soil nails (20mrs)	21 days	21 days	Sun 3/12/17	Sat 23/12/17
A.2.1.4.9	Construction of soil nails heads (29mrs)	14 days	14 days	Sun 24/12/17	Sat 6/1/18
A.2.1.4.10	Removal of tubular scaffold platform	7 days	7 days	Sun 7/1/18	Sat 13/1/18
A.2.1.4.11	Site clearance for soil nails for zone 2	5 days	5 days	Sun 14/1/18	Thu 18/1/18
A.2.1.4.12	Erection of tubular scaffold platform for soil nails for zone 2	7 days	7 days	Fri 19/1/18	Thu 25/1/18

Summary
Project Summary
Summary Progress
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary
Summary

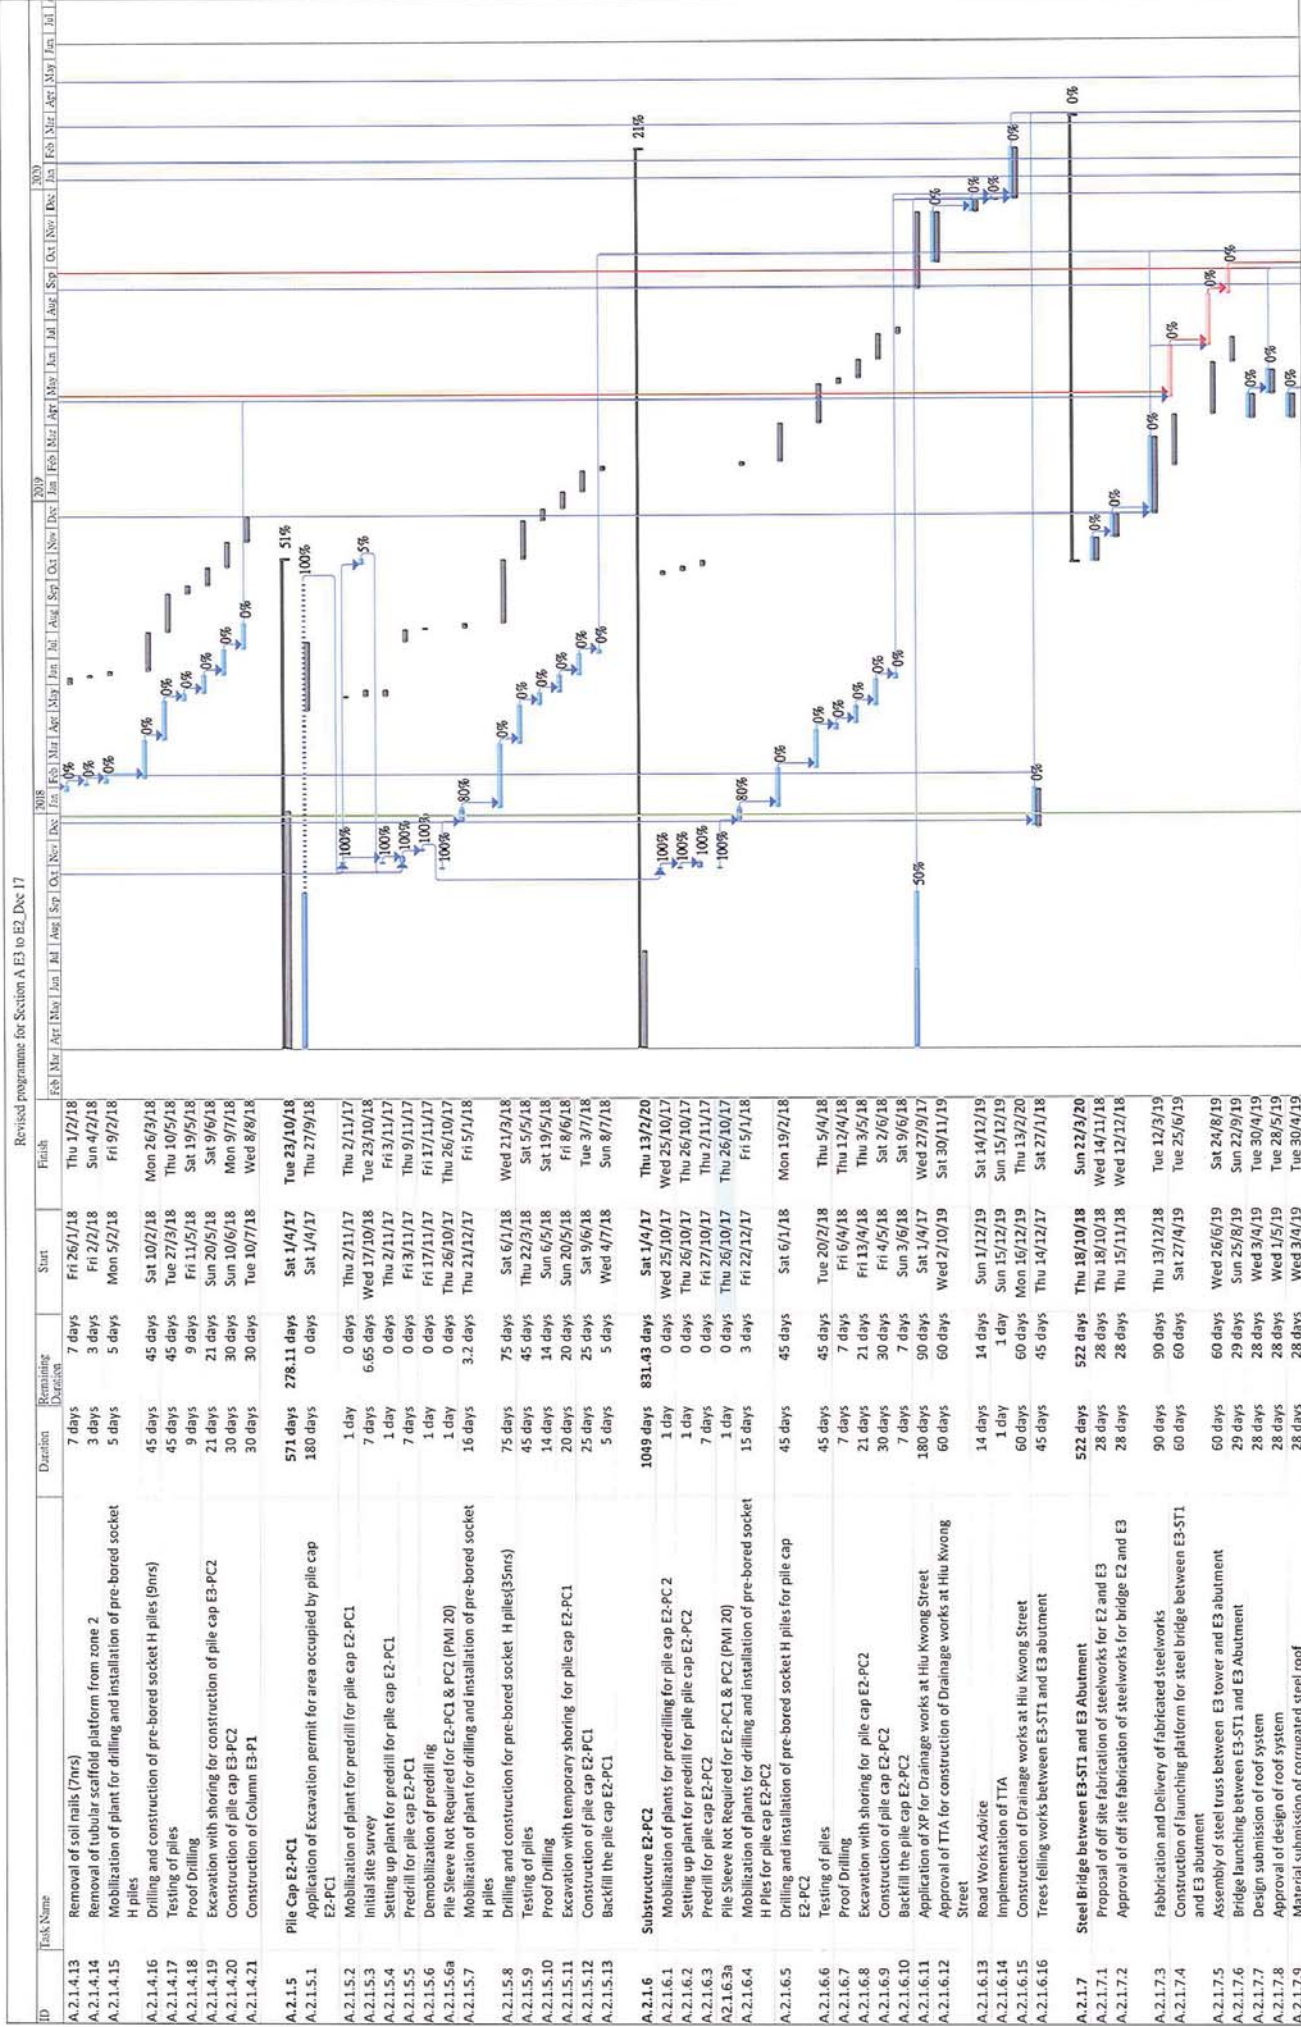

Revised programme for Section A E3 to E2 Dec 17


ID	Task Name	Duration	Remaining Duration	Start	Finish	2018	2019	2020
A.3.1.11.20	Electrical installation and lighting works for bridge from E2-LT1 to E2-P3	42 days	42 days	Mon 4/5/20	Sun 14/6/20	Jan	Feb	Mar
A.3.1.11.21	Tubular handrail and planter on bridge from E2-LT1 to E2-P3	20 days	20 days	Tue 26/5/20	Sun 14/6/20	Apr	May	Jun
A.3.1.11.22	Trenching works for connection of existing water connection point	25 days	25 days	Sat 2/5/20	Tue 26/5/20	Jul	Aug	Sep
A.3.1.11.23	Water meter box and water point construction	5 days	5 days	Wed 27/5/20	Sun 31/5/20	Oct	Nov	Dec
A.3.1.11.24	Planting works on bridge	2 days	2 days	Mon 15/6/20	Tue 16/6/20	Jan	Feb	Mar
A.3.1.11.25	General tidy up for Portion 3	1 day	1 day	Wed 17/6/20	Wed 17/6/20	Apr	May	Jun
A.3.1.11.26	Overall landscape works	150 days	150 days	Mon 2/9/19	Wed 29/1/20	Jul	Aug	Sep
A.3.1.11.27	Completion of works	0 days	0 days	Mon 30/3/20	Mon 30/3/20	Oct	Nov	Dec


Revised programme for Section B_Dec 17


ID	Task Name	Duration	Remaining Duration	Start	Finish	Predecessors
B.4.1	SECTION B - CONSTRUCTION OF SLIP ROAD	406 days	127.14 days	Fri 31/3/17	Thu 10/5/18	
B.4.1.1	PRE CONSTRUCTION WORKS	292 days	29.97 days	Fri 31/3/17	Tue 16/4/18	
B.4.1.1.1	Access Date of Portion 4	1 day	0 days	Fri 31/3/17	Fri 31/3/17	
B.4.1.1.2	Application of Excavation Permit	180 days	18 days	Sat 1/4/17	Wed 27/9/17	
B.4.1.1.3	Application of TTA and approval	88 days	0 days	Sat 1/4/17	Tue 27/6/17	
B.4.1.1.4	Road works advice	14 days	0 days	Wed 26/7/17	Tue 8/8/17	
B.4.1.1.5	Implementation of TTA for ingress and egress	1 day	0 days	Wed 9/8/17	Wed 9/8/17	
B.4.1.1.6	Proposal of landscape specialist	1 day	0 days	Fri 31/3/17	Fri 31/3/17 3FS-1 day	
B.4.1.1.7	Approval to proposal of landscape specialist	26 days	0 days	Sat 1/4/17	Wed 26/4/17	
B.4.1.1.10	Trees survey	10 days	0 days	Wed 26/4/17	Fri 5/5/17	
B.4.1.1.11	Trees Transplant	63 days	0 days	Fri 14/7/17	Thu 14/9/17 10,6FF,7	
B.4.1.1.11a	Landscaping Works (PMI 9)	180 days	36 days	Fri 21/7/17	Tue 16/1/18	
B.4.1.1.12	Submission of material for drainage works	13 days	0 days	Fri 31/3/17	Wed 12/4/17	
B.4.1.1.13	Approval of submission for drainage works	30 days	0 days	Thu 13/4/17	Fri 12/5/17 13	
B.4.1.1.16	Procurement and delivery of drainage pipes and material	115 days	0 days	Sat 27/5/17	Mon 18/9/17 14	
1.1.14	Material Test for Drainage Pipe (PMI 21)	21 days	0 days	Sat 4/11/17	Fri 24/11/17	
B.4.1.1.17	Submission of method statement for Drainage works	28 days	0 days	Thu 21/9/17	Wed 18/10/17	
B.4.1.1.18	Approval of method statement for drainage works	28 days	28 days	Thu 19/10/17	Wed 15/11/17 17	
B.4.1.2	First Stage Works	206 days	124.1 days	Mon 17/7/17	Wed 7/2/18	
B.4.1.2.1	Utilities Detection	1 day	0 days	Mon 17/7/17	Mon 17/7/17	
B.4.1.2.2	Survey of existing drainage	2 days	0 days	Tue 7/11/17	Wed 8/11/17	
B.4.1.2.3	Initial site survey	31 days	1.55 days	Sun 17/9/17	Sun 12/11/17 21,20	
B.4.1.2.4	Drainage works at first stage	45 days	9 days	Sat 7/10/17	Thu 21/12/17 11,15,22,18	
B.4.1.2.4a	Revised Drainage Works (PMI 26)	14 days	13.95 days	Thu 9/11/17	Thu 4/1/18 23	
B.4.1.2.5	Draw pits construction	15 days	15 days	Thu 7/12/17	Thu 21/12/17 23FS-15 days	
B.4.1.2.6	Laying street lighting cables	2 days	2 days	Fri 22/12/17	Sat 23/12/17 23,25	
B.4.1.2.6a	Revised Setting Out and Vertical Road Profile (PMI 25)	1 day	0 days	Thu 9/11/17	Thu 9/11/17	
B.4.1.2.7	Road works	46 days	43.7 days	Sun 24/12/17	Wed 7/2/18 27	
B.4.1.2.8	Construct Temporary road before implementation of road closure	27 days	25.65 days	Fri 12/1/18	Wed 7/2/18 28FS-27 days	
B.4.1.3	Second Stage Works	238 days	202.41 days	Fri 15/9/17	Thu 10/5/18	
B.4.1.3.1	Application of TTA to divert traffic of existing slip road	60 days	30 days	Fri 15/9/17	Mon 13/11/17	
B.4.1.3.2	Road Works advice	14 days	14 days	Tue 14/11/17	Mon 27/11/17 31	
B.4.1.3.3	Implementation of TTA to divert traffic to Temp slip road	1 day	1 day	Thu 8/2/18	Thu 8/2/18 32,29	
B.4.1.3.4	Utilities detection and Suirvey of existing drainage	2 days	2 days	Thu 8/2/18	Fri 9/2/18 32,33FS-1 day	
B.4.1.3.5	Initial site survey	2 days	0 days	Sun 17/9/17	Wed 10/1/18 34	
B.4.1.3.6	Drainage works at entrance of existing slip road (D101+ others)	45 days	45 days	Thu 11/1/18	Sat 24/2/18 35,4	
B.4.1.3.7	Draw pits construction	15 days	15 days	Sat 10/2/18	Sat 24/2/18 36FS-15 days	
B.4.1.3.8	Laying street lighting cables	9 days	9 days	Sun 25/2/18	Mon 5/3/18 37	
B.4.1.3.9	Road works	40 days	40 days	Tue 6/3/18	Sat 14/4/18 38	
B.4.1.3.10	Remaining clash barriers and road markings	10 days	10 days	Sun 15/4/18	Tue 24/4/18 39	
B.4.1.3.11	Reinstate works area	15 days	15 days	Wed 25/4/18	Wed 9/5/18 40	
B.4.1.3.12	General tidy up	1 day	1 day	Thu 10/5/18	Thu 10/5/18 41	
B.4.1.3.13	Completion of works	0 days	0 days	Sat 31/3/18	Sat 31/3/18 42	





ITEM ID	Task Name	Duration	Remaining Duration	Short	Finish
1	SECTION C - CONSTRUCTION OF BUS BUS INTERCHANGE	863.75 days	520.28 days	Fri 31/3/17	Sun 11/8/19
2	Works not within TKOT carriageway	863.75 days	520.28 days	Fri 31/3/17	Sun 11/8/19
3	Access Date of Portion 5	1 day	0 days	Fri 31/3/17	Fri 31/3/17
4	Initial Site Survey	197 days	9.85 days	Fri 5/5/17	Fri 17/11/17
5	Tree survey	220 days	11 days	Sat 22/4/17	Mon 27/11/17
6	Proposal of structural steel erectors	28 days	28 days	Sat 18/11/17	Fri 15/12/17
7	Approval of structural steel erectors	28 days	28 days	Sat 16/12/17	Fri 12/1/18
8	Submission of method statement of construction of covered walkway	35 days	17.5 days	Wed 13/12/17	Tue 30/1/18
9	Approval of method statement of construction of covered walkway	35 days	24.5 days	Thu 14/12/17	Fri 23/2/18
10	Submission of offsite fabrication of steel for covered walkway	60 days	60 days	Sat 24/2/18	Tue 24/4/18
11	Approval of proposal offsite fabrication of covered walkway	35 days	35 days	Wed 25/4/18	Tue 29/5/18
12	Fabrication of covered walkway	100 days	100 days	Wed 30/5/18	Thu 6/9/18
13	Application of XP	180 days	0 days	Sat 1/4/17	Wed 27/9/17
14	Application of TTA for loading and unloading area	88 days	0 days	Sat 1/4/17	Tue 27/6/17
15	Road works advice	14 days	0 days	Wed 28/6/17	Tue 11/7/17
16	Implementation of TTA	1 day	0 days	Wed 9/8/17	Wed 9/8/17
17	Tree Fellings	131 days	19.65 days	Tue 19/9/17	Thu 1/3/18
18	Landscaping Works (PMI 9)	180 days	36 days	Fri 21/7/17	Tue 16/1/18
19	Utilities detection	1 day	0 days	Fri 15/9/17	Fri 15/9/17
20	Excavation of inspection pit for locating existing utilities	17 days	0 days	Mon 23/10/17	Fri 24/11/17
21	Excavation of inspection pit for locating existing TCS (PMI 32)	14 days	0 days	Tue 5/12/17	Mon 18/12/17
22	Arrangement with UU companies for diversion of UU	30 days	30 days	Thu 1/3/18	Sat 31/3/18
23	Diversion of utilities	123 days	123 days	Sat 31/3/18	Wed 1/8/18
24	Construction of footing of covered walkway	63 days	63 days	Wed 1/8/18	Wed 3/10/18
25	Revised Drainage Works at Portion 4 & 5 (PMI 26)	1 day	0 days	Thu 9/11/17	Thu 9/11/17
26	Drainage works D201 to D207 above the footing	60 days	60 days	Thu 13/9/18	Mon 12/11/18
27	Material submission of Pillar box c/w accessories	28 days	28 days	Fri 27/10/17	Thu 23/11/17
28	Approval of material submission of Pillar box c/w accessories	28 days	28 days	Fri 24/11/17	Thu 21/12/17
29	Procurement to delivery of pillar box and accessories	30 days	30 days	Fri 22/12/17	Sat 20/1/18
30	Positioning and construction of pillar box	150 days	150 days	Mon 11/9/17	Wed 7/2/18
31	Application of Power Supply	90 days	90 days	Thu 8/2/18	Tue 8/5/18
32	Construct draw pits	20 days	20 days	Tue 23/10/18	Mon 12/11/18
33	Laying of TCS cables by others	30 days	30 days	Tue 23/10/18	Thu 22/11/18
34	Laying of cables for lighting	30 days	30 days	Wed 7/11/18	Fri 7/12/18
35	Construction of new high mast lighting and other lightings	90 days	90 days	Fri 7/12/18	Thu 7/3/19
36	Installation of posts and beams for covered walkway	60 days	60 days	Thu 7/3/19	Mon 6/5/19
37	Installation of glass cover for covered walkway	60 days	60 days	Sat 6/4/19	Wed 5/6/19
38	Material submission of fittings and lighting for covered walkway	28 days	28 days	Sat 22/9/18	Fri 19/10/18
39	Approval of fitting and lightings for covered walkway	28 days	28 days	Sat 20/10/18	Fri 16/11/18
40	Procurement to delivery of lightings	30 days	30 days	Sat 17/11/18	Sun 16/12/18
41	Installation of lighting of covered walkway	28 days	28 days	Wed 5/6/19	Wed 3/7/19
42	Connection of power supply to lightings	1 day	1 day	Wed 3/7/19	Thu 4/7/19
43	Testing and commissioning of electrical works	7 days	7 days	Thu 4/7/19	Thu 11/7/19
44	Material submission of paver blocks	28 days	28 days	Wed 10/10/18	Tue 6/11/18
45	Approval to submission of paver blocks	28 days	28 days	Wed 7/11/18	Tue 4/12/18
46	Procurement to delivery of paver blocks	30 days	30 days	Wed 5/12/18	Thu 3/1/19
47	Construction of paving blocks for covered walkway	37 days	37 days	Wed 3/7/19	Fri 9/8/19
48	General tidy up	2 days	2 days	Fri 9/8/19	Sun 11/8/19
49	Completion of Works	1 day	1 day	Sat 10/8/19	Sun 11/8/19



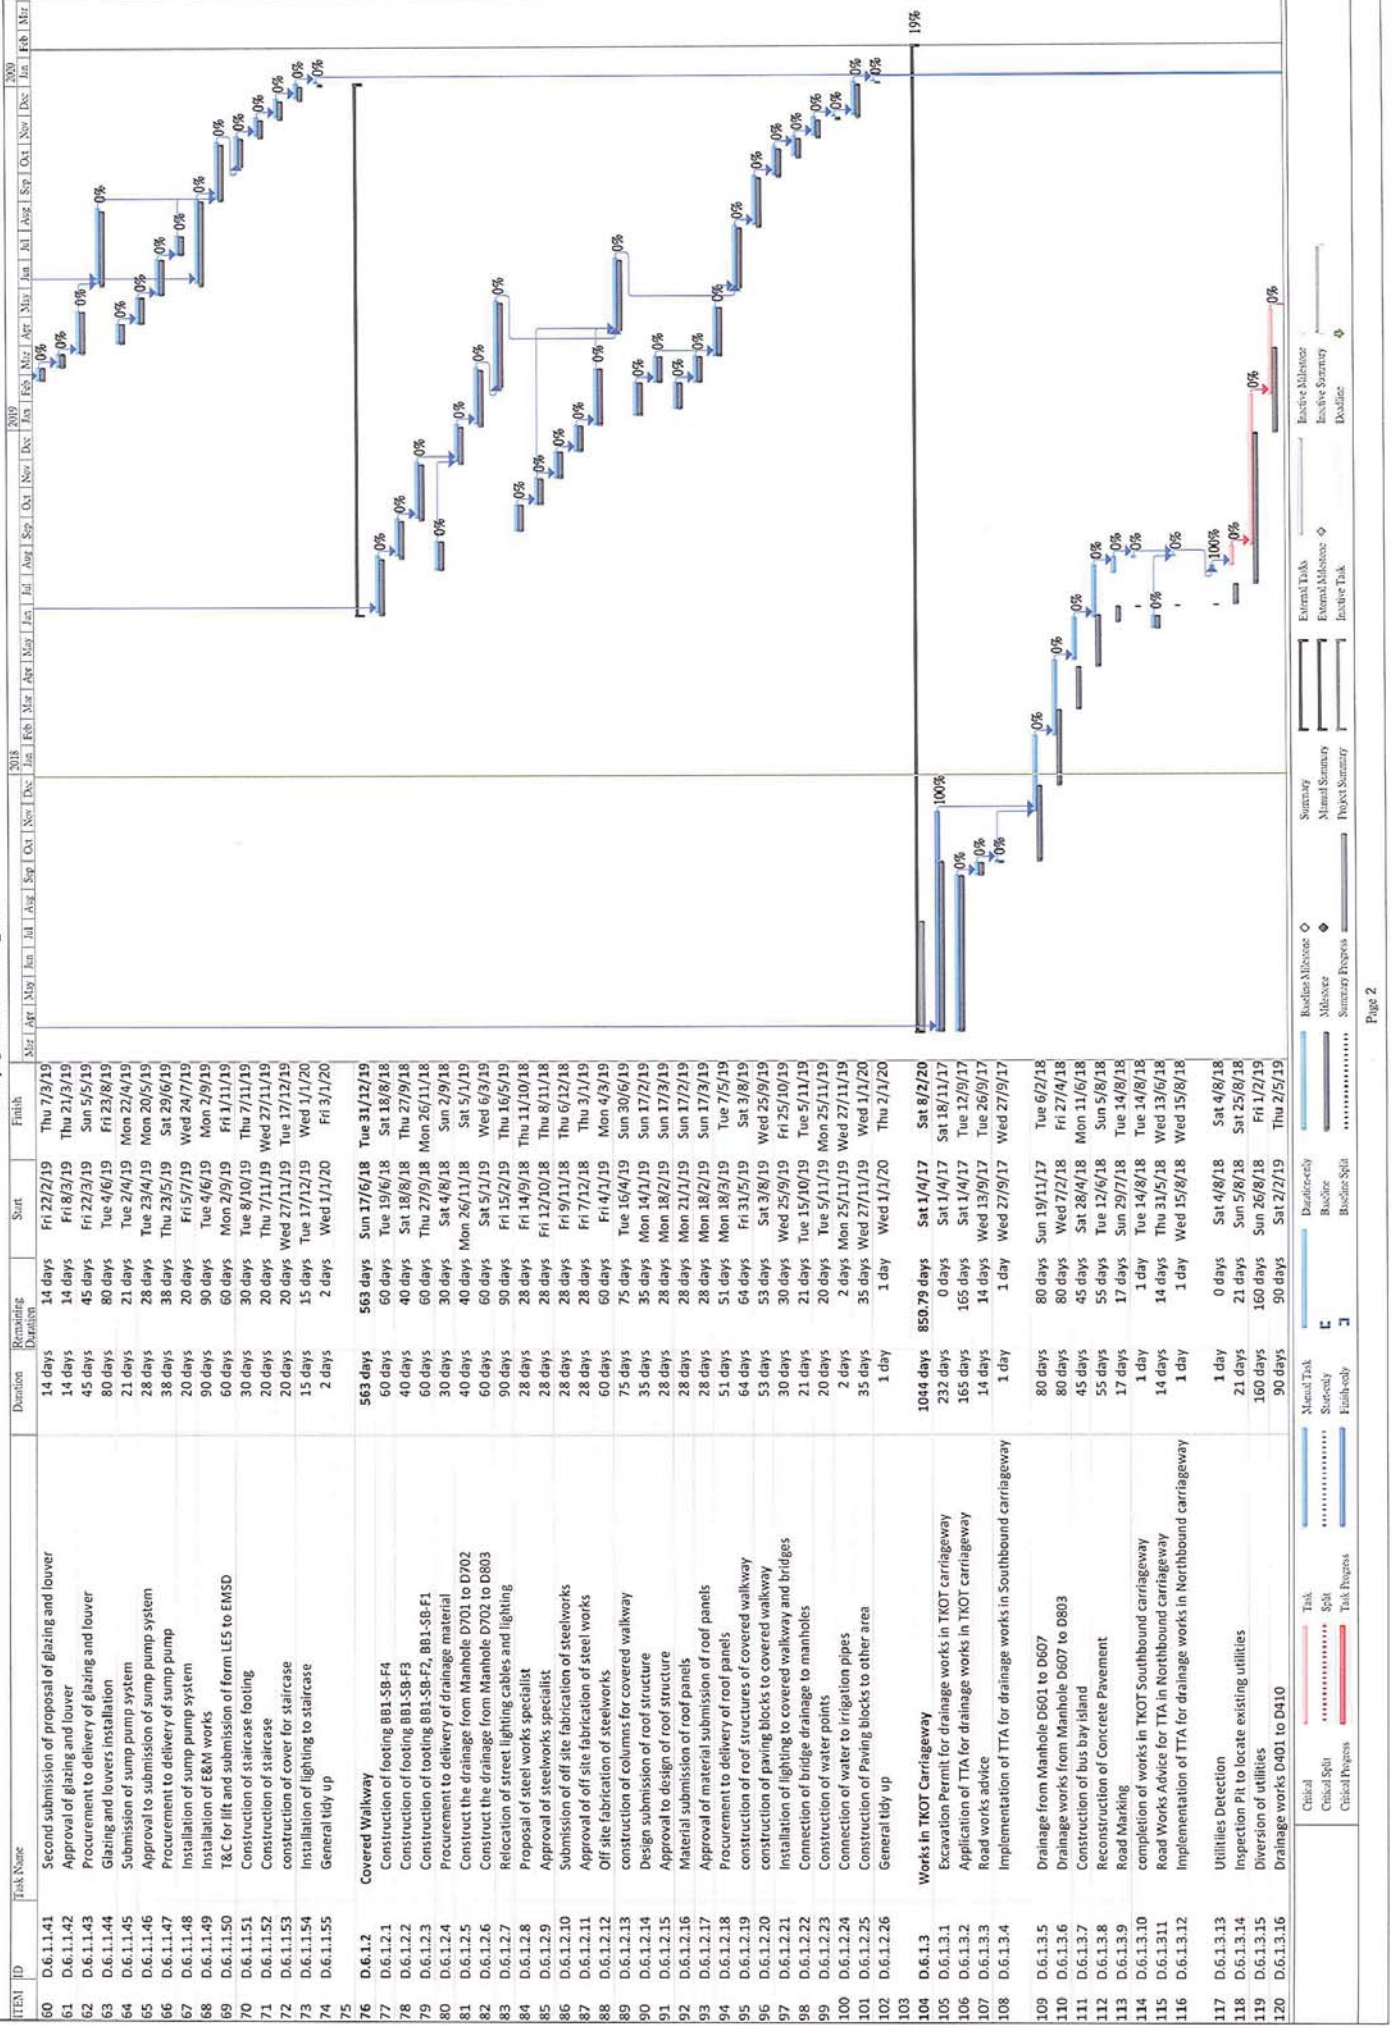

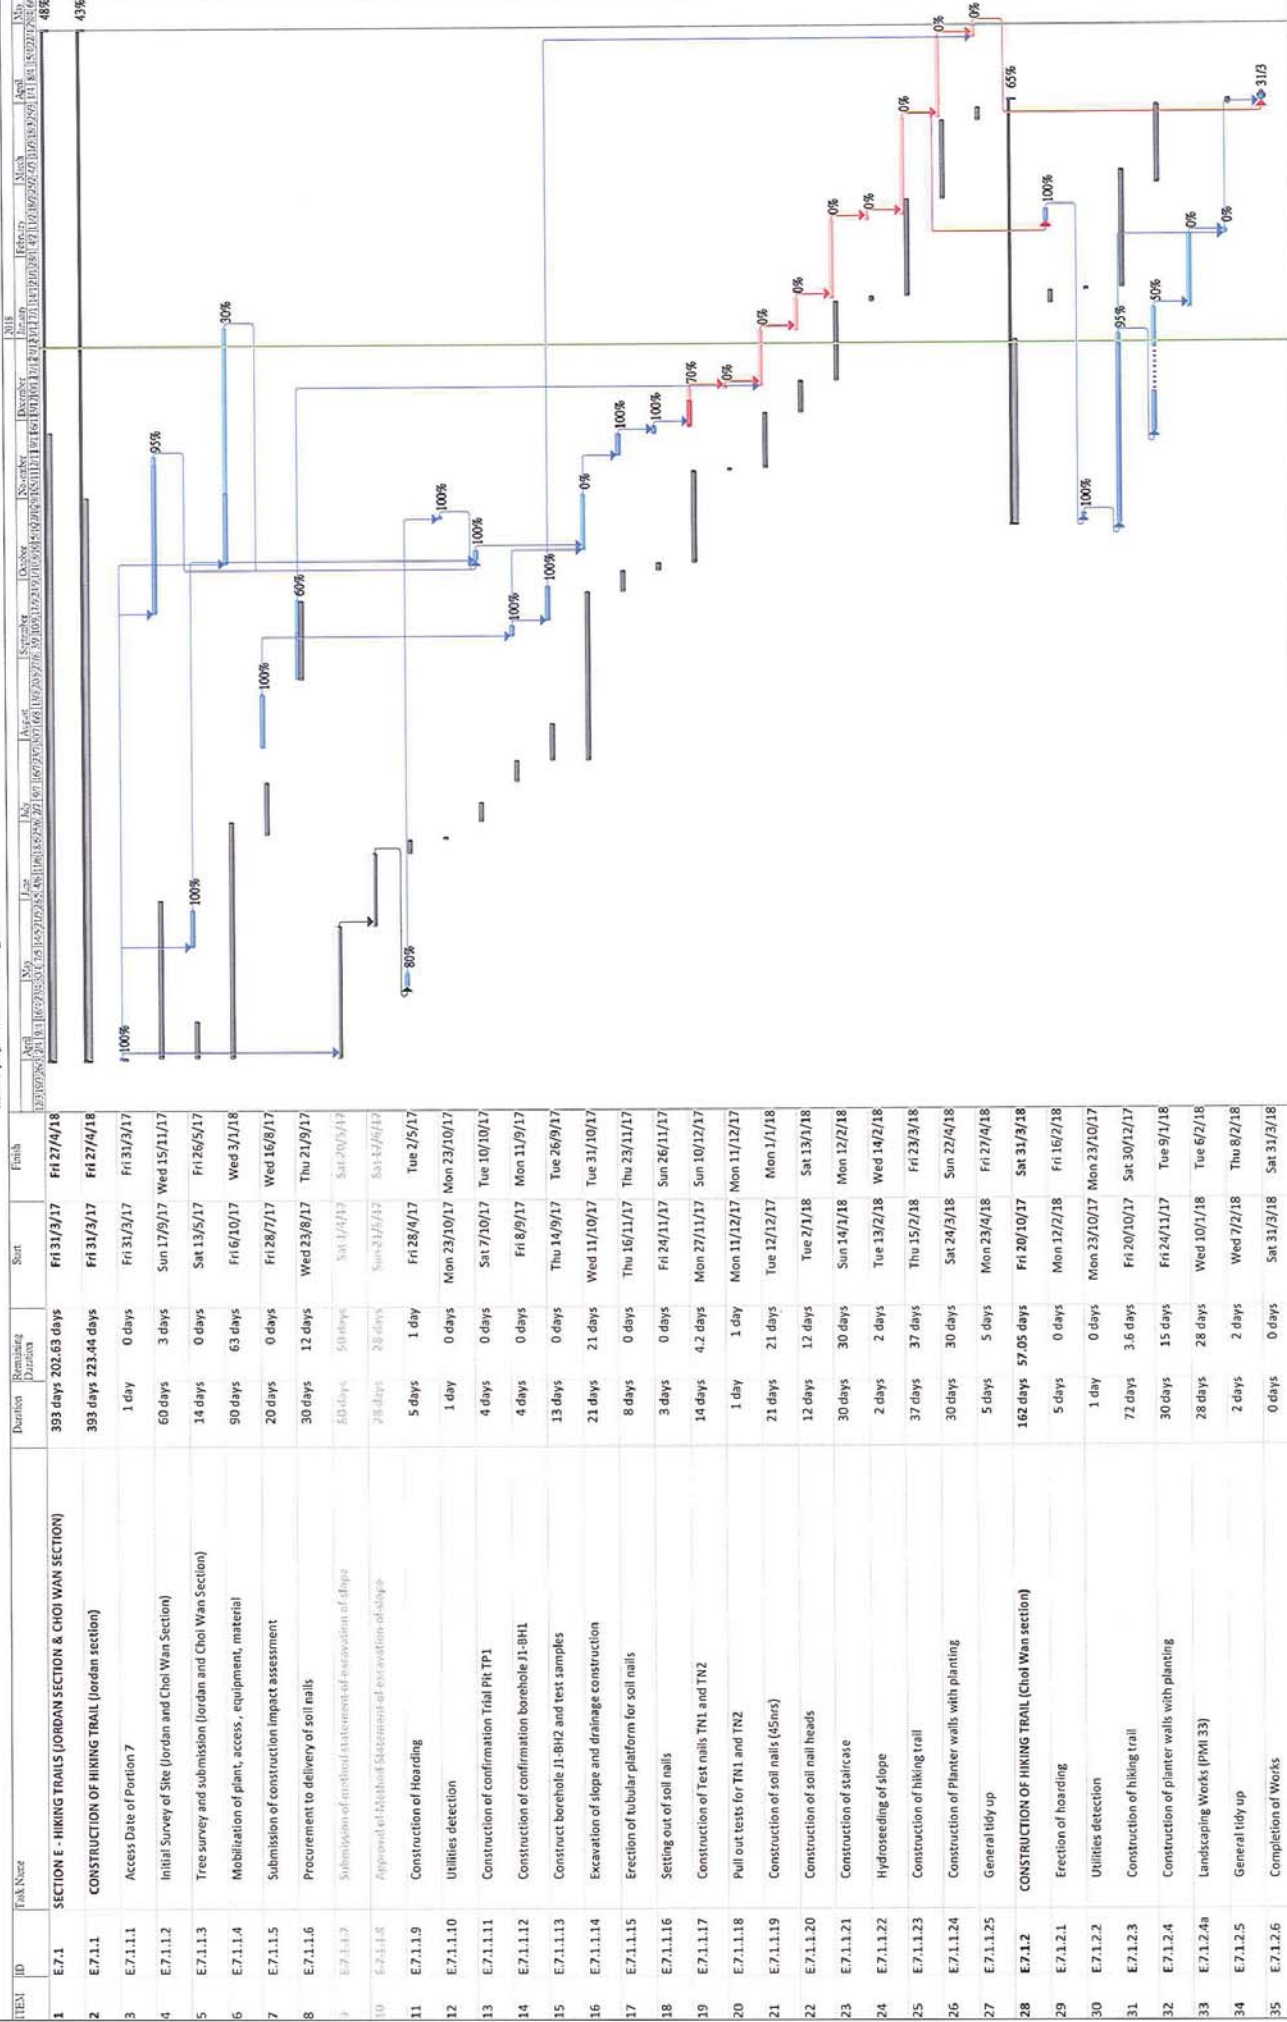

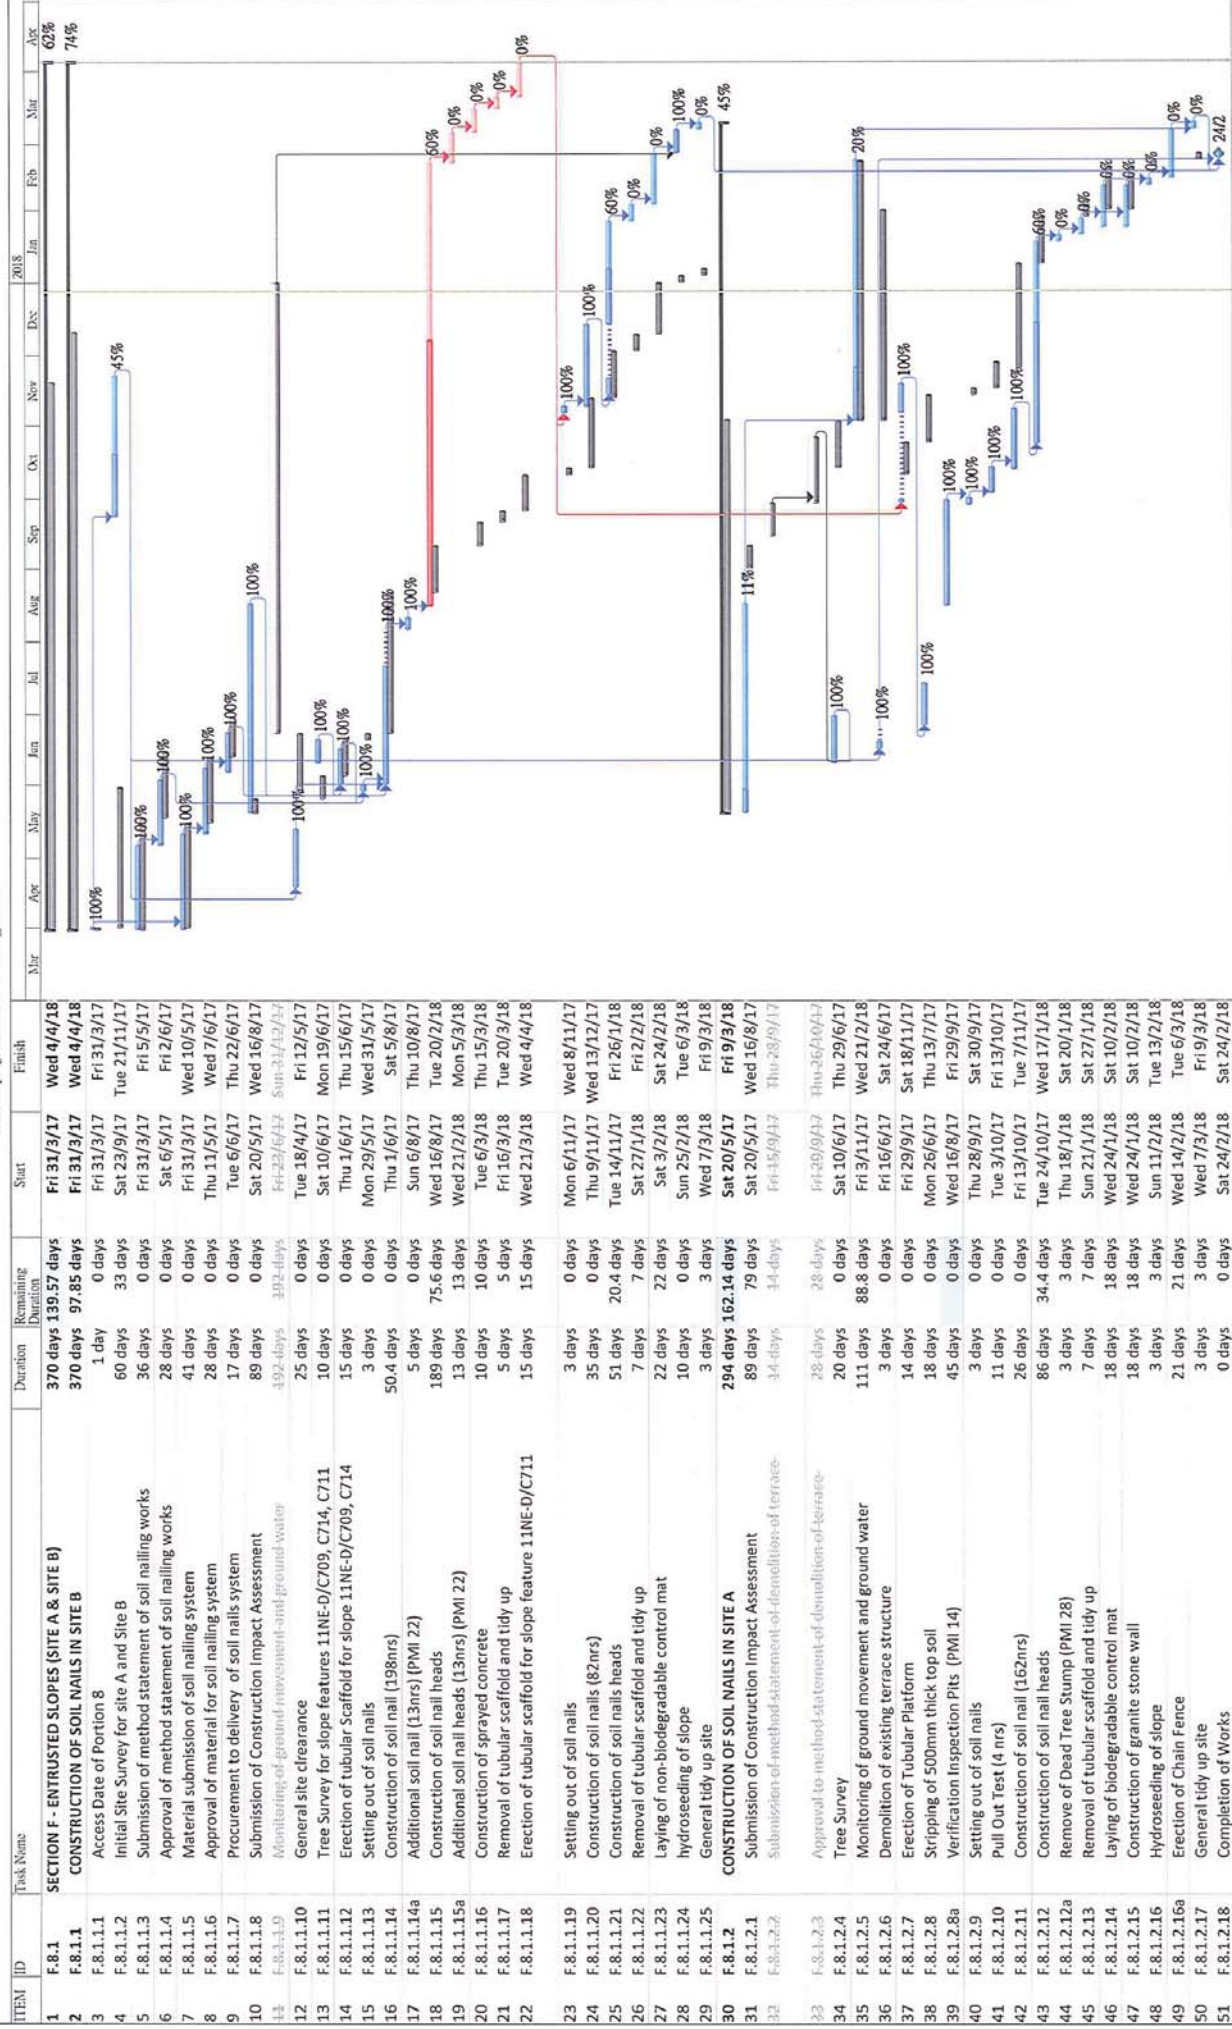

Revised programme for Section F1_Dec 17

ITEM ID	Task Name	Duration	Remaining Duration	Start	Finish	2018	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	F1.9.1 SECTION F1 - FLEXIBLE BARRIER	595 days	388.28 days	Fri 31/3/17	Thu 15/11/18																							35%
2	F1.9.1.1 CONSTRUCTION OF Flexible barriers near Tiu King Leng	595 days	388.28 days	Fri 31/3/17	Thu 15/11/18																							35%
3	F1.9.1.1.1 Access Date for Portion 9	1 day	0 days	Fri 31/3/17	Fri 31/3/17																							
4	F1.9.1.1.2 Initial Site Survey	60 days	33 days	Wed 11/10/17	Sat 9/12/17																							45%
5	F1.9.1.1.3 Initial Tree Survey	13 days	7.15 days	Tue 24/10/17	Sun 5/11/17																							45%
6	F1.9.1.1.4 Material and design submission for flexible barrier systems	78 days	0 days	Sat 1/4/17	Sat 17/6/17																							100%
7	F1.9.1.1.5 Approval to material and design submission for flexible barrier system	216 days	32.4 days	Sun 18/6/17	Fri 19/1/18																							85%
8	F1.9.1.1.6 Procurement of flexible barriers	121 days	121 days	Sat 20/1/18	Sun 20/5/18																							0%
9	F1.9.1.1.7 Submission of method statement for Flexible barrier construction	28 days	28 days	Wed 15/11/17	Tue 12/12/17																							0%
10	F1.9.1.1.8 Approval of method statement for flexible barrier construction	28 days	28 days	Wed 13/12/17	Tue 9/1/18																							0%
11	F1.9.1.1.9 Submission of construction impact assessment	10 days	0 days	Mon 7/8/17	Wed 16/8/17																							100%
12	F1.9.1.1.10 Monitoring of vibration and ground water level	264 days	205.4 days	Fri 3/11/17	Tue 24/7/18																							22%
13	F1.9.1.1.11 Construction of piezometers (2nr) (PMI 4)	10 days	0 days	Fri 15/9/17	Sun 24/9/17																							100%
14	F1.9.1.1.12 Ground Investigation works	30 days	30 days	Mon 25/9/17	Tue 24/10/17																							20%
15	F1.9.1.1.13 Construction of Baffles	91 days	72.8 days	Mon 16/10/17	Wed 18/4/18																							0%
16	F1.9.1.1.14 General site clearance for Flexible barriers	7 days	7 days	Mon 21/5/18	Sun 27/5/18																							0%
17	F1.9.1.1.15 Erection of tubular platform for flexible barrier construction	50 days	50 days	Mon 28/5/18	Mon 16/7/18																							0%
18	F1.9.1.1.16 Erection of flexible barriers	100 days	100 days	Tue 17/7/18	Wed 24/10/18																							0%
19	F1.9.1.1.17 Removal of platform	20 days	20 days	Thu 25/10/18	Tue 13/11/18																							0%
20	F1.9.1.1.18 General tidy up	2 days	2 days	Wed 14/11/18	Thu 15/11/18																							0%
21	F1.9.1.1.19 Completion of works	0 days	0 days	Tue 24/7/18	Tue 24/7/18																							0%

Contract 3 (NE/2017/03)

Activity ID	Activity Name	Duration	Start	Finish	2019				
						Feb	Mar	Apr	May
						14	15	16	17
Submission Works for RIW3		42	04-Dec-18 A	14-Feb-19 A					
SUB30560	PMI #17 Clearance of undersized vegetation other than plant of conservation	42	04-Dec-18 A	14-Feb-19 A					
Construction Works		343	19-Nov-18 A	20-Feb-20					
Works in Slope D1		320	08-Jan-19 A	20-Feb-20					
Preparation Works		90	12-Feb-19 A	03-Jun-19					
CON30010	Trees felling (Slope D1)	90	12-Feb-19 A	03-Jun-19					
CON30012	Install monitoring & instrumentation (Slope D1)	60	05-Mar-19	20-May-19					
Slope Works (Slope D1)		241	02-May-19	20-Feb-20					
CON30070	Soil nail works	72	02-May-19	27-Jul-19					
CON30060	Slope works at slope D1 (L=240m)	240	03-May-19	20-Feb-20					
Construction of Retaining Wall RWD1		216	02-May-19	18-Jan-20					
Foundation Works (RWD 1)		216	02-May-19	18-Jan-20					
CON30190	Pre-drill & construct socket H-pile works at RWD1 (144nos, 6d/no, 4 teams)	216	02-May-19	18-Jan-20					
CON30200	Pre-drill & construct bored pile (CH94~CH130, 5nos, 24d/no, team 1)	120	02-May-19	23-Sep-19					
Road Works (Slope D1)		56	08-Jan-19 A	11-Mar-19					
CON30890	Utilities mapping at Section 3	56	08-Jan-19 A	11-Mar-19					
Works in Slope D2		132	23-Jan-19 A	02-Aug-19					
Construction of Retaining Wall RWD2		132	23-Jan-19 A	02-Aug-19					
CON30020	Trees felling (slope D2)	30	23-Jan-19 A	02-Mar-19					
CON30022	Install monitoring & instrumentation (Slope D2)	60	04-Mar-19	18-May-19					
CON30080	Install sheet pile, support & slope works at slope D2 (L=75m)	90	12-Apr-19	02-Aug-19					
Works in Slope D3		313	19-Nov-18 A	13-Jan-20					
Slope Works (Slope D3)		313	19-Nov-18 A	13-Jan-20					
CON300130	EWN #016 - Piling works by WSD Contractor at junction	42	19-Nov-18 A	01-Feb-19 A					
CON300110	Relocation of existing traffic signal lighting (by EMSD's contractor) (RIW3)	64	30-Nov-18 A	15-Mar-19					
CON300120	Relocation of existing HyD lighting (by CLPE's contractor) (RIW3)	42	11-Dec-18 A	06-Mar-19					
CON300140	Modification works to existing junction near slope D2	18	15-Feb-19 A	22-Mar-19					
CON30030	Install safety fencing, from haul road & hoarding (CH250 to CH130)	18	23-Mar-19	13-Apr-19					
CON30028	Trees felling (Slope D3, CH250 to CH130)	60	15-Apr-19	29-Jun-19					
CON30029	Install monitoring & instrumentation (Slope D3)	60	03-May-19	15-Jul-19					
CON30120	Cut slope works (CH250 to CH130) (L=120m, 12255m3, 60m3/d)	198	18-May-19	13-Jan-20					
Pedestrian Connectivity Facility (PC-E8)		735	04-Dec-18 A	07-Dec-20					
Submission Works		73	04-Dec-18 A	14-Feb-19 A					
SUB41180	PMI #17 Clearance of undersized vegetation other than plant of conservation	73	04-Dec-18 A	14-Feb-19 A					
Construction Works		558	09-Jan-19 A	07-Dec-20					
Preparation Works		558	09-Jan-19 A	07-Dec-20					
Trees Works		539	15-Feb-19 A	07-Dec-20					
CON40080	Trees felling works & trees protection works	52	15-Feb-19 A	17-Apr-19					
CON400820	Preparation works for trees transplant & trees transplant at portion G	84	15-Feb-19 A	30-May-19					
CON400810	Trees preservation duration works period at portion G	487	18-Apr-19	07-Dec-20					
Hoarding Works & Site Set-up		101	09-Jan-19 A	28-May-19					
CON40100	Erect hoarding (between Hiu Kwong Street & Hiu Yuk Path)	21	09-Jan-19 A	26-Jan-19 A					
CON400710	Hoarding boundary of football court discussion with supervisor / LCSD	42	14-Jan-19 A	06-Mar-19					
CON40070	Erect hoarding (along Hiu Ming Street)	10	23-Jan-19 A	02-Feb-19 A					
CON400720	Erect hoarding (at football pitch)	12	07-Mar-19	20-Mar-19					
CON40150	Formation works for works area at upper portion	30	18-Apr-19	28-May-19					
Earth Works		137	21-Feb-19	08-Aug-19					
CON40040	Install monitoring & instrumentation (PC-E8)	24	21-Feb-19	20-Mar-19					
CON40140	Construct soldier pile wall to E8-ABT	52	21-Mar-19	27-May-19					
CON40160	Soil nailing & slope cut at slope E8-1 and E8-2	90	18-Apr-19	08-Aug-19					
CON40170	ELS to E8-F4 (approx 1783m3, @25m3/d)	72	18-Apr-19	18-Jul-19					
Pedestrian Connectivity Facility (PC-E11)		120	15-Dec-18 A	23-May-19					
Construction Works		120	15-Dec-18 A	23-May-19					
Preliminary Works		18	15-Dec-18 A	13-Feb-19 A					
CON40670	Install monitoring & instrumentation (PC-E11)	18	15-Dec-18 A	13-Feb-19 A					
Bus-Bus Interchange Public Toilet		90	29-Jan-19 A	23-May-19					
CON41270	Application for power supply & energization (BBI Toilet)	90	29-Jan-19 A	23-May-19					
Pedestrian Connectivity Facility System A (SYA)		154	21-Dec-18 A	04-Jul-19					
Construction Works		154	21-Dec-18 A	04-Jul-19					
Preliminary Works		71	21-Dec-18 A	11-Apr-19					
CON51210	Install monitoring & instrumentation (PC-SYA)	30	21-Dec-18 A	26-Jan-19 A					
CON50034	Revise hoarding boundary & erect revised boundary hoarding	48	21-Jan-19 A	11-Apr-19					

<div></div> Summary	<div></div> Critical Remainin...
<div></div> Actual Work	<div>◆</div> Milestone
<div></div> Remaining Work	

Activity ID	Activity Name	Duration	Start	Finish	2019				
					Feb 14	Mar 15	Apr 16	May 17	
	Sub-structure Works	128	24-Jan-19 A	04-Jul-19					
	CON500420	Excavate & install support at SYA-F1 (+144 to +130.5mPD, 2321m3, 40m3/d +	84	24-Jan-19 A	15-May-19				
	CON500510	Construct footing SYA-F1 (+130.5 ~ +134mPD)	41	16-May-19	04-Jul-19				
Pedestrian Connectivity Facility System B (SYB)		131	21-Feb-19	01-Aug-19					
Construction Works		131	21-Feb-19	01-Aug-19					
Preliminary Works		51	21-Feb-19	25-Apr-19					
CON50188	Install monitoring & instrumentation (PC-SYB)	24	21-Feb-19	20-Mar-19					
CON50200	Erect hoarding at portion K lower area (near slope side)	24	25-Feb-19	23-Mar-19					
CON50220	Form haul road	24	25-Mar-19	25-Apr-19					
CON51110	Erect hoarding at portion L lower area (near existing footbridge side)	24	25-Mar-19	25-Apr-19					
Foundation Works		18	26-Apr-19	18-May-19					
CON50280	Mobilisation of construct socket H-pile works to SYB-PC2	18	26-Apr-19	18-May-19					
CON50260	Mobilisation of socketted H pile works to SYB-PC3	18	26-Apr-19	18-May-19					
Earth Works		80	26-Apr-19	01-Aug-19					
CON50240	Slope works - slope B2	23	26-Apr-19	24-May-19					
CON50230	Cut slope works - slope B1 (3900m3, 50m3/d)	77	30-Apr-19	01-Aug-19					

- Summary
- Actual Work
- Remaining Work
- Critical Remainin...
- ◆

◆ Milestone

Appendix D

Monitoring Locations for Impact Monitoring

**Monitoring Locations
for
Contract 1 (NE/2016/01)**

DO NOT SCALE DRAWING. CHECK ALL DIMENSIONS ON SITE.
ALL RIGHTS RESERVED
© DYE ARUP



HVS in AMS-1 for 24-Hour TSP




PROPOSED ROCK CAVERN (SUBJECT TO DETAIL DESIGN)



AMS-3

- Legend
- Study Area
 - 500m Assessment Area
 - Dust Monitoring Locations

B	SECOND ISSUE	GL	03/14
A	FIRST ISSUE	GL	10/13
Rev	Description	By	Date
Consultant			
ARUP			
Contract No. and Title			
Agreement No. CE 18/2012(CE)			
Development of Anderson Road Quarry - Investigation			
Drawing title			
Locations of Construction Dust Monitoring (Sheet 1 of 3)			
Drawing no.		Rev.	
227724/E/1045		B	
Drawn	Date	Checked	Approved
GL	03/14	TC	ST
Scale	Status		
1:5000 @A3	PRELIMINARY		
COPYRIGHT RESERVED			
			
土木工程拓展署 Civil Engineering and Development Department			

DO NOT SCALE DRAWING/ CHECK ALL DIMENSIONS ON SITE.
ALL RIGHTS RESERVED.
© THE ARUP & PARTNERS HONG KONG LIMITED

- Legend
- Study Area
 - 500m Assessment Area
 - Dust Monitoring Locations



HVS in AMS-5 for 24-Hour TSP



HVS in AMS-6 for 24-Hour TSP



B SECOND ISSUE		GL	03/14
A FIRST ISSUE		GL	10/13
Rev	Description	By	Date
Consultant			
ARUP			
Contract No. and Title			
Agreement No. CE 18/2012(CE)			
Development of Anderson Road Quarry - Investigation			
Drawing title			
Locations of Construction Dust Monitoring (Sheet 2 of 3)			
Drawing no.		Rev.	
227724/E/1046		B	
Drawn	Date	Checked	Approved
GL	03/14	TC	ST
Scale	1:5000	ma3	PRELIMINARY

COPYRIGHT RESERVED



土木工程拓展署
Civil Engineering and
Development Department

DO NOT SCALE DRAWING. CHECK ALL DIMENSIONS ON SITE.
ALL RIGHTS RESERVED. (10/13)
© THE ARUP PARTNERS HONG KONG LIMITED.



Legend

- Study Area
- 500m Assessment Area
- Dust Monitoring Locations

B	SECOND ISSUE	GL	03/14
A	FIRST ISSUE	GL	10/13
Rev	Description	By	Date

Consultant
ARUP

Contract No. and Title
Agreement No. CE 18/2012(CE)
**Development of
Anderson Road Quarry -
Investigation**

Drawing title
**Locations of Construction
Dust Monitoring
(Sheet 3 of 3)**

Drawing no.	227724/E/1047	Rev.	B
Drawn	Date	Checked	Approved
GL	03/14	TC	ST
Scale	1:5000 m/s	Status	PRELIMINARY

COPYRIGHT RESERVED



DO NOT SCALE DRAWING. CHECK ALL DIMENSIONS ON SITE.
ALL RIGHTS RESERVED.
© THE ARUP & PARTNERS HONG KONG LIMITED

NMS-7 (Chi Tai House of On Tai Estate)

Building layout is assumed for assessment purpose

NMS-6 (Yung Tai House of On Tai Estate)

Building layout is assumed for assessment purpose

NMS-3 (Site C2 - R102)

NMS-1 (Site C2 + School 05)

NMS-4 / NMS-4a (On Tat House of On Tat Estate)

Building layout is assumed for assessment purpose

NMS-5 (Hau Tat House of On Tat Estate)

NMS-2 (Site E - School)
(Site E - School)

Legend

- Study Area
- Construction Noise Monitoring Location
- Construction and Operational Road Traffic Noise Monitoring Location
- Review Noise monitoring Location

C	THIRD ISSUE	GL	05/14
B	SECOND ISSUE	GL	03/14
A	FIRST ISSUE	GL	10/13
Rev	Description	By	Date

Consultant
ARUP

Contract No. and Title
Agreement No. CE 18/2012(CE)
Development of
Anderson Road Quarry -
Investigation


Drawing title
Locations of Noise
Monitoring

Drawing no.	227724/E/2400	Rev.	C
Drawn	Date	Checked	Approved
GL	05/14	TC	ST
Scale	1:5000 MA3	Status	PRELIMINARY

COPYRIGHT RESERVED
 土木工程拓展署
Civil Engineering and
Development Department

**Monitoring Locations
for
Contract 3 (NE/2017/03)**

DO NOT SCALE DRAWING. CHECK ALL DIMENSIONS ON SITE.
ALL RIGHTS RESERVED.
© THE ARUP & PARTNERS HONG KONG LIMITED

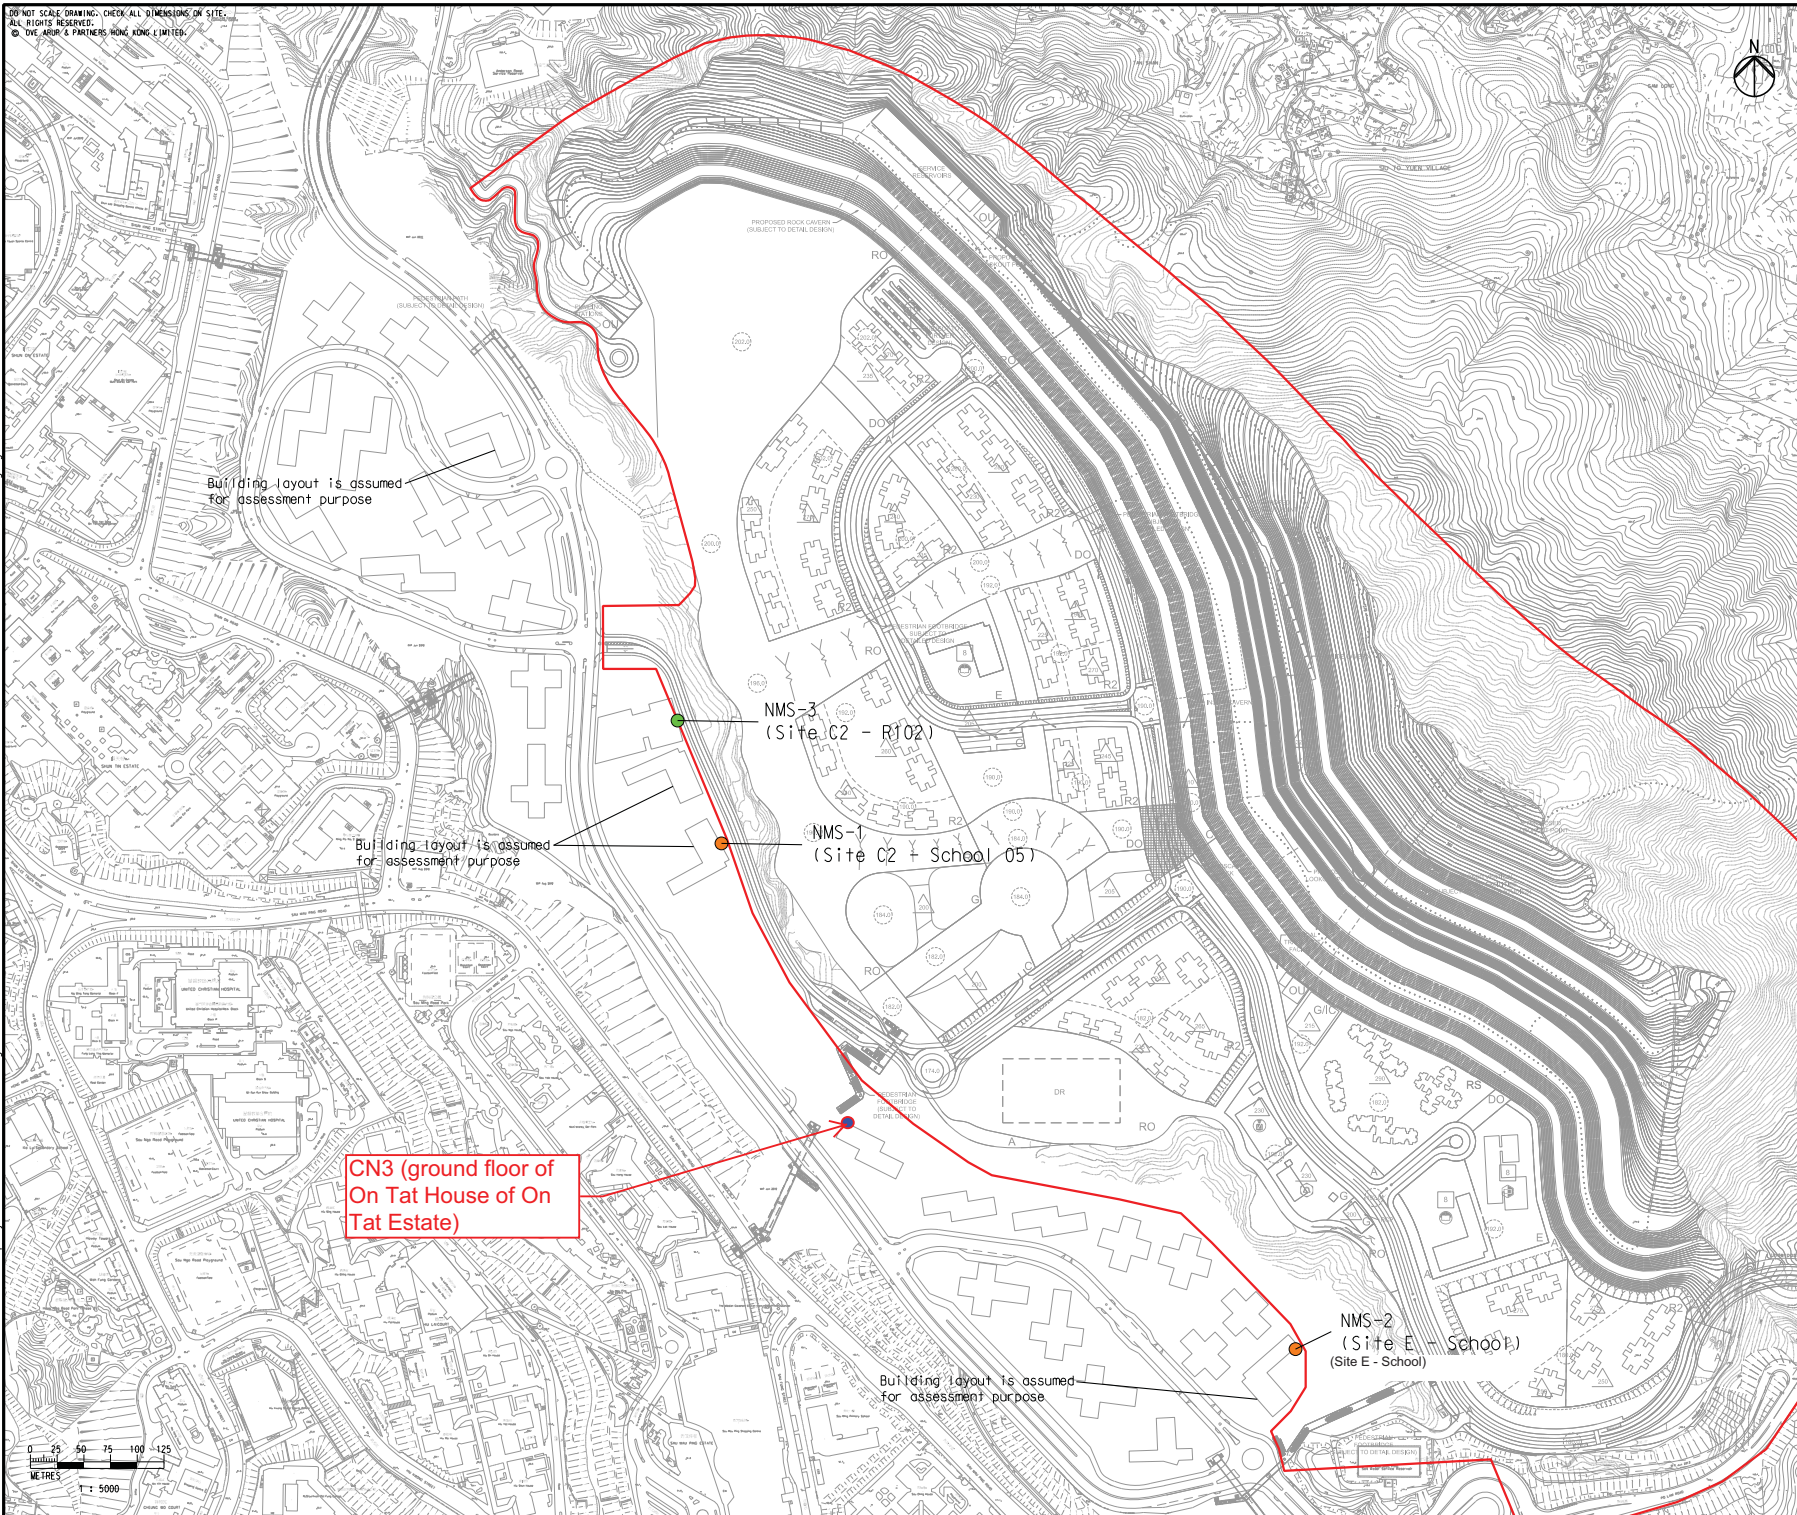

Legend

- Study Area
- Construction Noise Monitoring Location
- Construction and Operational Road Traffic Noise Monitoring Location
- Noise monitoring Location

Rev	Description	By	Date
C	THIRD ISSUE	GL	05/14
B	SECOND ISSUE	GL	03/14
A	FIRST ISSUE	GL	10/13

Consultant
ARUP

Contract No. and Title
Agreement No. CE 18/2012(CE)
Development of
Anderson Road Quarry -
Investigation

Drawing title
Locations of Noise
Monitoring

Drawing no. 227724/E/2400		Rev. C	
Drawn GL	Date 05/14	Checked TC	Approved ST
Scale 1:5000 RA3		Status PRELIMINARY	

COPYRIGHT RESERVED
 土木工程拓展署
Civil Engineering and
Development Department

Building layout is assumed
for assessment purpose

Building layout is assumed
for assessment purpose



CN3 (ground floor of
On Tat House of On
Tat Estate)

Building layout is assumed
for assessment purpose

NMS-3
(Site C2 - R102)

NMS-1
(Site C2 + School 05)

NMS-2
(Site E - School)
(Site E - School)

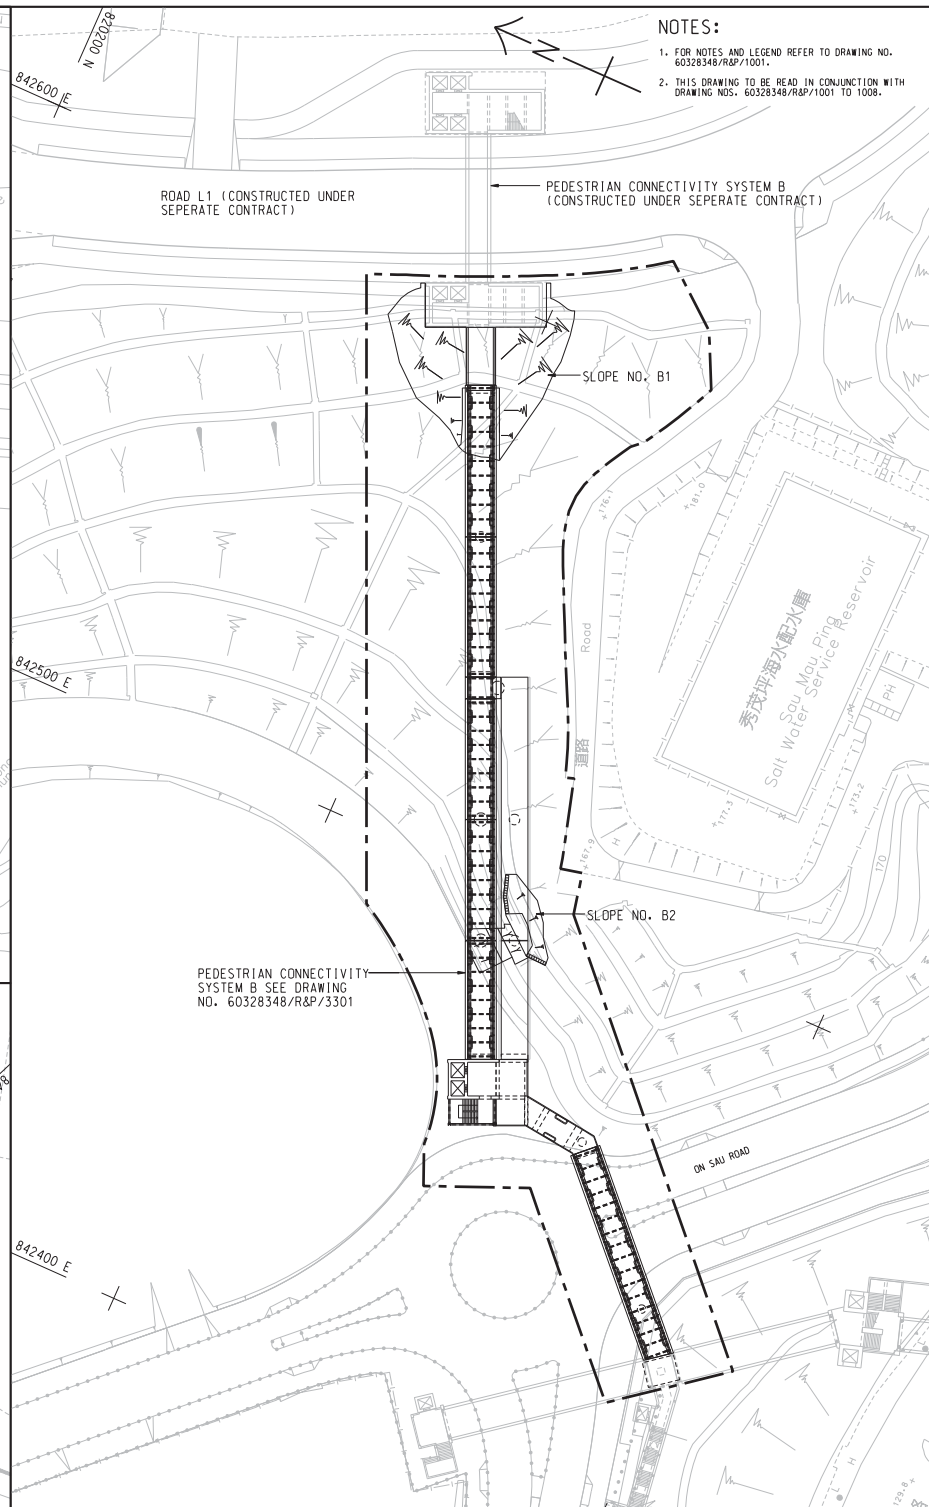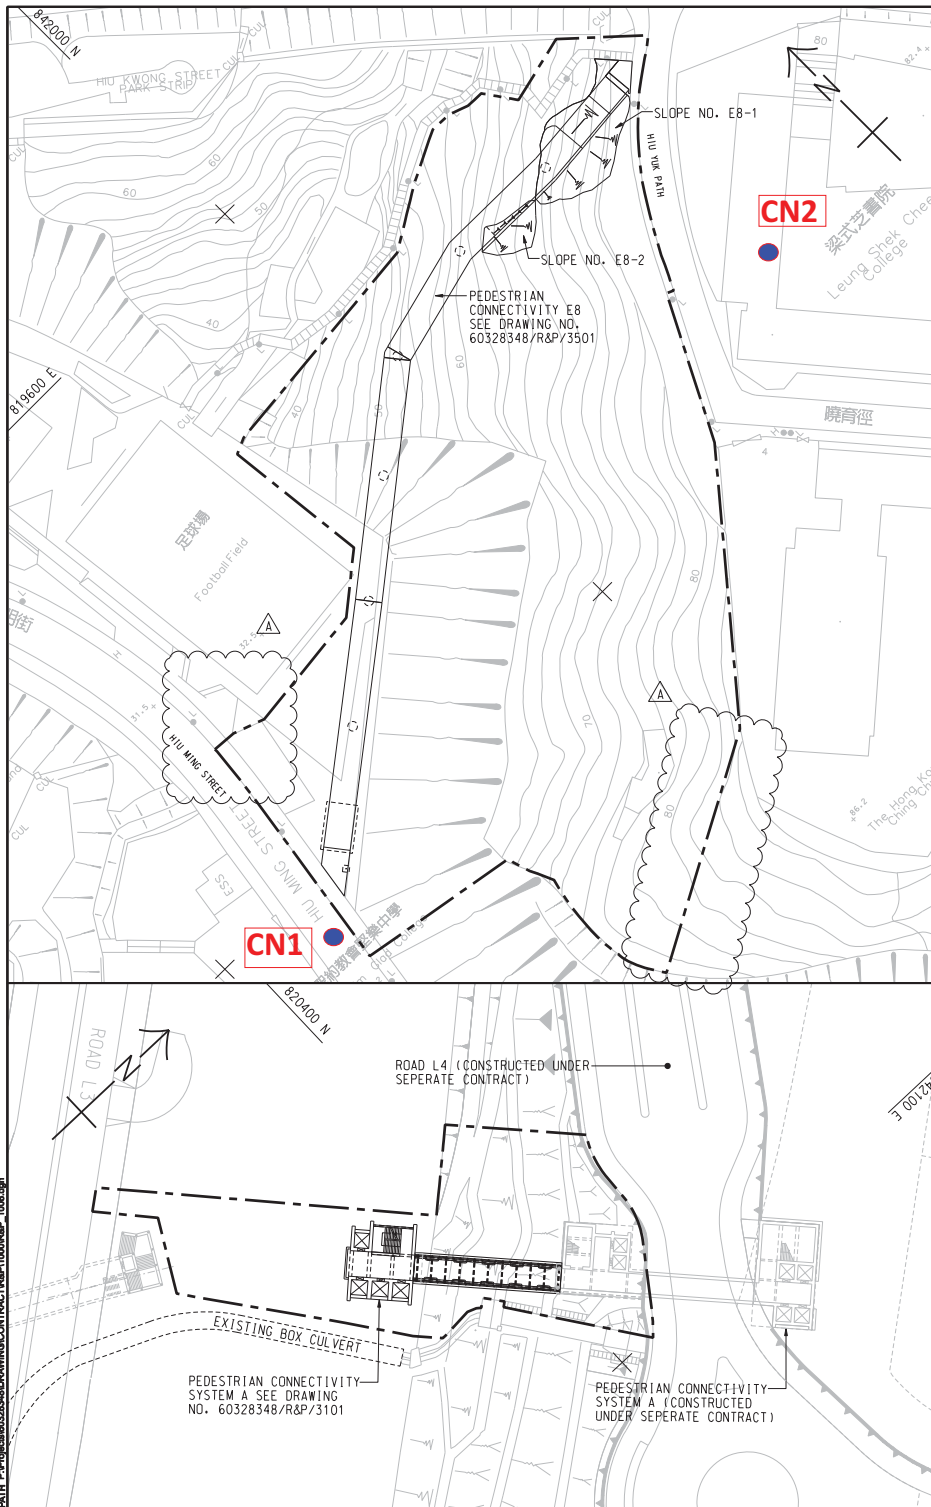

NOTES:

1. FOR NOTES AND LEGEND REFER TO DRAWING NO.
60328348/R&P/1001.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH
DRAWING NOS. 60328348/R&P/1001 TO 1008.



PROJECT

DEVELOPMENT OF ANDERSON ROAD QUARRY SITE - INVESTIGATION, DESIGN AND CONSTRUCTION

CONTRACT TITLE
DEVELOPMENT OF ANDERSON ROAD
QUARRY SITE - ROAD IMPROVEMENT
WORKS AND PEDESTRIAN CONNECTIVITY
FACILITIES WORKS PHASE 2A

CLIENT



土木工程拓展署
Civil Engineering and
Development Department

CONSULTANT

AECOM Asia Company Ltd.
www.aecom.com

SUB-CONSULTANTS
全權工程顧問公司



noise monitoring location

ISSUE/REVISION
#7

A	NOV. 17	TENDER ADDENDUM NO. 1	AW
-	OCT. 17	TENDER DRAWING	AW
IR	DATE	DESCRIPTION	CH
	日期	内容描述	

STATUS

100

SCALE


A1 1 : 500

DIMENSION UNIT

METRES

KEY PLAN

KEY PLAN A1 1:60000



PROJECT NO.

60328348

CONTRACT NO.

NE/2017/03

SHEET TITLE

GENERAL LAYOUT

SHEET 8 OF 8

SHEET NUMBER

60328348/R&P/1008A

Appendix E

Calibration Certificate of Monitoring Equipment and HOKLAS-accreditation Certificate of the Testing Laboratory

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Chi Yum Ching She				Date of Calibration: 26-Jan-19			
Location ID : AMS1				Next Calibration Date: 26-Mar-19			
Model: TISCH High Volume Air Sampler TE-5170				Technician: Mr. Fai So			
CONDITIONS							
Sea Level Pressure (hPa)		<div style="border: 1px solid black; padding: 2px;">1018.9</div>		Corrected Pressure (mm Hg)		<div style="border: 1px solid black; padding: 2px;">764.175</div>	
Temperature (°C)		<div style="border: 1px solid black; padding: 2px;">19.0</div>		Temperature (K)		<div style="border: 1px solid black; padding: 2px;">292</div>	
CALIBRATION ORIFICE							
Make->		<div style="border: 1px solid black; padding: 2px;">TISCH</div>		Qstd Slope ->		<div style="border: 1px solid black; padding: 2px;">2.02017</div>	
Model->		<div style="border: 1px solid black; padding: 2px;">TE-5025A</div>		Qstd Intercept ->		<div style="border: 1px solid black; padding: 2px;">-0.03691</div>	
Serial # ->		<div style="border: 1px solid black; padding: 2px;">1612</div>					
CALIBRATION							
Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.6	6.6	13.2	1.840	55	55.71	Slope = 33.8356 Intercept = -6.7937 Corr. coeff. = 0.9983
13	5.3	5.3	10.6	1.651	49	49.64	
10	3.7	3.7	7.4	1.382	38	38.49	
7	2.4	2.4	4.8	1.117	31	31.40	
5	1.1	1.1	2.2	0.762	19	19.25	
<p>Calculations :</p> <p>Qstd = $1/m[\text{Sqrt}(\text{H2O}(\text{Pa}/\text{Pstd})(\text{Tstd}/\text{Ta})) - b]$</p> <p>IC = $I[\text{Sqrt}(\text{Pa}/\text{Pstd})(\text{Tstd}/\text{Ta})]$</p> <p>Qstd = standard flow rate</p> <p>IC = corrected chart responses</p> <p>I = actual chart response</p> <p>m = calibrator Qstd slope</p> <p>b = calibrator Qstd intercept</p> <p>Ta = actual temperature during calibration (deg K)</p> <p>Pstd = actual pressure during calibration (mm Hg)</p> <p>For subsequent calculation of sampler flow:</p> <p>$1/m((I)[\text{Sqrt}(298/\text{Tav})(\text{Pav}/760)] - b)$</p> <p>m = sampler slope</p> <p>b = sampler intercept</p> <p>I = chart response</p> <p>Tav = daily average temperature</p> <p>Pav = daily average pressure</p>							

FLOW RATE CHART

Standard Flow Rate (m3/min)	Actual chart response (I(C))
0.762	19.25
1.117	31.40
1.382	38.49
1.651	49.64
1.840	55.71

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Oi Tat House		Date of Calibration: 26-Jan-19	
Location ID : AMS 5		Next Calibration Date: 26-Mar-19	
Model: TISCH High Volume Air Sampler TE-5170		Technician: Mr. Fai So	

CONDITIONS			
Sea Level Pressure (hPa)	1018.9	Corrected Pressure (mm Hg)	764.175
Temperature (°C)	19.0	Temperature (K)	292

CALIBRATION ORIFICE			
Make->	TISCH	Qstd Slope ->	2.02017
Model->	TE-5025A	Qstd Intercept ->	-0.03691
Serial # ->	1612		

CALIBRATION							
Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.2	6.2	12.4	1.784	55	55.71	Slope = 34.2087 Intercept = -5.2620 Corr. coeff. = 0.9987
13	4.8	4.7	9.5	1.564	47	47.61	
10	3.6	3.5	7.1	1.354	41	41.53	
7	2.35	2.35	4.7	1.105	33	33.43	
5	1.2	1.2	2.4	0.795	21	21.27	

Calculations :

Qstd = $1/m[\text{Sqrt}(\text{H2O}(\text{Pa}/\text{Pstd})(\text{Tstd}/\text{Ta})) - b]$

IC = $I[\text{Sqrt}(\text{Pa}/\text{Pstd})(\text{Tstd}/\text{Ta})]$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K)

Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$1/m((I)[\text{Sqrt}(298/\text{Tav})(\text{Pav}/760)] - b)$

m = sampler slope

b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

FLOW RATE CHART

Standard Flow Rate (m3/min)	Actual chart response (IC)
0.795	21.27
1.105	33.43
1.354	41.53
1.564	47.61
1.784	55.71

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Hau Tat House Date of Calibration: 26-Jan-19
 Location ID : AMS 6 Next Calibration Date: 26-Mar-19
 Model: TISCH High Volume Air Sampler TE-5170 Technician: Mr. Fai So

CONDITIONS

Sea Level Pressure (hPa)	1018.9	Corrected Pressure (mm Hg)	764.175
Temperature (°C)	19.0	Temperature (K)	292

CALIBRATION ORIFICE

Make->	TISCH	Qstd Slope ->	2.02017
Model->	TE-5025A	Qstd Intercept ->	-0.03691
Serial # ->	1612		

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.2	6.2	12.4	1.784	55	55.71	Slope = 32.5942 Intercept = -2.5907 Corr. coeff. = 0.9984
13	4.65	4.65	9.3	1.547	48	48.62	
10	3.6	3.5	7.1	1.354	40	40.52	
7	2.2	2.1	4.3	1.058	31	31.40	
5	1.1	1.0	2.1	0.745	22	22.29	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta)) - b]$$

$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K

Pstd = actual pressure during calibration (mm Hg

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)] - b)$$

m = sampler slope


b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

FLOW RATE CHART

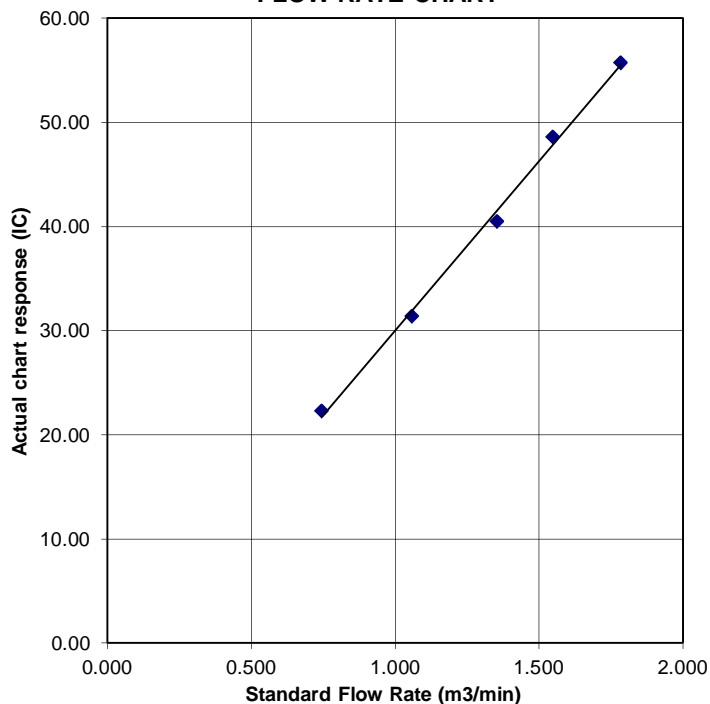

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Ma Yau Tong Village Date of Calibration: 26-Jan-19
 Location ID : AMS 7 Next Calibration Date: 26-Mar-19
 Model: TISCH High Volume Air Sampler TE-5170 Technician: Mr. Fai So

CONDITIONS

Sea Level Pressure (hPa)	1018.9	Corrected Pressure (mm Hg)	764.175
Temperature (°C)	19.0	Temperature (K)	292

CALIBRATION ORIFICE

Make->	TISCH	Qstd Slope ->	2.02017
Model->	TE-5025A	Qstd Intercept ->	-0.03691
Serial # ->	1612		

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.2	6.1	12.3	1.777	46	46.60	Slope = 26.1208 Intercept = -0.7053 Corr. coeff. = 0.9976
13	5.2	5.1	10.3	1.628	41	41.53	
10	3.7	3.7	7.4	1.382	34	34.44	
7	2.0	2.2	4.2	1.046	26	26.34	
5	1.2	1.1	2.3	0.779	20	20.26	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta))-b]$$

$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K)

Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)]-b)$$


m = sampler slope

b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

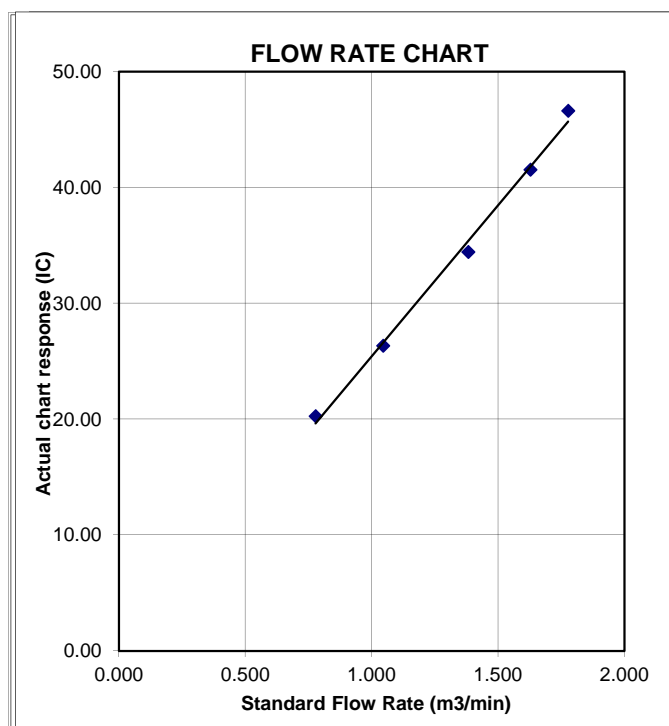

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Hau Tat House

Date of Calibration: 26-Mar-19

Location ID : AMS 6

Next Calibration Date: 26-May-19

Model: TISCH High Volume Air Sampler TE-5170

Technician: Mr. Fai So

CONDITIONS

Sea Level Pressure (hPa)

1018.5

Corrected Pressure (mm Hg)

763.875

Temperature (°C)

21.9

Temperature (K)

295

CALIBRATION ORIFICE

Make-> TISCH

Qstd Slope ->

2.0968

Model-> TE-5025A

Qstd Intercept ->

-0.00065

Serial # -> 1941

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.2	6.2	12.4	1.693	55	55.43	Slope = 34.5088 Intercept = -3.2675 Corr. coeff. = 0.9975
13	4.5	4.5	9	1.442	47	47.37	
10	3.6	3.5	7.1	1.281	39	39.30	
7	2.2	2.1	4.3	0.997	31	31.24	
5	1.1	1.0	2.1	0.697	21	21.16	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta)) - b]$$

$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K

Pstd = actual pressure during calibration (mm Hg

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)] - b)$$

m = sampler slope


b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

FLOW RATE CHART

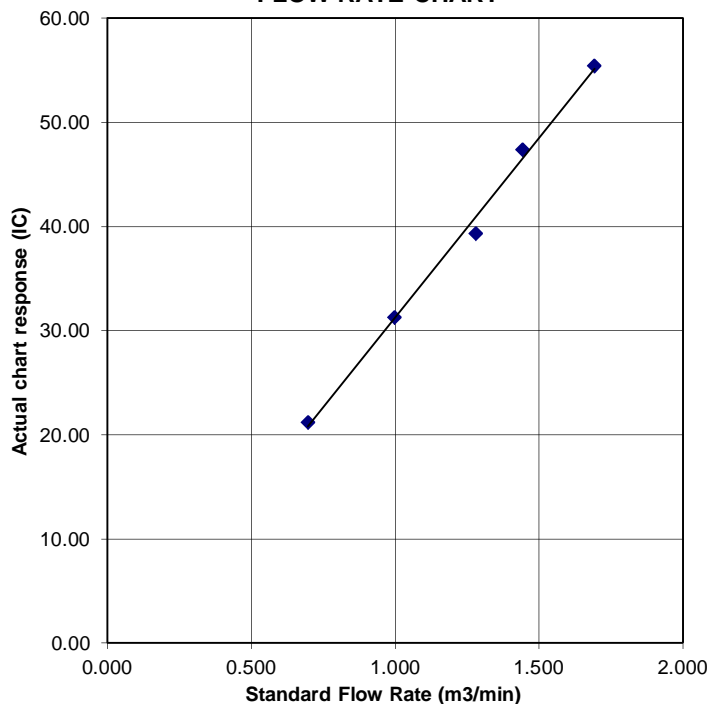

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Oi Tat House		Date of Calibration: 26-Mar-19	
Location ID : AMS 5		Next Calibration Date: 26-May-19	
Model: TISCH High Volume Air Sampler TE-5170		Technician: Mr. Fai So	

CONDITIONS			
Sea Level Pressure (hPa)	1018.5	Corrected Pressure (mm Hg)	763.875
Temperature (°C)	21.9	Temperature (K)	295

CALIBRATION ORIFICE			
Make->	TISCH	Qstd Slope ->	2.0968
Model->	TE-5025A	Qstd Intercept ->	-0.00065
Serial # ->	1941		

CALIBRATION							
Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.2	6.2	12.4	1.693	54	54.42	Slope = 35.7219 Intercept = -5.7784 Corr. coeff. = 0.9978
13	4.8	4.7	9.5	1.482	46	46.36	
10	3.6	3.5	7.1	1.281	41	41.32	
7	2.4	2.4	4.8	1.053	32	32.25	
5	1.2	1.2	2.4	0.745	20	20.16	

Calculations :

Qstd = $1/m[\text{Sqrt}(\text{H2O}(\text{Pa}/\text{Pstd})(\text{Tstd}/\text{Ta})) - b]$

IC = $I[\text{Sqrt}(\text{Pa}/\text{Pstd})(\text{Tstd}/\text{Ta})]$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K)

Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$1/m((I) [\text{Sqrt}(298/\text{Tav})(\text{Pav}/760)] - b)$

m = sampler slope

b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

FLOW RATE CHART

Standard Flow Rate (m3/min)	Actual chart response (IC)
0.745	20.16
1.053	32.25
1.281	41.32
1.482	46.36
1.693	54.42

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Chi Yum Ching She				Date of Calibration: 26-Mar-19			
Location ID : AMS1				Next Calibration Date: 26-May-19			
Model: TISCH High Volume Air Sampler TE-5170				Technician: Mr. Fai So			
CONDITIONS							
Sea Level Pressure (hPa)		<div style="border: 1px solid black; padding: 2px;">1018.5</div>		Corrected Pressure (mm Hg)		<div style="border: 1px solid black; padding: 2px;">763.875</div>	
Temperature (°C)		<div style="border: 1px solid black; padding: 2px;">21.9</div>		Temperature (K)		<div style="border: 1px solid black; padding: 2px;">295</div>	
CALIBRATION ORIFICE							
Make->		<div style="border: 1px solid black; padding: 2px;">TISCH</div>		Qstd Slope ->		<div style="border: 1px solid black; padding: 2px;">2.0968</div>	
Model->		<div style="border: 1px solid black; padding: 2px;">TE-5025A</div>		Qstd Intercept ->		<div style="border: 1px solid black; padding: 2px;">-0.00065</div>	
Serial # ->		<div style="border: 1px solid black; padding: 2px;">1941</div>					
CALIBRATION							
Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	6.6	6.6	13.2	1.747	55	55.43	Slope = 36.3762 Intercept = -8.2857 Corr. coeff. = 0.9995
13	5.2	5.2	10.4	1.550	48	48.37	
10	3.6	3.6	7.2	1.290	38	38.30	
7	2.5	2.5	5	1.075	30	30.23	
5	1.1	1.1	2.2	0.713	18	18.14	
<p>Calculations :</p> <p>Qstd = $1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta))-b]$</p> <p>IC = $I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$</p> <p>Qstd = standard flow rate</p> <p>IC = corrected chart responses</p> <p>I = actual chart response</p> <p>m = calibrator Qstd slope</p> <p>b = calibrator Qstd intercept</p> <p>Ta = actual temperature during calibration (deg K)</p> <p>Pstd = actual pressure during calibration (mm Hg)</p> <p>For subsequent calculation of sampler flow:</p> <p>$1/m((I)[\text{Sqrt}(298/Tav)(Pav/760)]-b)$</p> <p>m = sampler slope</p> <p>b = sampler intercept</p> <p>I = chart response</p> <p>Tav = daily average temperature</p> <p>Pav = daily average pressure</p>							

FLOW RATE CHART

Standard Flow Rate (m3/min)	Actual chart response (I(C))
0.713	18.14
1.075	30.23
1.290	38.30
1.550	48.37
1.747	55.43

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location : Ma Yau Tong Village

Date of Calibration: 26-Mar-19

Location ID : AMS 7

Next Calibration Date: 26-May-19

Model: TISCH High Volume Air Sampler TE-5170

Technician: Mr. Fai So

CONDITIONS

Sea Level Pressure (hPa)

1018.5

Temperature (°C)

21.9

Corrected Pressure (mm Hg)

763.875

Temperature (K)

295

CALIBRATION ORIFICE

Make-> TISCH

Model-> TE-5025A

Serial # -> 1941

Qstd Slope ->

2.0968

Qstd Intercept ->

-0.00065

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	5.9	5.9	11.8	1.651	44	44.34	Slope = 28.3639 Intercept = -3.2170 Corr. coeff. = 0.9973
13	5.2	5.1	10.3	1.543	39	39.30	
10	3.7	3.7	7.4	1.308	34	34.27	
7	2.1	2.1	4.2	0.985	25	25.20	
5	1.2	1.1	2.3	0.729	17	17.13	

Calculations :

$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta)) - b]$

$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K)

Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)] - b)$


m = sampler slope

b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

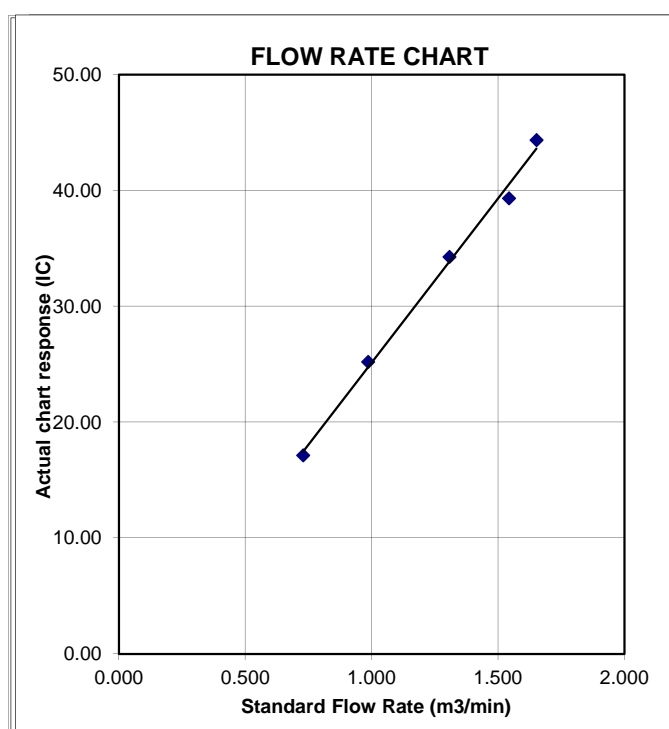

Certificate of Calibration

Calibration Certification Information

Cal. Date: February 13, 2018

Rootsmeter S/N: 438320

Ta: 293

°K

Operator: Jim Tisch

Pa: 763.3

mm Hg

Calibration Model #: TE-5025A

Calibrator S/N: 1612

Run	Vol. Init (m3)	Vol. Final (m3)	ΔVol. (m3)	ΔTime (min)	ΔP (mm Hg)	ΔH (in H2O)
1	1	2	1	1.3970	3.2	2.00
2	3	4	1	1.0000	6.3	4.00
3	5	6	1	0.8900	7.9	5.00
4	7	8	1	0.8440	8.7	5.50
5	9	10	1	0.7010	12.6	8.00

Data Tabulation

Vstd (m3)	Qstd (x-axis)	$\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)}$ (y-axis)	Va	Qa (x-axis)	$\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)}$ (y-axis)
1.0172	0.7281	1.4293	0.9958	0.7128	0.8762
1.0130	1.0130	2.0213	0.9917	0.9917	1.2392
1.0109	1.1358	2.2599	0.9896	1.1120	1.3854
1.0098	1.1964	2.3702	0.9886	1.1713	1.4530
1.0046	1.4331	2.8586	0.9835	1.4030	1.7524
QSTD	m=	2.02017	QA	m=	1.26500
	b=	-0.03691		b=	-0.02263
	r=	0.99988		r=	0.99988

Calculations

$$Vstd = \Delta Vol / ((Pa - \Delta P) / Pstd) (Tstd / Ta)$$

$$Va = \Delta Vol / ((Pa - \Delta P) / Pa)$$

$$Qstd = Vstd / \Delta Time$$

$$Qa = Va / \Delta Time$$

For subsequent flow rate calculations:

$$Qstd = 1/m \left(\left(\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)} \right) - b \right)$$

$$Qa = 1/m \left(\left(\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)} \right) - b \right)$$

Standard Conditions

Tstd: 298.15 °K

Pstd: 760 mm Hg

Key

ΔH: calibrator manometer reading (in H2O)

ΔP: rootsmeter manometer reading (mm Hg)

Ta: actual absolute temperature (°K)

Pa: actual barometric pressure (mm Hg)

b: intercept

m: slope

RECALIBRATION

US EPA recommends annual recalibration per 1998 40 Code of Federal Regulations Part 50 to 51, Appendix B to Part 50, Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere, 9.2.17, page 30



Certificate of Calibration

Calibration Certification Information

Cal. Date: February 5, 2019 Rootsmeter S/N: 438320 Ta: 293 °K
Operator: Jim Tisch Pa: 753.1 mm Hg
Calibration Model #: TE-5025A Calibrator S/N: 1941

Run	Vol. Init (m3)	Vol. Final (m3)	ΔVol. (m3)	ΔTime (min)	ΔP (mm Hg)	ΔH (in H2O)
1	1	2	1	1.4830	3.2	2.00
2	3	4	1	1.0430	6.4	4.00
3	5	6	1	0.9300	7.9	5.00
4	7	8	1	0.8870	8.7	5.50
5	9	10	1	0.7320	12.7	8.00

Data Tabulation

Vstd (m3)	Qstd (x-axis)	$\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)}$ (y-axis)	Va	Qa (x-axis)	$\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)}$ (y-axis)
1.0036	0.6767	1.4197	0.9958	0.6714	0.8821
0.9993	0.9581	2.0078	0.9915	0.9506	1.2475
0.9973	1.0723	2.2448	0.9895	1.0640	1.3947
0.9962	1.1231	2.3544	0.9884	1.1144	1.4628
0.9908	1.3536	2.8395	0.9831	1.3431	1.7642
QSTD	m=	2.09680	QA	m=	1.31298
	b=	-0.00065		b=	-0.00040
	r=	0.99999		r=	0.99999

Calculations

Vstd = $\Delta Vol / ((Pa - \Delta P) / Pstd) (Tstd / Ta)$	Va = $\Delta Vol / ((Pa - \Delta P) / Pa)$
Qstd = $Vstd / \Delta Time$	Qa = $Va / \Delta Time$
For subsequent flow rate calculations:	
Qstd = $1/m \left(\left(\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)} \right) - b \right)$	Qa = $1/m \left(\left(\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)} \right) - b \right)$

Standard Conditions

Tstd:	298.15 °K
Pstd:	760 mm Hg
Key	
ΔH: calibrator manometer reading (in H2O)	
ΔP: rootsmeter manometer reading (mm Hg)	
Ta: actual absolute temperature (°K)	
Pa: actual barometric pressure (mm Hg)	
b: intercept	
m: slope	

RECALIBRATION

US EPA recommends annual recalibration per 1998 40 Code of Federal Regulations Part 50 to 51, Appendix B to Part 50, Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere, 9.2.17, page 30



SUB-CONTRACTING REPORT

CONTACT	: MR BEN TAM	WORK ORDER	: HK1908931
CLIENT	: ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING		
ADDRESS	: RM A 20/F., GOLD KING IND BLDG, NO. 35-41 TAI LIN PAI ROAD, KWAI CHUNG, N.T. HONG KONG	SUB-BATCH	: 1
		DATE RECEIVED	: 25-FEB-2019
		DATE OF ISSUE	: 4-MAR-2019
PROJECT	: ----	NO. OF SAMPLES	: 1
		CLIENT ORDER	: ----

General Comments

- Sample(s) were received in ambient condition.
- Sample(s) analysed and reported on an as received basis.
- Calibration was subcontracted to and analysed by Action United Enviro Services.

Signatories

This document has been signed by those names that appear on this report and are the authorised signatories

Signatories

Position

Richard Fung

General Manager

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

ALS Technichem (HK) Pty Ltd
Part of the ALS Laboratory Group

11/F. Chung Shun Knitting Centre 1 - 3 Wing Yip Street Kwai Chung N.T. Hong Kong
Tel. +852 2610 1044 Fax. +852 2610 2021 www.alsglobal.com

WORK ORDER : HK1908931
SUB-BATCH : 1
CLIENT : ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING
PROJECT : ----



ALS Lab ID	Client's Sample ID	Sample Type	Sample Date	External Lab Report No.
HK1908931-001	S/N: 3Y6505	AIR	25-Feb-2019	S/N: 3Y6505

Equipment Verification Report (TSP)

Equipment Calibrated:

Type: Laser Dust monitor
Manufacturer: Sibata LD-3B
Serial No. 3Y6505
Equipment Ref: EQ114
Job Order HK1908931

Standard Equipment:

Standard Equipment: Higher Volume Sampler
Location & Location ID: AUES office (calibration room)
Equipment Ref: HVS 018
Last Calibration Date: 21 December 2018

Equipment Verification Results:

Testing Date: 7 January 2019


Hour	Time	Mean Temp °C	Mean Pressure (hPa)	Concentration in mg/m ³ (Standard Equipment)	Total Count (Calibrated Equipment)	Count/Minute (Total Count/60min)
2hr07min	09:01 ~ 11:08	18.5	1021.4	0.045	2318	18.3
2hr11min	11:13 ~ 13:24	18.5	1021.4	0.032	1433	11.0
2hr07min	13:30 ~ 15:37	18.5	1021.4	0.089	5022	39.7

Sensitivity Adjustment Scale Setting (Before Calibration) 602 (CPM)

Sensitivity Adjustment Scale Setting (After Calibration) 602 (CPM)

Linear Regression of Y or X

Slope (K-factor): 0.0022
Correlation Coefficient 0.9957
Date of Issue 14 January 2019

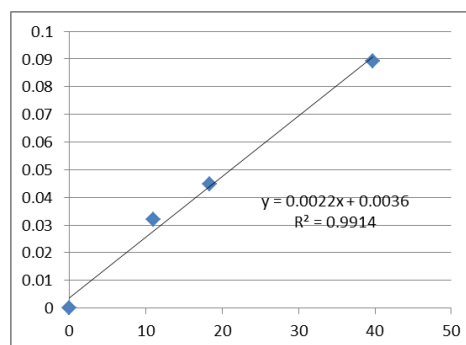

Remarks:

1. **Strong** Correlation ($R > 0.8$)
2. Factor 0.0022 should be apply for TSP monitoring

*If $R < 0.5$, repair or re-verification is required for the equipment

Operator : Martin Li Signature :  Date : 14 January 2019

QC Reviewer : Ben Tam Signature :  Date : 14 January 2019

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location :	Gold King Industrial Building, Kwai Chung	Date of Calibration: 21-Dec-18
Location ID :	Calibration Room	Next Calibration Date: 21-Mar-19

CONDITIONS

Sea Level Pressure (hPa)	1016.1	Corrected Pressure (mm Hg)	762.075
Temperature (°C)	22.4	Temperature (K)	295

CALIBRATION ORIFICE

Make->	TISCH	Qstd Slope ->	2.02017
Model->	5025A	Qstd Intercept ->	-0.03691
Calibration Date->	13-Feb-18	Expiry Date->	13-Feb-19

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	5.7	5.7	11.4	1.699	56	56.32	Slope = 34.0074 Intercept = -0.4093 Corr. coeff. = 0.9972
13	4.4	4.4	8.8	1.495	51	51.29	
10	3.4	3.4	6.8	1.317	45	45.26	
8	2.3	2.3	4.6	1.086	36	36.21	
5	1.4	1.4	2.8	0.851	28	28.16	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta))-b]$$

$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate

IC = corrected chart responses

I = actual chart response

m = calibrator Qstd slope

b = calibrator Qstd intercept

Ta = actual temperature during calibration (deg K)

Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)]-b)$$


m = sampler slope

b = sampler intercept

I = chart response

Tav = daily average temperature

Pav = daily average pressure

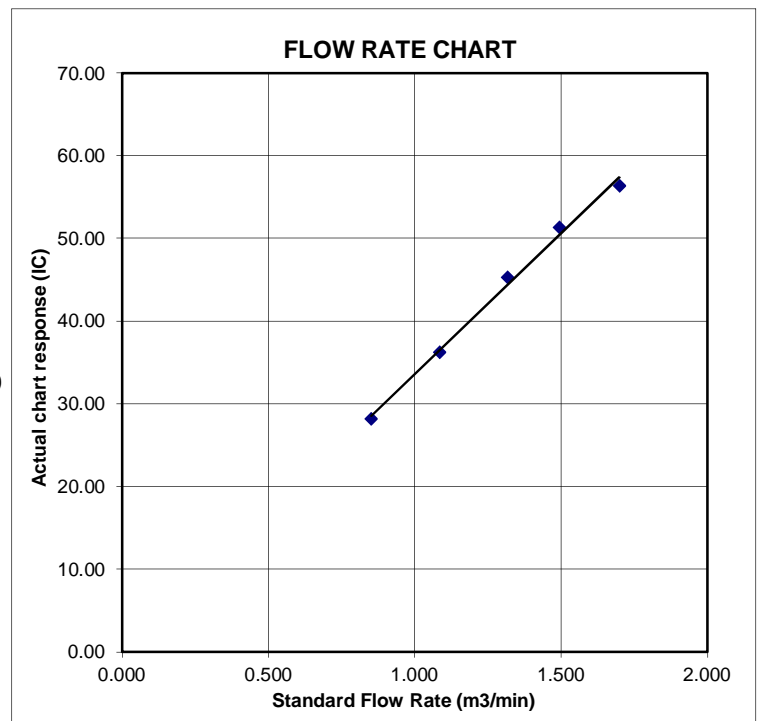

Certificate of Calibration

Calibration Certification Information

Cal. Date: February 13, 2018

Rootsmeter S/N: 438320

Ta: 293

°K

Operator: Jim Tisch

Pa: 763.3

mm Hg

Calibration Model #: TE-5025A

Calibrator S/N: 1612

Run	Vol. Init (m3)	Vol. Final (m3)	ΔVol. (m3)	ΔTime (min)	ΔP (mm Hg)	ΔH (in H2O)
1	1	2	1	1.3970	3.2	2.00
2	3	4	1	1.0000	6.3	4.00
3	5	6	1	0.8900	7.9	5.00
4	7	8	1	0.8440	8.7	5.50
5	9	10	1	0.7010	12.6	8.00

Data Tabulation

Vstd (m3)	Qstd (x-axis)	$\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)}$ (y-axis)	Va	Qa (x-axis)	$\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)}$ (y-axis)
1.0172	0.7281	1.4293	0.9958	0.7128	0.8762
1.0130	1.0130	2.0213	0.9917	0.9917	1.2392
1.0109	1.1358	2.2599	0.9896	1.1120	1.3854
1.0098	1.1964	2.3702	0.9886	1.1713	1.4530
1.0046	1.4331	2.8586	0.9835	1.4030	1.7524
QSTD	m=	2.02017	QA	m=	1.26500
	b=	-0.03691		b=	-0.02263
	r=	0.99988		r=	0.99988

Calculations

$$Vstd = \Delta Vol / ((Pa - \Delta P) / Pstd) (Tstd / Ta)$$

$$Va = \Delta Vol / ((Pa - \Delta P) / Pa)$$

$$Qstd = Vstd / \Delta Time$$

$$Qa = Va / \Delta Time$$

For subsequent flow rate calculations:

$$Qstd = 1/m \left(\left(\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)} \right) - b \right)$$

$$Qa = 1/m \left(\left(\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)} \right) - b \right)$$

Standard Conditions

Tstd: 298.15 °K

Pstd: 760 mm Hg

Key

ΔH: calibrator manometer reading (in H2O)

ΔP: rootsmeter manometer reading (mm Hg)

Ta: actual absolute temperature (°K)

Pa: actual barometric pressure (mm Hg)

b: intercept

m: slope

RECALIBRATION

US EPA recommends annual recalibration per 1998 40 Code of Federal Regulations Part 50 to 51, Appendix B to Part 50, Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere, 9.2.17, page 30



SUB-CONTRACTING REPORT

CONTACT	: MR BEN TAM	WORK ORDER	: HK1912134
CLIENT	: ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING		
ADDRESS	: RM A 20/F., GOLD KING IND BLDG, NO. 35-41 TAI LIN PAI ROAD, KWAI CHUNG, N.T. HONG KONG	SUB-BATCH	: 1
		DATE RECEIVED	: 20-MAR-2019
		DATE OF ISSUE	: 22-MAR-2019
PROJECT	: ----	NO. OF SAMPLES	: 1
		CLIENT ORDER	: ----

General Comments

- Sample(s) were received in ambient condition.
- Sample(s) analysed and reported on an as received basis.
- Calibration was subcontracted to and analysed by Action United Enviro Services.

Signatories

This document has been signed by those names that appear on this report and are the authorised signatories

Signatories

Position

Richard Fung

General Manager

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

ALS Technichem (HK) Pty Ltd
Part of the **ALS Laboratory Group**

11/F. Chung Shun Knitting Centre 1 - 3 Wing Yip Street Kwai Chung N.T. Hong Kong
Tel. +852 2610 1044 Fax. +852 2610 2021 www.alsglobal.com

WORK ORDER : HK1912134
SUB-BATCH : 1
CLIENT : ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING
PROJECT : ----



ALS Lab ID	Client's Sample ID	Sample Type	Sample Date	External Lab Report No.
HK1912134-001	S/N: 3Y6502	AIR	20-Mar-2019	3Y6502

Equipment Verification Report (TSP)

Equipment Calibrated:

Type: Laser Dust monitor
Manufacturer: Sibata LD-3B
Serial No. 3Y6502
Equipment Ref: EQ113
Job Order HK1912134

Standard Equipment:

Standard Equipment: Higher Volume Sampler
Location & Location ID: AUES office (calibration room)
Equipment Ref: HVS 018
Last Calibration Date: 12 February 2019

Equipment Verification Results:

Calibration Date: 11 March 2019

Hour	Time	Mean Temp °C	Mean Pressure (hPa)	Concentration in mg/m ³ (Standard Equipment)	Total Count (Calibrated Equipment)	Count/Minute (Total Count/60min)
2hr00min	09:21 ~ 11:21	18.4	1014.9	0.021	2670	22.3
2hr00min	11:30 ~ 13:30	18.4	1014.9	0.025	2917	24.3
2hr00min	13:40 ~ 15:40	18.4	1014.9	0.032	3301	27.5

Sensitivity Adjustment Scale Setting (Before Calibration) 573 (CPM)


Sensitivity Adjustment Scale Setting (After Calibration) 573 (CPM)

Linear Regression of Y or X

Slope (K-factor): 0.0011

Correlation Coefficient (R) 0.9860

Date of Issue 15 March 2019

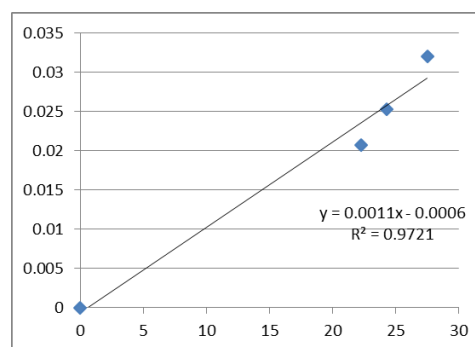

Remarks:

1. **Strong** Correlation ($R > 0.8$)
2. Factor 0.0011 should be apply for TSP monitoring

*If $R < 0.5$, repair or re-verification is required for the equipment

Operator : Fai So Signature :  Date : 15 March 2019

QC Reviewer : Ben Tam Signature :  Date : 15 March 2019

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location :	Gold King Industrial Building, Kwai Chung	Date of Calibration: 12-Feb-19
Location ID :	Calibration Room	Next Calibration Date: 12-May-19

CONDITIONS

Sea Level Pressure (hPa)	1024.2	Corrected Pressure (mm Hg)	768.15
Temperature (°C)	19.0	Temperature (K)	292

CALIBRATION ORIFICE

Make->	TISCH	Qstd Slope ->	2.02017
Model->	5025A	Qstd Intercept ->	-0.03691
Calibration Date->	13-Feb-18	Expiry Date->	13-Feb-19

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	4	7.7	11.7	1.738	60	60.94	Slope = 35.5369 Intercept = -1.8924 Corr. coeff. = 0.9951
13	2.8	6.9	9.7	1.584	52	52.81	
10	1.9	5.4	7.3	1.377	46	46.72	
8	0.6	4	4.6	1.097	38	38.59	
5	-0.4	3.1	2.7	0.844	27	27.42	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta))-b]$$


$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate
 IC = corrected chart responses
 I = actual chart response
 m = calibrator Qstd slope
 b = calibrator Qstd intercept
 Ta = actual temperature during calibration (deg K)
 Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)]-b)$$

m = sampler slope
 b = sampler intercept
 I = chart response
 Tav = daily average temperature
 Pav = daily average pressure

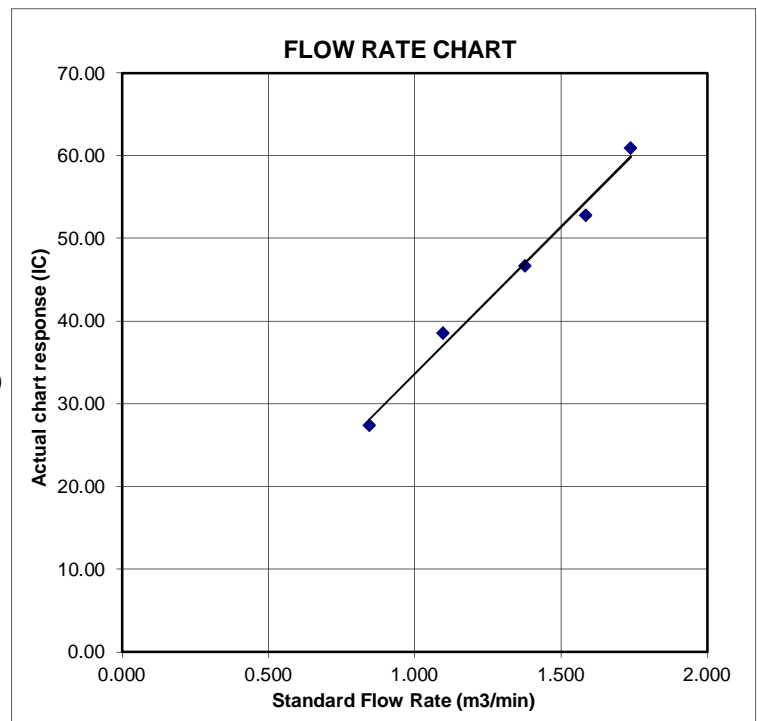

Certificate of Calibration

Calibration Certification Information

Cal. Date: February 13, 2018

Rootsmeter S/N: 438320

Ta: 293

°K

Operator: Jim Tisch

Pa: 763.3

mm Hg

Calibration Model #: TE-5025A

Calibrator S/N: 1612

Run	Vol. Init (m3)	Vol. Final (m3)	ΔVol. (m3)	ΔTime (min)	ΔP (mm Hg)	ΔH (in H2O)
1	1	2	1	1.3970	3.2	2.00
2	3	4	1	1.0000	6.3	4.00
3	5	6	1	0.8900	7.9	5.00
4	7	8	1	0.8440	8.7	5.50
5	9	10	1	0.7010	12.6	8.00

Data Tabulation

Vstd (m3)	Qstd (x-axis)	$\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)}$ (y-axis)	Va	Qa (x-axis)	$\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)}$ (y-axis)
1.0172	0.7281	1.4293	0.9958	0.7128	0.8762
1.0130	1.0130	2.0213	0.9917	0.9917	1.2392
1.0109	1.1358	2.2599	0.9896	1.1120	1.3854
1.0098	1.1964	2.3702	0.9886	1.1713	1.4530
1.0046	1.4331	2.8586	0.9835	1.4030	1.7524
QSTD	m=	2.02017	QA	m=	1.26500
	b=	-0.03691		b=	-0.02263
	r=	0.99988		r=	0.99988

Calculations

Vstd =	$\Delta Vol / ((Pa - \Delta P) / Pstd) (Tstd / Ta)$	Va =	$\Delta Vol / ((Pa - \Delta P) / Pa)$
Qstd =	$Vstd / \Delta Time$	Qa =	$Va / \Delta Time$
For subsequent flow rate calculations:			
Qstd =	$1/m \left(\left(\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)} \right) - b \right)$	Qa =	$1/m \left(\left(\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)} \right) - b \right)$

Standard Conditions

Tstd:	298.15 °K
Pstd:	760 mm Hg
Key	
ΔH: calibrator manometer reading (in H2O)	
ΔP: rootsmeter manometer reading (mm Hg)	
Ta: actual absolute temperature (°K)	
Pa: actual barometric pressure (mm Hg)	
b: intercept	
m: slope	

RECALIBRATION

US EPA recommends annual recalibration per 1998 40 Code of Federal Regulations Part 50 to 51, Appendix B to Part 50, Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere, 9.2.17, page 30



SUB-CONTRACTING REPORT

CONTACT	: MR BEN TAM	WORK ORDER	: HK1908930
CLIENT	: ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING		
ADDRESS	: RM A 20/F., GOLD KING IND BLDG, NO. 35-41 TAI LIN PAI ROAD, KWAI CHUNG, N.T. HONG KONG	SUB-BATCH	: 1
		DATE RECEIVED	: 25-FEB-2019
		DATE OF ISSUE	: 4-MAR-2019
PROJECT	: ----	NO. OF SAMPLES	: 1
		CLIENT ORDER	: ----

General Comments

- Sample(s) were received in ambient condition.
- Sample(s) analysed and reported on an as received basis.
- Calibration was subcontracted to and analysed by Action United Enviro Services.

Signatories

This document has been signed by those names that appear on this report and are the authorised signatories

Signatories

Position

Richard Fung

General Manager

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

ALS Technichem (HK) Pty Ltd
Part of the ALS Laboratory Group

11/F. Chung Shun Knitting Centre 1 - 3 Wing Yip Street Kwai Chung N.T. Hong Kong
Tel. +852 2610 1044 Fax. +852 2610 2021 www.alsglobal.com

WORK ORDER : HK1908930
SUB-BATCH : 1
CLIENT : ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING
PROJECT : ----



ALS Lab ID	Client's Sample ID	Sample Type	Sample Date	External Lab Report No.
HK1908930-001	S/N: 3Y6503	AIR	25-Feb-2019	S/N: 3Y6503

Equipment Verification Report (TSP)

Equipment Calibrated:

Type: Laser Dust monitor
Manufacturer: Sibata LD-3B
Serial No. 3Y6503
Equipment Ref: EQ112
Job Order HK1908930

Standard Equipment:

Standard Equipment: Higher Volume Sampler
Location & Location ID: AUES office (calibration room)
Equipment Ref: HVS 018
Last Calibration Date: 21 December 2018

Equipment Verification Results:

Testing Date: 7 January 2019


Hour	Time	Mean Temp °C	Mean Pressure (hPa)	Concentration in mg/m ³ (Standard Equipment)	Total Count (Calibrated Equipment)	Count/Minute (Total Count/60min)
2hr07min	09:01 ~ 11:08	18.5	1021.4	0.045	2403	19.0
2hr11min	11:13 ~ 13:24	18.5	1021.4	0.032	1577	12.1
2hr07min	13:30 ~ 15:37	18.5	1021.4	0.089	5129	40.5

Sensitivity Adjustment Scale Setting (Before Calibration) 655 (CPM)

Sensitivity Adjustment Scale Setting (After Calibration) 655 (CPM)

Linear Regression of Y or X

Slope (K-factor): 0.0022
Correlation Coefficient 0.9975
Date of Issue 14 January 2019

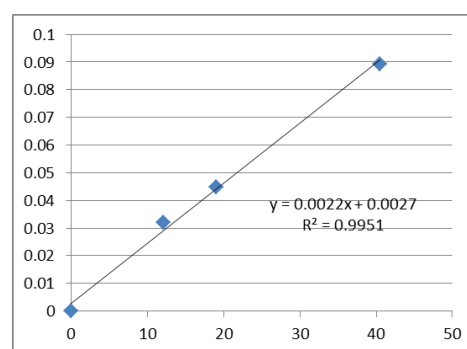

Remarks:

1. **Strong** Correlation ($R > 0.8$)
2. Factor 0.0022 should be apply for TSP monitoring

*If $R < 0.5$, repair or re-verification is required for the equipment

Operator : Martin Li Signature :  Date : 14 January 2019

QC Reviewer : Ben Tam Signature :  Date : 14 January 2019

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location :	Gold King Industrial Building, Kwai Chung	Date of Calibration: 21-Dec-18
Location ID :	Calibration Room	Next Calibration Date: 21-Mar-19

CONDITIONS

Sea Level Pressure (hPa)	1016.1	Corrected Pressure (mm Hg)	762.075
Temperature (°C)	22.4	Temperature (K)	295

CALIBRATION ORIFICE

Make->	TISCH	Qstd Slope ->	2.02017
Model->	5025A	Qstd Intercept ->	-0.03691
Calibration Date->	13-Feb-18	Expiry Date->	13-Feb-19

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	5.7	5.7	11.4	1.699	56	56.32	Slope = 34.0074 Intercept = -0.4093 Corr. coeff. = 0.9972
13	4.4	4.4	8.8	1.495	51	51.29	
10	3.4	3.4	6.8	1.317	45	45.26	
8	2.3	2.3	4.6	1.086	36	36.21	
5	1.4	1.4	2.8	0.851	28	28.16	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta))-b]$$


$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate
 IC = corrected chart responses
 I = actual chart response
 m = calibrator Qstd slope
 b = calibrator Qstd intercept
 Ta = actual temperature during calibration (deg K)
 Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)]-b)$$

m = sampler slope
 b = sampler intercept
 I = chart response
 Tav = daily average temperature
 Pav = daily average pressure

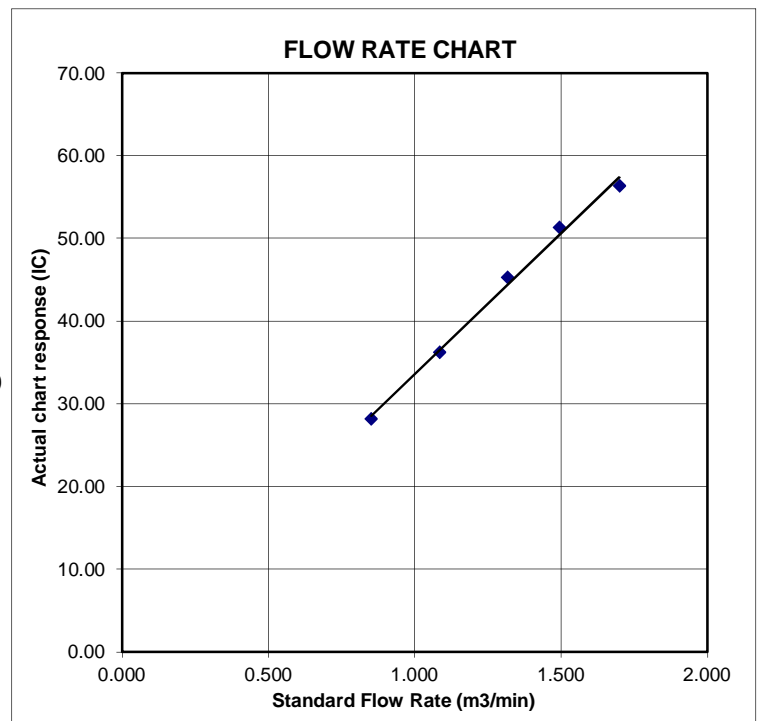

Certificate of Calibration

Calibration Certification Information

Cal. Date: February 13, 2018

Rootsmeter S/N: 438320

Ta: 293

°K

Operator: Jim Tisch

Pa: 763.3

mm Hg

Calibration Model #: TE-5025A

Calibrator S/N: 1612

Run	Vol. Init (m3)	Vol. Final (m3)	ΔVol. (m3)	ΔTime (min)	ΔP (mm Hg)	ΔH (in H2O)
1	1	2	1	1.3970	3.2	2.00
2	3	4	1	1.0000	6.3	4.00
3	5	6	1	0.8900	7.9	5.00
4	7	8	1	0.8440	8.7	5.50
5	9	10	1	0.7010	12.6	8.00

Data Tabulation

Vstd (m3)	Qstd (x-axis)	$\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)}$ (y-axis)	Va	Qa (x-axis)	$\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)}$ (y-axis)
1.0172	0.7281	1.4293	0.9958	0.7128	0.8762
1.0130	1.0130	2.0213	0.9917	0.9917	1.2392
1.0109	1.1358	2.2599	0.9896	1.1120	1.3854
1.0098	1.1964	2.3702	0.9886	1.1713	1.4530
1.0046	1.4331	2.8586	0.9835	1.4030	1.7524
QSTD	m=	2.02017	QA	m=	1.26500
	b=	-0.03691		b=	-0.02263
	r=	0.99988		r=	0.99988

Calculations

Vstd =	$\Delta Vol / ((Pa - \Delta P) / Pstd) (Tstd / Ta)$	Va =	$\Delta Vol / ((Pa - \Delta P) / Pa)$
Qstd =	$Vstd / \Delta Time$	Qa =	$Va / \Delta Time$
For subsequent flow rate calculations:			
Qstd =	$1/m \left(\left(\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)} \right) - b \right)$	Qa =	$1/m \left(\left(\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)} \right) - b \right)$

Standard Conditions

Tstd:	298.15 °K
Pstd:	760 mm Hg
Key	
ΔH: calibrator manometer reading (in H2O)	
ΔP: rootsmeter manometer reading (mm Hg)	
Ta: actual absolute temperature (°K)	
Pa: actual barometric pressure (mm Hg)	
b: intercept	
m: slope	

RECALIBRATION

US EPA recommends annual recalibration per 1998 40 Code of Federal Regulations Part 50 to 51, Appendix B to Part 50, Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere, 9.2.17, page 30



SUB-CONTRACTING REPORT

CONTACT	: MR BEN TAM	WORK ORDER	: HK1908929
CLIENT	: ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING		
ADDRESS	: RM A 20/F., GOLD KING IND BLDG, NO. 35-41 TAI LIN PAI ROAD, KWAI CHUNG, N.T. HONG KONG	SUB-BATCH	: 1
		DATE RECEIVED	: 25-FEB-2019
		DATE OF ISSUE	: 4-MAR-2019
PROJECT	: ----	NO. OF SAMPLES	: 1
		CLIENT ORDER	: ----

General Comments

- Sample(s) were received in ambient condition.
- Sample(s) analysed and reported on an as received basis.
- Calibration was subcontracted to and analysed by Action United Enviro Services.

Signatories

This document has been signed by those names that appear on this report and are the authorised signatories

Signatories

Position

Richard Fung

General Manager

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

ALS Technichem (HK) Pty Ltd
Part of the **ALS Laboratory Group**

11/F. Chung Shun Knitting Centre 1 - 3 Wing Yip Street Kwai Chung N.T. Hong Kong
Tel. +852 2610 1044 Fax. +852 2610 2021 www.alsglobal.com

WORK ORDER : HK1908929

SUB-BATCH : 1

CLIENT : ACTION UNITED ENVIRONMENT SERVICES AND CONSULTING

PROJECT : ----



ALS Lab ID	Client's Sample ID	Sample Type	Sample Date	External Lab Report No.
HK1908929-001	S/N: 366410	AIR	25-Feb-2019	S/N: 366410

Equipment Verification Report (TSP)

Equipment Calibrated:

Type: Laser Dust monitor
Manufacturer: Sibata LD-3B
Serial No. 366410
Equipment Ref: EQ110
Job Order HK1908929

Standard Equipment:

Standard Equipment: Higher Volume Sampler
Location & Location ID: AUES office (calibration room)
Equipment Ref: HVS 018
Last Calibration Date: 21 December 2018

Equipment Verification Results:

Testing Date: 7 January 2019


Hour	Time	Mean Temp °C	Mean Pressure (hPa)	Concentration in mg/m ³ (Standard Equipment)	Total Count (Calibrated Equipment)	Count/Minute (Total Count/60min)
2hr07min	09:01 ~ 11:08	18.5	1021.4	0.045	2377	18.8
2hr11min	11:13 ~ 13:24	18.5	1021.4	0.032	1522	11.6
2hr07min	13:30 ~ 15:37	18.5	1021.4	0.089	5117	40.4

Sensitivity Adjustment Scale Setting (Before Calibration) 674 (CPM)

Sensitivity Adjustment Scale Setting (After Calibration) 674 (CPM)

Linear Regression of Y or X

Slope (K-factor): 0.0022
Correlation Coefficient 0.9967
Date of Issue 14 January 2019

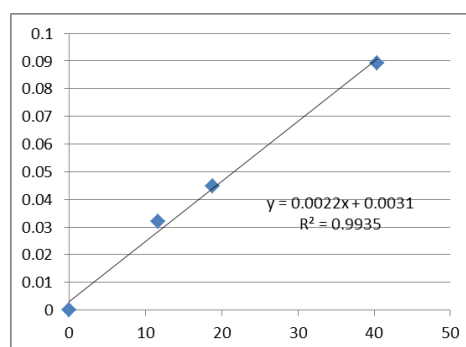

Remarks:

1. **Strong** Correlation ($R > 0.8$)
 2. Factor 0.0022 should be apply for TSP monitoring
- *If $R < 0.5$, repair or re-verification is required for the equipment

Operator : Martin Li Signature :  Date : 14 January 2019

QC Reviewer : Ben Tam Signature :  Date : 14 January 2019

TSP SAMPLER CALIBRATION CALCULATION SPREADSHEET

Location :	Gold King Industrial Building, Kwai Chung	Date of Calibration: 21-Dec-18
Location ID :	Calibration Room	Next Calibration Date: 21-Mar-19

CONDITIONS

Sea Level Pressure (hPa)	1016.1	Corrected Pressure (mm Hg)	762.075
Temperature (°C)	22.4	Temperature (K)	295

CALIBRATION ORIFICE

Make->	TISCH	Qstd Slope ->	2.02017
Model->	5025A	Qstd Intercept ->	-0.03691
Calibration Date->	13-Feb-18	Expiry Date->	13-Feb-19

CALIBRATION

Plate No.	H2O (L) (in)	H2O (R) (in)	H2O (in)	Qstd (m3/min)	I (chart)	IC corrected	LINEAR REGRESSION
18	5.7	5.7	11.4	1.699	56	56.32	Slope = 34.0074 Intercept = -0.4093 Corr. coeff. = 0.9972
13	4.4	4.4	8.8	1.495	51	51.29	
10	3.4	3.4	6.8	1.317	45	45.26	
8	2.3	2.3	4.6	1.086	36	36.21	
5	1.4	1.4	2.8	0.851	28	28.16	

Calculations :

$$Qstd = 1/m[\text{Sqrt}(H2O(Pa/Pstd)(Tstd/Ta))-b]$$


$$IC = I[\text{Sqrt}(Pa/Pstd)(Tstd/Ta)]$$

Qstd = standard flow rate
 IC = corrected chart responses
 I = actual chart response
 m = calibrator Qstd slope
 b = calibrator Qstd intercept
 Ta = actual temperature during calibration (deg K)
 Pstd = actual pressure during calibration (mm Hg)

For subsequent calculation of sampler flow:

$$1/m((I) [\text{Sqrt}(298/Tav)(Pav/760)]-b)$$

m = sampler slope
 b = sampler intercept
 I = chart response
 Tav = daily average temperature
 Pav = daily average pressure

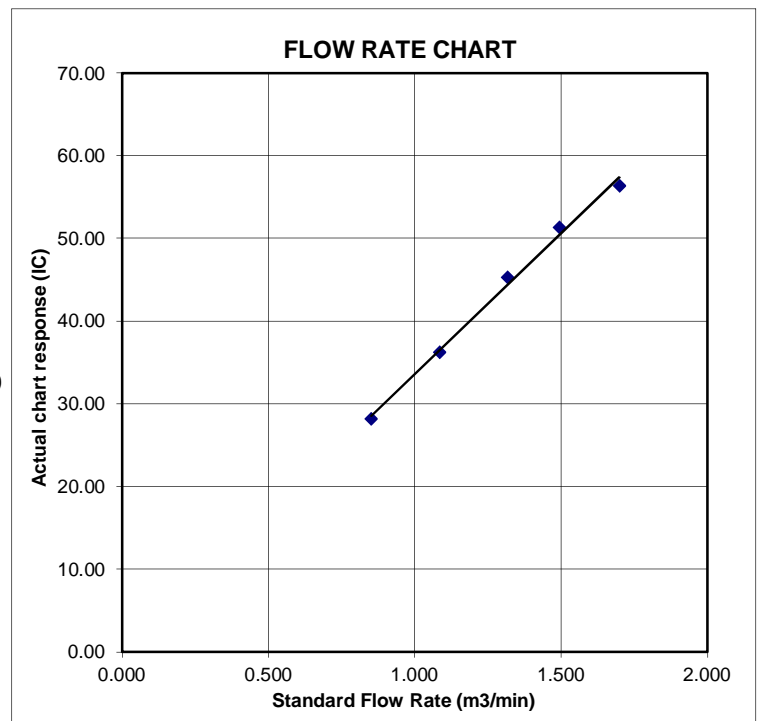

Certificate of Calibration

Calibration Certification Information

Cal. Date: February 13, 2018

Rootsmeter S/N: 438320

Ta: 293

°K

Operator: Jim Tisch

Pa: 763.3

mm Hg

Calibration Model #: TE-5025A

Calibrator S/N: 1612

Run	Vol. Init (m3)	Vol. Final (m3)	ΔVol. (m3)	ΔTime (min)	ΔP (mm Hg)	ΔH (in H2O)
1	1	2	1	1.3970	3.2	2.00
2	3	4	1	1.0000	6.3	4.00
3	5	6	1	0.8900	7.9	5.00
4	7	8	1	0.8440	8.7	5.50
5	9	10	1	0.7010	12.6	8.00

Data Tabulation

Vstd (m3)	Qstd (x-axis)	$\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)}$ (y-axis)	Va	Qa (x-axis)	$\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)}$ (y-axis)
1.0172	0.7281	1.4293	0.9958	0.7128	0.8762
1.0130	1.0130	2.0213	0.9917	0.9917	1.2392
1.0109	1.1358	2.2599	0.9896	1.1120	1.3854
1.0098	1.1964	2.3702	0.9886	1.1713	1.4530
1.0046	1.4331	2.8586	0.9835	1.4030	1.7524
QSTD	m=	2.02017	QA	m=	1.26500
	b=	-0.03691		b=	-0.02263
	r=	0.99988		r=	0.99988

Calculations

Vstd =	$\Delta Vol / ((Pa - \Delta P) / Pstd) (Tstd / Ta)$	Va =	$\Delta Vol / ((Pa - \Delta P) / Pa)$
Qstd =	$Vstd / \Delta Time$	Qa =	$Va / \Delta Time$
For subsequent flow rate calculations:			
Qstd =	$1/m \left(\left(\sqrt{\Delta H \left(\frac{Pa}{Pstd} \right) \left(\frac{Tstd}{Ta} \right)} \right) - b \right)$	Qa =	$1/m \left(\left(\sqrt{\Delta H \left(\frac{Ta}{Pa} \right)} \right) - b \right)$

Standard Conditions

Tstd:	298.15 °K
Pstd:	760 mm Hg
Key	
ΔH: calibrator manometer reading (in H2O)	
ΔP: rootsmeter manometer reading (mm Hg)	
Ta: actual absolute temperature (°K)	
Pa: actual barometric pressure (mm Hg)	
b: intercept	
m: slope	

RECALIBRATION

US EPA recommends annual recalibration per 1998 40 Code of Federal Regulations Part 50 to 51, Appendix B to Part 50, Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere, 9.2.17, page 30

Certificate of Calibration

校正證書

Certificate No. : C183260

證書編號

ITEM TESTED / 送檢項目 (Job No. / 序引編號 : IC18-0867)

Date of Receipt / 收件日期 : 12 June 2018

Description / 儀器名稱 : Sound Calibrator (EQ083)

Manufacturer / 製造商 : Rion

Model No. / 型號 : NC-74

Serial No. / 編號 : 34246492

Supplied By / 委託者 : Action-United Environmental Services and Consulting
Unit A, 20/F., Gold King Industrial Building,
35-41 Tai Lin Pai Road, Kwai Chung, N.T.

TEST CONDITIONS / 測試條件

Temperature / 溫度 : $(23 \pm 2)^{\circ}\text{C}$

Relative Humidity / 相對濕度 : $(50 \pm 25)\%$

Line Voltage / 電壓 : ---

TEST SPECIFICATIONS / 測試規範

Calibration check

DATE OF TEST / 測試日期 : 18 June 2018

TEST RESULTS / 測試結果

The results apply to the particular unit-under-test only.


The results do not exceed manufacturer's specification.

The results are detailed in the subsequent page(s).


The test equipment used for calibration are traceable to National Standards via :

- The Government of The Hong Kong Special Administrative Region Standard & Calibration Laboratory
- Agilent Technologies / Keysight Technologies
- Rohde & Schwarz Laboratory, Germany
- Fluke Everett Service Center, USA

Tested By :
測試


H T Wong
Technical Officer

Certified By :
核證


K C Lee
Engineer

Date of Issue : 20 June 2018
簽發日期

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Certificate of Calibration

校正證書

Certificate No. : C183260

證書編號

1. The unit-under-test (UUT) was allowed to stabilize in the laboratory for over 12 hours before the commencement of the test.
2. The results presented are the mean of 3 measurements at each calibration point.
3. Test equipment :

Equipment ID	Description	Certificate No.
CL130	Universal Counter	C173864
CL281	Multifunction Acoustic Calibrator	PA160023
TST150A	Measuring Amplifier	C181288

4. Test procedure : MA100N.

5. Results :

5.1 Sound Level Accuracy

UUT Nominal Value	Measured Value (dB)	Mfr's Spec. (dB)	Uncertainty of Measured Value (dB)
94 dB, 1 kHz	94.0	± 0.3	± 0.2

5.2 Frequency Accuracy

UUT Nominal Value (kHz)	Measured Value (kHz)	Mfr's Spec.	Uncertainty of Measured Value (Hz)
1	1.001	1 kHz ± 1 %	± 1

Remark : The uncertainties are for a confidence probability of not less than 95 %.

Note :

Only the original copy or the laboratory's certified true copy is valid.

The values given in this Certificate only relate to the values measured at the time of the test and any uncertainties quoted will not include allowance for the equipment long term drift, variations with environment changes, vibration and shock during transportation, overloading, mis-handling, or the capability of any other laboratory to repeat the measurement. Sun Creation Engineering Limited shall not be liable for any loss or damage resulting from the use of the equipment.

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606 Fax/傳真: (852) 2744 8986

E-mail/電郵: callab@suncreation.com

Website/網址: www.suncreation.com

Certificate of Calibration

校正證書

Certificate No. : C183085
證書編號

ITEM TESTED / 送檢項目 (Job No. / 序引編號 : IC18-0867)

Date of Receipt / 收件日期 : 28 May 2018

Description / 儀器名稱 : Integrating Sound Level Meter (EQ006)
Manufacturer / 製造商 : Brüel & Kjær
Model No. / 型號 : 2238
Serial No. / 編號 : 2285762
Supplied By / 委託者 : Action-United Environmental Services and Consulting
Unit A, 20/F., Gold King Industrial Building,
35-41 Tai Lin Pai Road, Kwai Chung, N.T.

TEST CONDITIONS / 測試條件

Temperature / 溫度 : $(23 \pm 2)^{\circ}\text{C}$
Line Voltage / 電壓 : ---

Relative Humidity / 相對濕度 : $(50 \pm 25)\%$

TEST SPECIFICATIONS / 測試規範

Calibration check

DATE OF TEST / 測試日期 : 10 June 2018

TEST RESULTS / 測試結果

The results apply to the particular unit-under-test only.
The results do not exceed manufacturer's specification.
The results are detailed in the subsequent page(s).


The test equipment used for calibration are traceable to National Standards via :

- The Government of The Hong Kong Special Administrative Region Standard & Calibration Laboratory
- Agilent Technologies / Keysight Technologies
- Rohde & Schwarz Laboratory, Germany
- Fluke Everett Service Center, USA

Tested By
測試


K C Lee
Engineer

Certified By
核證

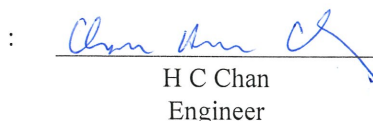
H C Chan
Engineer

Date of Issue : 11 June 2018
簽發日期

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗所書面批准。

Certificate of Calibration

校正證書

Certificate No. : C183085
證書編號

- The unit-under-test (UUT) was allowed to stabilize in the laboratory for over 12 hours, and switched on to warm up for over 10 minutes before the commencement of the test.
- Self-calibration using laboratory acoustic calibrator was performed before the test from 6.1.1.2 to 6.4.
- The results presented are the mean of 3 measurements at each calibration point.
- Test equipment :

Equipment ID	Description	Certificate No.
CL280	40 MHz Arbitrary Waveform Generator	C180024
CL281	Multifunction Acoustic Calibrator	PA160023

- Test procedure : MA101N.

- Results :

- 6.1 Sound Pressure Level

- 6.1.1 Reference Sound Pressure Level

- 6.1.1.1 Before Self-calibration

UUT Setting				Applied Value		UUT Reading
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	(dB)
52 - 132	L _{AFP}	A	F	94.00	1	94.1

- 6.1.1.2 After Self-calibration

UUT Setting				Applied Value		UUT Reading	IEC 60651 Type 1 Spec.
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	(dB)	(dB)
52 - 132	L _{AFP}	A	F	94.00	1	94.0	± 0.7

- 6.1.2 Linearity

UUT Setting				Applied Value		UUT Reading
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	(dB)
52 - 132	L _{AFP}	A	F	94.00	1	94.0 (Ref.)
				104.00		104.0
				114.00		114.0

IEC 60651 Type 1 Spec. : ± 0.4 dB per 10 dB step and ± 0.7 dB for overall different.

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606 Fax/傳真: (852) 2744 8986

E-mail/電郵: callab@suncreation.com

Website/網址: www.suncreation.com

Certificate of Calibration

校正證書

Certificate No. : C183085
證書編號

6.2 Time Weighting

6.2.1 Continuous Signal

UUT Setting				Applied Value		UUT	IEC 60651
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	Reading (dB)	Type 1 Spec. (dB)
52 - 132	L _{AFP}	A	F	94.00	1	94.0	Ref.
	L _{ASP}		S			94.0	± 0.1
	L _{AIP}		I			94.1	± 0.1

6.2.2 Tone Burst Signal (2 kHz)

UUT Setting				Applied Value		UUT Reading (dB)	IEC 60651 Type 1 Spec. (dB)
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Burst Duration		
32 - 112	L _{AFP}	A	F	106.0	Continuous	106.0	Ref.
	L _{AFMax}				200 ms	104.9	-1.0 ± 1.0
	L _{ASP}	S	Continuous		106.0	Ref.	
	L _{ASMax}		500 ms		102.0	-4.1 ± 1.0	

6.3 Frequency Weighting

6.3.1 A-Weighting

UUT Setting				Applied Value		UUT	IEC 60651
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq.	Reading (dB)	Type 1 Spec. (dB)
52 - 132	L _{AFP}	A	F	94.00	31.5 Hz	55.0	-39.4 ± 1.5
					63 Hz	67.9	-26.2 ± 1.5
					125 Hz	77.8	-16.1 ± 1.0
					250 Hz	85.3	-8.6 ± 1.0
					500 Hz	90.7	-3.2 ± 1.0
					1 kHz	94.0	Ref.
					2 kHz	95.2	+1.2 ± 1.0
					4 kHz	95.0	+1.0 ± 1.0
					8 kHz	92.9	-1.1 (+1.5 ; -3.0)
					12.5 kHz	89.8	-4.3 (+3.0 ; -6.0)

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606 Fax/傳真: (852) 2744 8986 E-mail/電郵: callab@suncreation.com Website/網址: www.suncreation.com

Certificate of Calibration

校正證書

Certificate No. : C183085

證書編號

6.3.2 C-Weighting

UUT Setting				Applied Value		UUT Reading (dB)	IEC 60651 Type 1 Spec. (dB)
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq.		
52 - 132	L _{CFP}	C	F	94.00	31.5 Hz	91.4	-3.0 ± 1.5
					63 Hz	93.3	-0.8 ± 1.5
					125 Hz	93.8	-0.2 ± 1.0
					250 Hz	94.0	0.0 ± 1.0
					500 Hz	94.0	0.0 ± 1.0
					1 kHz	94.0	Ref.
					2 kHz	93.8	-0.2 ± 1.0
					4 kHz	93.2	-0.8 ± 1.0
					8 kHz	90.9	-3.0 (+1.5 ; -3.0)
					12.5 kHz	87.8	-6.2 (+3.0 ; -6.0)

6.4 Time Averaging

UUT Setting				Applied Value					UUT Reading (dB)	IEC 60804 Type 1 Spec. (dB)
Range (dB)	Parameter	Frequency Weighting	Integrating Time	Frequency (kHz)	Burst Duration (ms)	Burst Duty Factor	Burst Level (dB)	Equivalent Level (dB)		
32 - 112	L _{Aeq}	A	10 sec.	4	1	1/10	110.0	100	100.0	± 0.5
						1/10 ²		90	89.5	± 0.5
			60 sec.			1/10 ³		80	79.2	± 1.0
			5 min.			1/10 ⁴		70	69.3	± 1.0

Remarks : - UUT Microphone Model No. : 4188 & S/N : 2812706

- Mfr's Spec. : IEC 60651 Type 1 & IEC 60804 Type 1

- Uncertainties of Applied Value :

94 dB	31.5 Hz - 125 Hz	: ± 0.35 dB
	250 Hz - 500 Hz	: ± 0.30 dB
	1 kHz	: ± 0.20 dB
	2 kHz - 4 kHz	: ± 0.35 dB
	8 kHz	: ± 0.45 dB
	12.5 kHz	: ± 0.70 dB
104 dB	1 kHz	: ± 0.10 dB (Ref. 94 dB)
114 dB	1 kHz	: ± 0.10 dB (Ref. 94 dB)
Burst equivalent level		: ± 0.2 dB (Ref. 110 dB continuous sound level)

- The uncertainties are for a confidence probability of not less than 95 %.

Note :

Only the original copy or the laboratory's certified true copy is valid.

The values given in this Certificate only relate to the values measured at the time of the test and any uncertainties quoted will not include allowance for the equipment long term drift, variations with environment changes, vibration and shock during transportation, overloading, mis-handling, or the capability of any other laboratory to repeat the measurement. Sun Creation Engineering Limited shall not be liable for any loss or damage resulting from the use of the equipment.

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室所書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606

Fax/傳真: (852) 2744 8986

E-mail/電郵: callab@suncreation.com

Website/網址: www.suncreation.com

Certificate of Calibration

校正證書

Certificate No. : C183441

證書編號

ITEM TESTED / 送檢項目 (Job No. / 序引編號 : IC18-0867)

Date of Receipt / 收件日期 : 13 June 2018

Description / 儀器名稱 : Integrating Sound Level Meter (EQ008)
Manufacturer / 製造商 : Brüel & Kjær
Model No. / 型號 : 2238
Serial No. / 編號 : 2285690
Supplied By / 委託者 : Action-United Environmental Services and Consulting
Unit A, 20/F., Gold King Industrial Building,
35-41 Tai Lin Pai Road, Kwai Chung, N.T.

TEST CONDITIONS / 測試條件

Temperature / 溫度 : $(23 \pm 2)^{\circ}\text{C}$

Relative Humidity / 相對濕度 : $(50 \pm 25)\%$

Line Voltage / 電壓 : ---

TEST SPECIFICATIONS / 測試規範

Calibration check

DATE OF TEST / 測試日期 : 23 June 2018

TEST RESULTS / 測試結果


The results apply to the particular unit-under-test only.
The results do not exceed manufacturer's specification.
The results are detailed in the subsequent page(s).

The test equipment used for calibration are traceable to National Standards via :

- The Government of The Hong Kong Special Administrative Region Standard & Calibration Laboratory
- Agilent Technologies / Keysight Technologies
- Rohde & Schwarz Laboratory, Germany
- Fluke Everett Service Center, USA


Tested By

測試

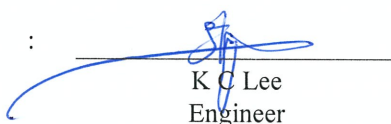
K C Lee
Engineer

Certified By

核證

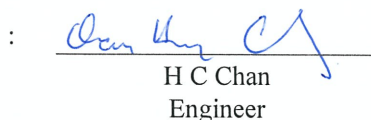
H C Chan
Engineer

Date of Issue

簽發日期

29 June 2018

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Certificate of Calibration

校正證書

Certificate No. : C183441

證書編號

- The unit-under-test (UUT) was allowed to stabilize in the laboratory for over 12 hours, and switched on to warm up for over 10 minutes before the commencement of the test.
- Self-calibration using laboratory acoustic calibrator was performed before the test from 6.1.1.2 to 6.4.
- The results presented are the mean of 3 measurements at each calibration point.
- Test equipment :

Equipment ID	Description	Certificate No.
CL280	40 MHz Arbitrary Waveform Generator	C180024
CL281	Multifunction Acoustic Calibrator	PA160023

- Test procedure : MA101N.

- Results :

6.1 Sound Pressure Level

6.1.1 Reference Sound Pressure Level

6.1.1.1 Before Self-calibration

UUT Setting				Applied Value		UUT Reading
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	(dB)
50 - 130	L _{AFP}	A	F	94.00	1	94.2

6.1.1.2 After Self-calibration

UUT Setting				Applied Value		UUT Reading	IEC 60651 Type 1 Spec.
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	(dB)	(dB)
50 - 130	L _{AFP}	A	F	94.00	1	94.1	± 0.7

6.1.2 Linearity

UUT Setting				Applied Value		UUT Reading
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)	(dB)
50 - 130	L _{AFP}	A	F	94.00	1	94.1 (Ref.)
				104.00		104.1
				114.00		114.0

IEC 60651 Type 1 Spec. : ± 0.4 dB per 10 dB step and ± 0.7 dB for overall different.

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室所書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606

Fax/傳真: (852) 2744 8986

E-mail/電郵: callab@suncreation.com

Website/網址: www.suncreation.com

Page 2 of 4

Certificate of Calibration

校正證書

Certificate No. : C183441

證書編號

6.2 Time Weighting

6.2.1 Continuous Signal

UUT Setting				Applied Value		UUT Reading (dB)	IEC 60651 Type 1 Spec. (dB)
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq. (kHz)		
50 - 130	L _{AFP}	A	F	94.00	1	94.1	Ref.
	L _{ASP}		S			94.2	± 0.1
	L _{AIP}		I			94.1	± 0.1

6.2.2 Tone Burst Signal (2 kHz)

UUT Setting				Applied Value		UUT Reading (dB)	IEC 60651 Type 1 Spec. (dB)
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Burst Duration		
30 - 110	L _{AFP}	A	F	106.0	Continuous	106.0	Ref.
	L _{AFMax}				200 ms	105.0	-1.0 ± 1.0
	L _{ASP}	S	Continuous		106.0	Ref.	
	L _{ASMax}		500 ms		102.0	-4.1 ± 1.0	

6.3 Frequency Weighting

6.3.1 A-Weighting

UUT Setting				Applied Value		UUT Reading (dB)	IEC 60651 Type 1 Spec. (dB)
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq.		
50 - 130	L _{AFP}	A	F	94.00	31.5 Hz	54.8	-39.4 ± 1.5
					63 Hz	68.0	-26.2 ± 1.5
					125 Hz	77.9	-16.1 ± 1.0
					250 Hz	85.4	-8.6 ± 1.0
					500 Hz	90.8	-3.2 ± 1.0
					1 kHz	94.1	Ref.
					2 kHz	95.3	+1.2 ± 1.0
					4 kHz	95.1	+1.0 ± 1.0
					8 kHz	93.0	-1.1 (+1.5 ; -3.0)
					12.5 kHz	89.9	-4.3 (+3.0 ; -6.0)

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606

Fax/傳真: (852) 2744 8986

E-mail/電郵: callab@suncreation.com

Website/網址: www.suncreation.com

Page 3 of 4

Certificate of Calibration

校正證書

Certificate No. : C183441

證書編號

6.3.2 C-Weighting

UUT Setting				Applied Value		UUT	IEC 60651
Range (dB)	Parameter	Frequency Weighting	Time Weighting	Level (dB)	Freq.	Reading (dB)	Type 1 Spec. (dB)
50 - 130	L _{CFF}	C	F	94.00	31.5 Hz	91.2	-3.0 ± 1.5
					63 Hz	93.3	-0.8 ± 1.5
					125 Hz	93.9	-0.2 ± 1.0
					250 Hz	94.1	0.0 ± 1.0
					500 Hz	94.1	0.0 ± 1.0
					1 kHz	94.1	Ref.
					2 kHz	93.9	-0.2 ± 1.0
					4 kHz	93.3	-0.8 ± 1.0
					8 kHz	91.1	-3.0 (+1.5 ; -3.0)
					12.5 kHz	88.0	-6.2 (+3.0 ; -6.0)

6.4 Time Averaging

UUT Setting				Applied Value					UUT	IEC 60804
Range (dB)	Parameter	Frequency Weighting	Integrating Time	Frequency (kHz)	Burst Duration (ms)	Burst Duty Factor	Burst Level (dB)	Equivalent Level (dB)	Reading (dB)	Type 1 Spec. (dB)
30 - 110	L _{Aeq}	A	10 sec.	4	1	1/10	110.0	100	99.9	± 0.5
								90	89.7	± 0.5
			60 sec.					80	79.7	± 1.0
			5 min.					70	69.7	± 1.0

Remarks : - UUT Microphone Model No. : 4188 & S/N : 2812705

- Mfr's Spec. : IEC 60651 Type 1 & IEC 60804 Type 1

- Uncertainties of Applied Value :

94 dB : 31.5 Hz - 125 Hz	: ± 0.35 dB
250 Hz - 500 Hz	: ± 0.30 dB
1 kHz	: ± 0.20 dB
2 kHz - 4 kHz	: ± 0.35 dB
8 kHz	: ± 0.45 dB
12.5 kHz	: ± 0.70 dB
104 dB : 1 kHz	: ± 0.10 dB (Ref. 94 dB)
114 dB : 1 kHz	: ± 0.10 dB (Ref. 94 dB)
Burst equivalent level	: ± 0.2 dB (Ref. 110 dB continuous sound level)

- The uncertainties are for a confidence probability of not less than 95 %.

Note :

Only the original copy or the laboratory's certified true copy is valid.

The values given in this Certificate only relate to the values measured at the time of the test and any uncertainties quoted will not include allowance for the equipment long term drift, variations with environment changes, vibration and shock during transportation, overloading, mis-handling, or the capability of any other laboratory to repeat the measurement. Sun Creation Engineering Limited shall not be liable for any loss or damage resulting from the use of the equipment.

The test equipment used for calibration are traceable to the Nation Standards as specified in this certificate. This certificate shall not be reproduced except in full, without the prior written approval of this laboratory.

本證書所載校正用之測試器材均可溯源至國際標準。局部複印本證書需先獲本實驗室書面批准。

Sun Creation Engineering Limited – Calibration & Testing Laboratory

c/o 4/F, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

輝創工程有限公司 — 校正及檢測實驗室

c/o 香港新界屯門興安里一號四樓

Tel/電話: (852) 2927 2606

Fax/傳真: (852) 2744 8986

E-mail/電郵: callab@suncreation.com

Website/網址: www.suncreation.com

Page 4 of 4



Hong Kong Accreditation Service
香港認可處

Certificate of Accreditation
認可證書

This is to certify that
特此證明

ALS TECHNICHEM (HK) PTY LIMITED

11/F., Chung Shun Knitting Centre, 1-3 Wing Yip Street, Kwai Chung, New Territories, Hong Kong
香港新界葵涌永業街1-3號忠信針織中心11樓

has been accepted by the HKAS Executive, on the recommendation of the Accreditation Advisory Board, as a
為香港認可處執行機關根據認可諮詢委員會建議而接受的

HOKLAS Accredited Laboratory
「香港實驗所認可計劃」認可實驗所

This laboratory meets the requirements of ISO / IEC 17025 : 2005 – General requirements for the competence
此實驗所符合ISO / IEC 17025 : 2005 – 《測試及校正實驗所能力的通用規定》所訂的要求，
of testing and calibration laboratories and it has been accredited for performing specific tests or calibrations as
獲認可進行載於香港實驗所認可計劃《認可實驗所名冊》內下述測試類別中的指定
listed in the HOKLAS Directory of Accredited Laboratories within the test category of
測試或校正工作

Environmental Testing
環境測試

This laboratory is accredited in accordance with the recognised International Standard ISO / IEC 17025 : 2005.
本實驗所乃根據公認的國際標準 ISO / IEC 17025 : 2005 獲得認可。


This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory
這項認可資格演示在指定範疇所需的技術能力及實驗所質量管理體系的運作
quality management system (see joint IAF-ILAC-ISO Communiqué).
(見國際認可論壇、國際實驗所認可合作組織及國際標準化組織的聯合公報)。

The common seal of the Hong Kong Accreditation Service is affixed hereto by the authority of the HKAS Executive
香港認可處根據認可處執行機關的權限在此蓋上通用印章

CHAN Sing Sing, Terence, Executive Administrator
執行幹事 陳成城
Issue Date : 5 May 2009
簽發日期：二零零九年五月五日

Registration Number : **HOKLAS 066**
註冊號碼：

Date of First Registration : 15 September 1995
首次註冊日期：一九九五年九月十五日

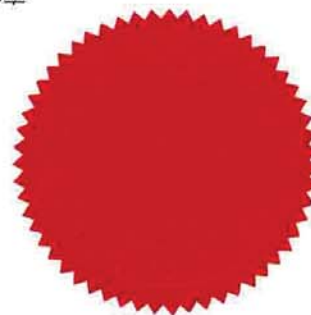

Appendix F

Event and Action Plan

Event / Action Plan for construction dust

Event	Action			
	ET	IEC	ER	Contractor
Action Level exceedance for one sample	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Inform IEC, ER and Contractor; 3. Repeat measurement to confirm finding; and 4. Increase monitoring frequency to daily.	1. Check monitoring data submitted by ET; 2. Check Contractor's working method; and 3. Review and advise the ET and ER on the effectiveness of the proposed remedial measures.	1. Notify Contractor.	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Rectify any unacceptable practice and implement remedial measures; and 3. Amend working methods agreed with ER if appropriate.
Action Level exceedance for two or more consecutive samples	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Inform IEC, ER and Contractor; 3. Advise the ER and Contractor on the effectiveness of the proposed remedial measures; 4. Repeat measurements to confirm findings; 5. Increase monitoring frequency to daily; 6. Discuss with IEC, ER and Contractor on remedial actions required; 7. If exceedance continues, arrange meeting with IEC and ER; and 8. If exceedance stops, cease additional monitoring.	1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss with ET and Contractor on possible remedial measures; 4. Advise the ET and ER on the effectiveness of the proposed remedial measures; and 5. Supervise Implementation of remedial measures.	1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; and 3. Supervise and ensure remedial measures properly implemented.	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Submit proposals for remedial actions to ER with a copy to ET and IEC within 3 working days of notification; 3. Implement the agreed proposals; and 4. Amend proposal if appropriate.
Limit Level exceedance for one sample	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Inform ER, Contractor, IEC and EPD; 3. Repeat measurement to confirm finding; 4. Increase monitoring frequency to daily; and 5. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results.	1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss with ET, ER and Contractor on possible remedial measures; 4. Advise the ER and ET on the effectiveness of the proposed remedial measures; and 5. Supervise implementation of remedial measures.	1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; and 3. Supervise and ensure remedial measures properly implemented.	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Take immediate action to avoid further exceedance; 3. Submit proposals for remedial actions to ER with a copy to ET and IEC within 3 working days of notification; 4. Implement the agreed proposals; and 5. Amend proposal if appropriate.
Limit Level exceedance for two or more consecutive samples	1. Notify IEC, ER, Contractor and EPD; 2. Identify source; 3. Repeat measurement to confirm findings; 4. Increase monitoring frequency to daily; 5. Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented; 6. Arrange meeting with IEC, Contractor and ER to discuss the remedial actions to be taken; 7. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results; and 8. If exceedance stops, cease additional monitoring.	1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss amongst ER, ET, and Contractor on the potential remedial actions; 4. Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly; and 5. Supervise the implementation of remedial measures.	1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. In consultation with the ET and IEC, agree with the Contractor on the remedial measures to be implemented; 4. Supervise and ensure remedial measures properly implemented; and 5. If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated.	1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Take immediate action to avoid further exceedance; 3. Submit proposals for remedial actions to ER with a copy to ET and IEC within 3 working days of notification; 4. Implement the agreed proposals; 5. Resubmit proposals if problem still not under control; and 6. Stop the relevant portion of works as determined by the ER until the exceedance is abated.

Event and Action Plan for Construction Noise

Event	Action			
	ET	IEC	ER	Contractor
Action Level Exceedance	<ol style="list-style-type: none"> 1. Notify IEC, ER and Contractor; 2. Carry out investigation; 3. Report the results of investigation to the IEC, ER and Contractor; 4. Discuss with the Contractor and formulate remedial measures; and 5. Increase monitoring frequency to check mitigation effectiveness. 	<ol style="list-style-type: none"> 1. Review the analysed results submitted by the ET; 2. Review the proposed remedial measures by the Contractor and advise the ER accordingly; and 3. Supervise the implementation of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. Require Contractor to propose remedial measures for the analysed noise problem; and 4. Ensure remedial measures are properly implemented. 	<ol style="list-style-type: none"> 1. Submit noise mitigation proposals to IEC and ER; and 2. Implement noise mitigation proposals.
Limit Level Exceedance	<ol style="list-style-type: none"> 1. Identify source; 2. Inform IEC, ER, EPD and Contractor; 3. Repeat measurements to confirm findings; 4. Increase monitoring frequency; 5. Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented; 6. Inform IEC, ER and EPD the causes and actions taken for the exceedances; 7. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results; and 8. If exceedance stops, cease additional monitoring. 	<ol style="list-style-type: none"> 1. Discuss amongst ER, ET, and Contractor on the potential remedial actions; 2. Review Contractors remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly; and 3. Supervise the implementation of remedial measures. 	<ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. Require Contractor to propose remedial measures for the analysed noise problem; 4. Ensure remedial measures properly implemented; and 5. If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated. 	<ol style="list-style-type: none"> 1. Take immediate action to avoid further exceedance; 2. Submit proposals for remedial actions to IEC within 3 working days of notification; 3. Implement the agreed proposals; 4. Resubmit proposals if problem still not under control; and 5. Stop the relevant portion of works as determined by the ER until the exceedance is abated.

Appendix G

Impact Monitoring Schedule

Impact Monitoring Schedule for the Reporting Period

Date		Noise Monitoring (0700 – 1900)	Air Quality Monitoring	
			1-hour TSP	24-hour TSP
Fri	1-Mar-19			
Sat	2-Mar-19			
Sun	3-Mar-19			
Mon	4-Mar-19			✓
Tue	5-Mar-19	✓	✓	
Wed	6-Mar-19			
Thu	7-Mar-19			
Fri	8-Mar-19			
Sat	9-Mar-19			✓
Sun	10-Mar-19			
Mon	11-Mar-19	✓	✓	
Tue	12-Mar-19			
Wed	13-Mar-19			
Thu	14-Mar-19			
Fri	15-Mar-19			✓
Sat	16-Mar-19		✓	
Sun	17-Mar-19			
Mon	18-Mar-19			
Tue	19-Mar-19			
Wed	20-Mar-19			
Thu	21-Mar-19			✓
Fri	22-Mar-19	✓	✓	
Sat	23-Mar-19			
Sun	24-Mar-19			
Mon	25-Mar-19			
Tue	26-Mar-19			
Wed	27-Mar-19			✓
Thu	28-Mar-19	✓	✓	
Fri	29-Mar-19			
Sat	30-Mar-19			
Sun	31-Mar-19			

✓	Monitoring Day
	Sunday or Public Holiday

Impact Monitoring Schedule for next Reporting Period

Date		Noise Monitoring (0700 – 1900)	Air Quality Monitoring	
			1-hour TSP	24-hour TSP
Mon	1-Apr-19			
Tue	2-Apr-19			✓
Wed	3-Apr-19	✓	✓	
Thu	4-Apr-19			
Fri	5-Apr-19			
Sat	6-Apr-19			
Sun	7-Apr-19			
Mon	8-Apr-19			✓
Tue	9-Apr-19	✓	✓	
Wed	10-Apr-19			
Thu	11-Apr-19			
Fri	12-Apr-19			
Sat	13-Apr-19			✓
Sun	14-Apr-19			
Mon	15-Apr-19	✓	✓	
Tue	16-Apr-19			
Wed	17-Apr-19			
Thu	18-Apr-19		✓	✓
Fri	19-Apr-19			
Sat	20-Apr-19			
Sun	21-Apr-19			
Mon	22-Apr-19			
Tue	23-Apr-19	✓	✓	
Wed	24-Apr-19			✓
Thu	25-Apr-19			
Fri	26-Apr-19			
Sat	27-Apr-19			
Sun	28-Apr-19			
Mon	29-Apr-19	✓	✓	
Tue	30-Apr-19			✓

✓	Monitoring Day
	Sunday or Public Holiday

Appendix H

Database of Monitoring Result

24-HOUR TSP MONITORING RESULT DATABASE

24-hour TSP Monitoring Data for AMS-1															
DATE	SAMPLE NUMBER	ELAPSED TIME			CHART READING			AVG TEMP	AVG AIR PRESS	STANDARD FLOW RATE	AIR VOLUME	FILTER WEIGHT (g)		DUST WEIGHT COLLECTED	24-hr TSP (µg/m ³)
		INITIAL	FINAL	(min)	MIN	MAX	AVG	(°C)	(hPa)	(m ³ /min)	(std m ³)	INITIAL	FINAL	(g)	
4-Mar-19	23775	15356.32	15380.32	1440.0	36	37	36.5	18.3	1017	1.29	1863	2.6245	2.7745	0.1500	81
9-Mar-19	23887	15380.32	15404.82	1470.0	38	40	39	17.8	1012.2	1.37	2009	2.6547	2.7227	0.0680	34
22-Mar-19	23877	15404.82	15428.52	1422.0	36	36	36	18.7	1020.6	1.28	1820	2.6597	2.708	0.0483	27
25-Mar-19	23845	15428.52	15452.52	1440.0	38	38	38	25.3	1011.4	1.32	1904	2.6201	2.6628	0.0427	22
27-Mar-19	23882	15452.52	15476.53	1440.6	42	42	42	20	1014.9	1.39	2007	2.686	2.7677	0.0817	41
24-hour TSP Monitoring Data for AMS-5															
DATE	SAMPLE NUMBER	ELAPSED TIME			CHART READING			AVG TEMP	AVG AIR PRESS	STANDARD FLOW RATE	AIR VOLUME	FILTER WEIGHT (g)		DUST WEIGHT COLLECTED	24-hr TSP (µg/m ³)
		INITIAL	FINAL	(min)	MIN	MAX	AVG	(°C)	(hPa)	(m ³ /min)	(std m ³)	INITIAL	FINAL	(g)	
4-Mar-19	23781	7235.96	7259.57	1416.60	26	28	27.0	20.9	1013.7	0.95	1344	2.6200	2.6547	0.0347	26
9-Mar-19	23836	7259.57	7283.10	1411.80	32	34	33.0	17.8	1012.2	1.13	1595	2.6104	2.6330	0.0226	14
15-Mar-19	23839	7283.10	7306.60	1410.00	32	34	33.0	18.7	1020.6	1.13	1597	2.6159	2.6650	0.0491	31
21-Mar-19	23841	7306.60	7330.20	1416.00	33	34	33.5	19.8	1014.6	1.14	1618	2.6206	2.6636	0.0430	27
27-Mar-19	23585	7330.20	7353.70	1410.00	30	32	31.0	20	1014.9	1.04	1463	2.6654	2.6893	0.0239	16
24-hour TSP Monitoring Data for AMS-6															
DATE	SAMPLE NUMBER	ELAPSED TIME			CHART READING			AVG TEMP	AVG AIR PRESS	STANDARD FLOW RATE	AIR VOLUME	FILTER WEIGHT (g)		DUST WEIGHT COLLECTED	24-hr TSP (µg/m ³)
		INITIAL	FINAL	(min)	MIN	MAX	AVG	(°C)	(hPa)	(m ³ /min)	(std m ³)	INITIAL	FINAL	(g)	
4-Mar-19	23780	12453.38	12477.02	1418.40	30	32	31.0	20.9	1013.7	1.04	1471	2.6179	2.6717	0.0538	37
9-Mar-19	23782	12477.02	12500.72	1422.00	30	32	31.0	17.8	1012.2	1.04	1481	2.6067	2.6333	0.0266	18
15-Mar-19	23838	12500.72	12524.22	1410.00	30	32	31.0	18.7	1020.6	1.04	1472	2.6083	2.6785	0.0702	48
21-Mar-19	23842	12524.22	12547.82	1416.00	31	32	31.5	19.8	1014.6	1.06	1494	2.6043	2.6563	0.0520	35
27-Mar-19	23859	12547.82	12571.52	1422.00	28	30	29.0	20	1014.9	0.94	1341	2.6730	2.6988	0.0258	19
24-hour TSP Monitoring Data for AMS-7															
DATE	SAMPLE NUMBER	ELAPSED TIME			CHART READING			AVG TEMP	AVG AIR PRESS	STANDARD FLOW RATE	AIR VOLUME	FILTER WEIGHT (g)		DUST WEIGHT COLLECTED	24-hr TSP (µg/m ³)
		INITIAL	FINAL	(min)	MIN	MAX	AVG	(°C)	(hPa)	(m ³ /min)	(std m ³)	INITIAL	FINAL	(g)	
4-Mar-19	23811	7818.55	7842.65	1446.00	38	38	38.0	20.9	1013.7	1.49	2158	2.5903	2.7015	0.1112	52
9-Mar-19	23776	7842.65	7866.75	1446.00	37	38	37.5	18	1017.8	1.48	2144	2.6279	2.7117	0.0838	39
15-Mar-19	23860	7866.75	7890.75	1440.00	38	38	38.0	18.7	1020.6	1.50	2164	2.6370	2.7136	0.0766	35
21-Mar-19	23878	7890.75	7914.75	1440.00	40	40	40.0	19.8	1014.6	1.57	2265	2.6553	2.7437	0.0884	39
27-Mar-19	23814	7918.12	7942.12	1440.00	40	42	41.0	22.3	1017.1	1.57	2258	2.6127	2.7484	0.1357	60

NOISE MONITORING RESULT DATABASE

Noise Measurement Results (dB) of NMS4a																					
Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	9:46	73.3	75.2	71.2	73.6	75.3	71.5	71.7	73.7	66.8	74.2	76.9	71.3	74	75.9	71.7	71.5	73.2	68.2	73	75.0
11-Mar-19	13:15	68.2	71.9	57.5	66.6	69.7	58.6	67.4	69.6	58.1	65.7	68.6	59.6	64.7	67.0	56.6	66.4	68.7	57.6	67	75.0
22-Mar-19	10:38	72.3	74.5	68.9	71	73.7	66.5	69.7	72.7	63.8	70.2	73.4	64.6	66.8	70.3	61.1	65.2	68.1	59.1	70	75.0
28-Mar-19	10:15	64.9	67.8	61.5	66.5	69.8	62.7	67.1	69	61.8	65.8	67.8	63.5	72.2	68.6	62.6	65.9	67.6	63.4	68	75.0

Noise Measurement Results (dB) of NMS5																					
Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	10:38	60.1	61.4	58.5	60.7	62.3	59	60	61.4	58.6	59.7	60.8	58.2	59.8	61.4	57.7	58	59.9	55.3	60	75
11-Mar-19	13:15	60.0	62.7	54.7	58.1	57.1	54.3	56.8	55.5	53.9	58.7	60.0	53.7	59.1	60.5	54.0	61.1	62.7	55.1	59	75
22-Mar-19	14:32	62.6	64.4	56.2	61.1	63.2	56.8	62.5	64.6	56.7	60.8	62.8	56.6	62.1	64.8	55.5	61.3	63.8	55	62	75
28-Mar-19	10:58	68.3	70.7	63.6	66.1	67.4	64.6	66.5	69.7	61	67.9	69.3	66.3	66.1	67.7	64.4	67.4	69.7	60.8	67	75

Noise Measurement Results (dB) of NMS6																					
Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	9:27	60.6	62	53.5	63	63	53	57.4	67	53	55.7	58	53	54.5	55.5	53	54.7	57	52.5	59	75
11-Mar-19	14:45	57.7	59.8	53.3	60.8	64.1	53.0	58.1	61.3	53.1	57.9	60.3	52.4	59.0	62.0	51.7	58.6	61.2	54.1	59	75
22-Mar-19	9:56	58.8	61	49	59	61	62.5	61.2	65.5	54	62.6	65.5	56	63	65	59.5	62.4	65.5	56.5	61	75
28-Mar-19	13:09	61.5	62.4	60.4	61.8	62.8	60.5	60.3	61.3	59	62.5	63.7	61.2	64.8	66.7	62.4	63.2	64	62.1	63	75

Noise Measurement Results (dB) of NMS7																					
Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	10:09	65.6	66	58	59.8	62	56	59.5	62	52.5	65.2	66.5	59.5	62	65	55.5	65.1	67.5	59.5	64	75
11-Mar-19	15:28	63.2	65.9	59.2	69.5	71.9	59.5	62.2	63.5	59.1	76.4	69.8	58.3	65.3	69.7	58.7	59.9	61.1	58.7	70	75
22-Mar-19	9:09	64.5	65.5	62	64.2	65.5	62	61.4	62	60.5	63	64	61.5	60.5	61.5	55	55.2	57	52.5	62	75
28-Mar-19	14:04	67.3	69.9	62.4	69.2	72.6	62.2	69.2	71.9	64.4	70.1	72.2	66.9	69.3	72	61.7	70.4	71.9	66	69	75

Noise Measurement Results (dB) of NMS8

Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	14:30	70.4	73	64.5	69	72.5	59	67.4	70.5	56.5	69.9	72.5	63	70.6	73.5	63	71.2	74	66	70	75
11-Mar-19	16:31	71.1	75.0	60.5	69.4	73.0	60.5	72.1	75.0	63.5	68.9	72.5	62.0	69.7	72.5	61.0	69.0	73.0	61.0	70	75
22-Mar-19	15:48	71.8	75	63	71.2	74.6	60.3	71.5	75.1	60.5	71.8	75	61.7	70.6	74.3	60.9	69.2	74.9	60.8	71	75
28-Mar-19	15:58	70.0	73.1	65.0	71.0	74.0	65.0	73.0	73.2	67.5	69.1	69.5	67.0	73.0	75.0	68.0	72.5	73.6	67.5	72	75

Noise Measurement Results (dB) of CN1

Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	13:56	57.7	59.5	54.2	58.1	60.0	54.9	55.8	57.6	52.5	62.2	65.6	52.2	52.7	55.6	47.4	60.2	58.5	44.0	59	70
11-Mar-19	9:35	56.5	57.1	49.9	56.5	53.5	49.3	60.4	60.8	49.4	57.1	61.2	50.1	58.7	63.1	50.3	57.0	61.1	50.3	58	70
22-Mar-19	10:08	61.8	63.6	59.6	58.2	59.2	56.9	60.2	61.0	59.2	58.4	59.6	56.4	61.4	63.3	59.7	58.7	59.6	57.8	60	70
28-Mar-19	13:49	59.8	61.0	58.3	62.2	63.4	60.9	62.3	64.6	57.2	59.6	60.5	58.7	61.7	63.0	59.7	62.2	63.0	61.4	61	70

Noise Measurement Results (dB) of CN2

Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	13:22	63.6	65.3	61.6	65.2	67.5	61.4	64.3	66.7	60.5	66	68.5	60.4	63.3	65.2	61.1	64.1	66.1	61.7	65	70
11-Mar-19	10:18	60.1	58.7	51.8	60.3	60.9	52.1	53.5	54.1	51.2	65.0	57.1	50.8	58.5	54.1	51.1	64.6	56.9	50.8	62	70
22-Mar-19	10:56	56.4	57.1	55.2	59.8	61.4	57.8	60.6	61.4	59.7	58.3	60	56.5	56.7	58.2	55.3	61.7	63.2	57.4	59	70
28-Mar-19	13:12	62.4	63.3	61.4	63.2	65	61.2	62.4	63.7	60.8	60.4	61.9	58.8	62.5	63.9	60.8	62	63.4	60.3	62	70


Noise Measurement Results (dB) of CN3


Date	Start Time	1st Leq (5min)			2nd Leq (5min)			3rd Leq (5min)			4th Leq (5min)			5th Leq (5min)			6th Leq (5min)			Leq30min, dB(A)	Limit Level dB(A)
		Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)	Leq, dB(A)	L10, dB(A)	L90, dB(A)		
5-Mar-19	9:11	61.2	63.6	58.6	62	65.2	56.7	62.6	65.9	58.9	63.6	65.9	60.3	62.6	65.6	59.1	62.9	66	57.3	63	75
11-Mar-19	11:16	66.7	64.6	57.8	64.7	65.7	56.3	65.5	68.9	58.1	64.0	67.0	58.3	65.6	68.6	59.0	66.0	67.8	59.0	66	75
22-Mar-19	10:02	60.9	62.9	56.3	65.1	68.2	56	65.6	68.6	57.9	64.7	67	61.1	63.3	66.8	58.1	65.7	68	57.3	64	75
28-Mar-19	9:40	69.5	72.6	51.9	64.2	65.8	62.1	64.1	66	61.8	64	66.4	60.2	63.4	64.9	61.8	64.8	66.7	62.3	66	75

Appendix I


Graphical Plots for Monitoring Result


Air Quality – 1-hour TSP

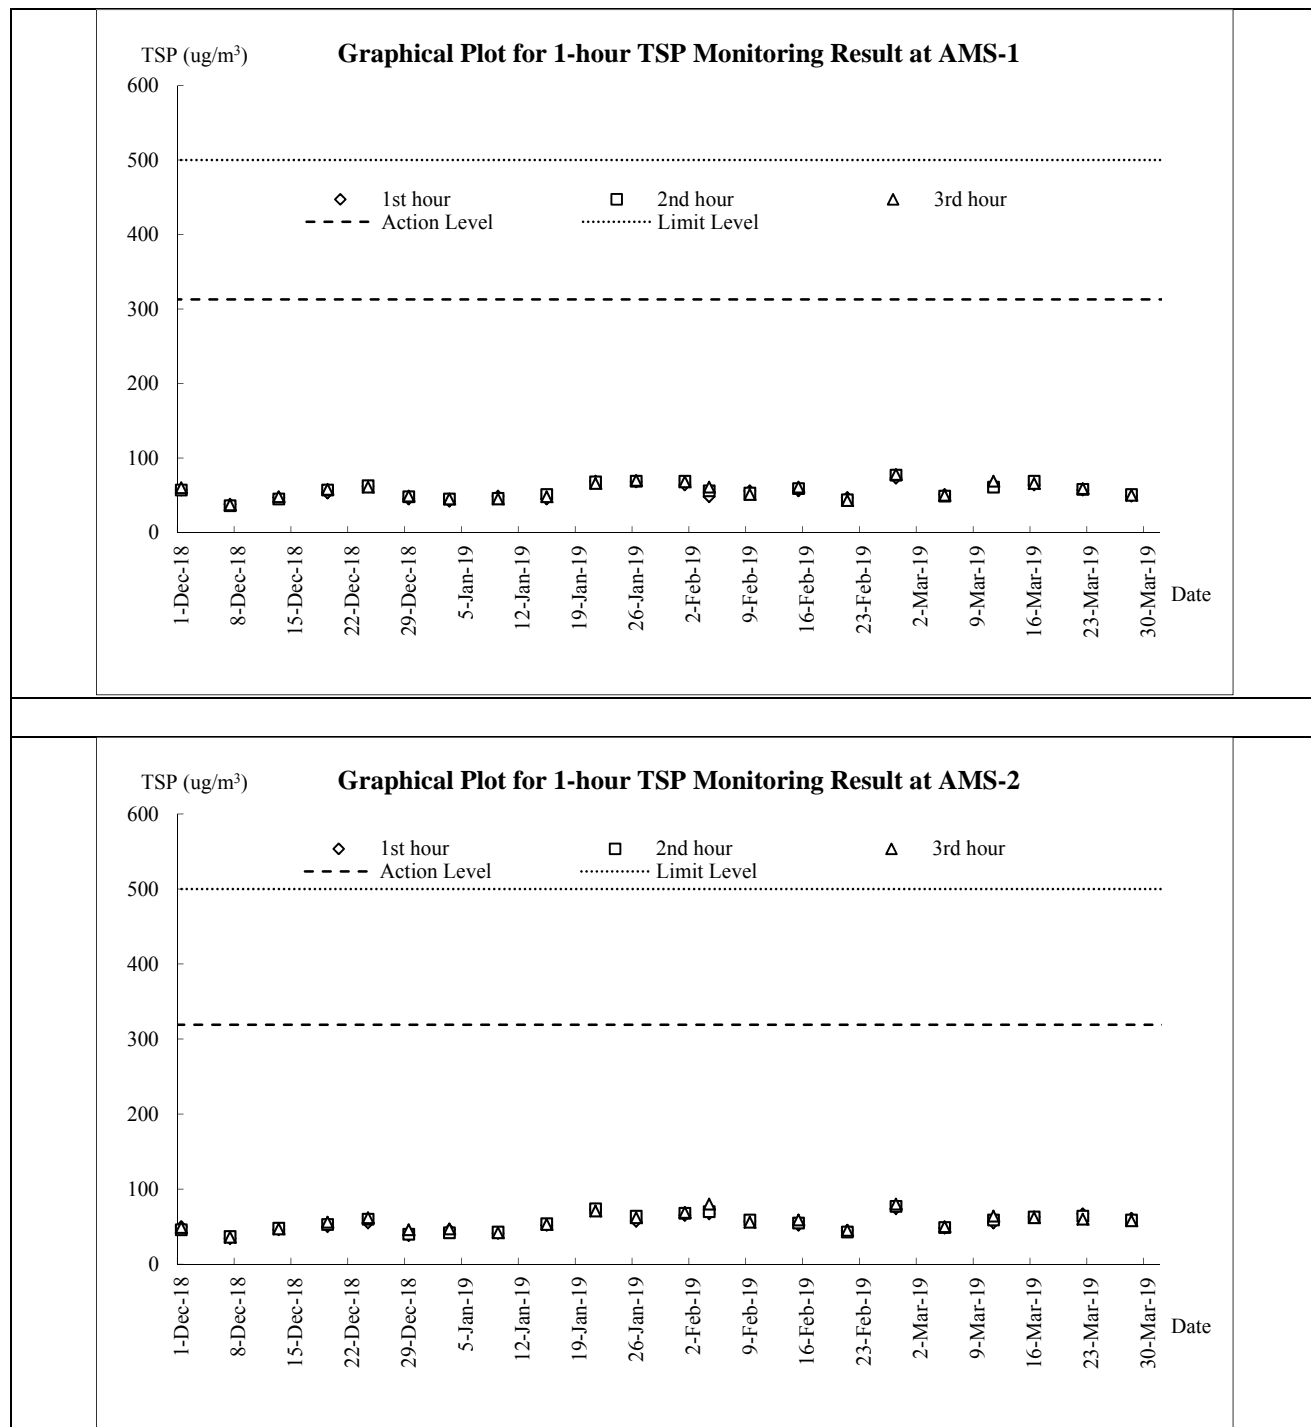

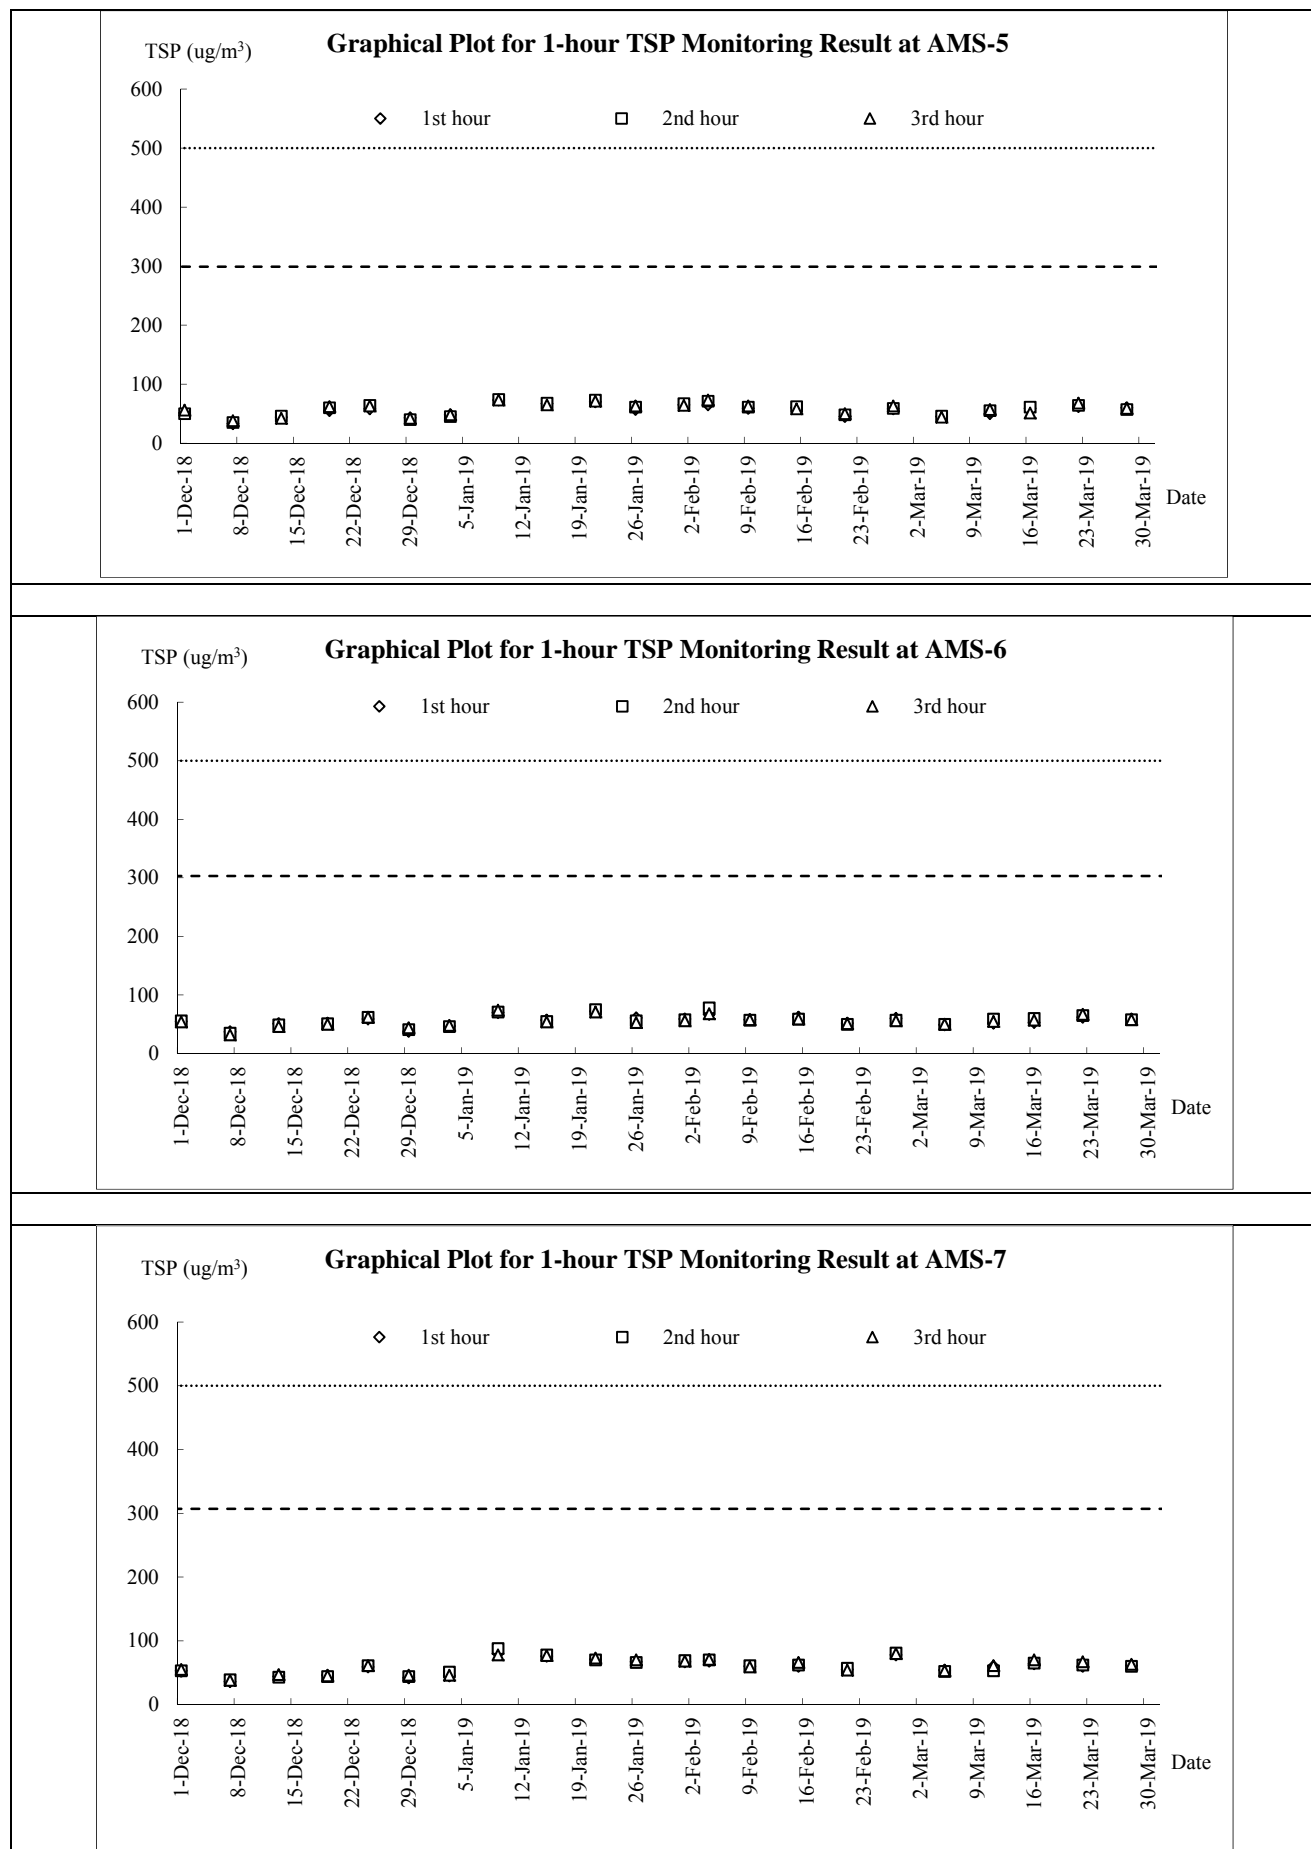



Air Quality – 24-hour TSP

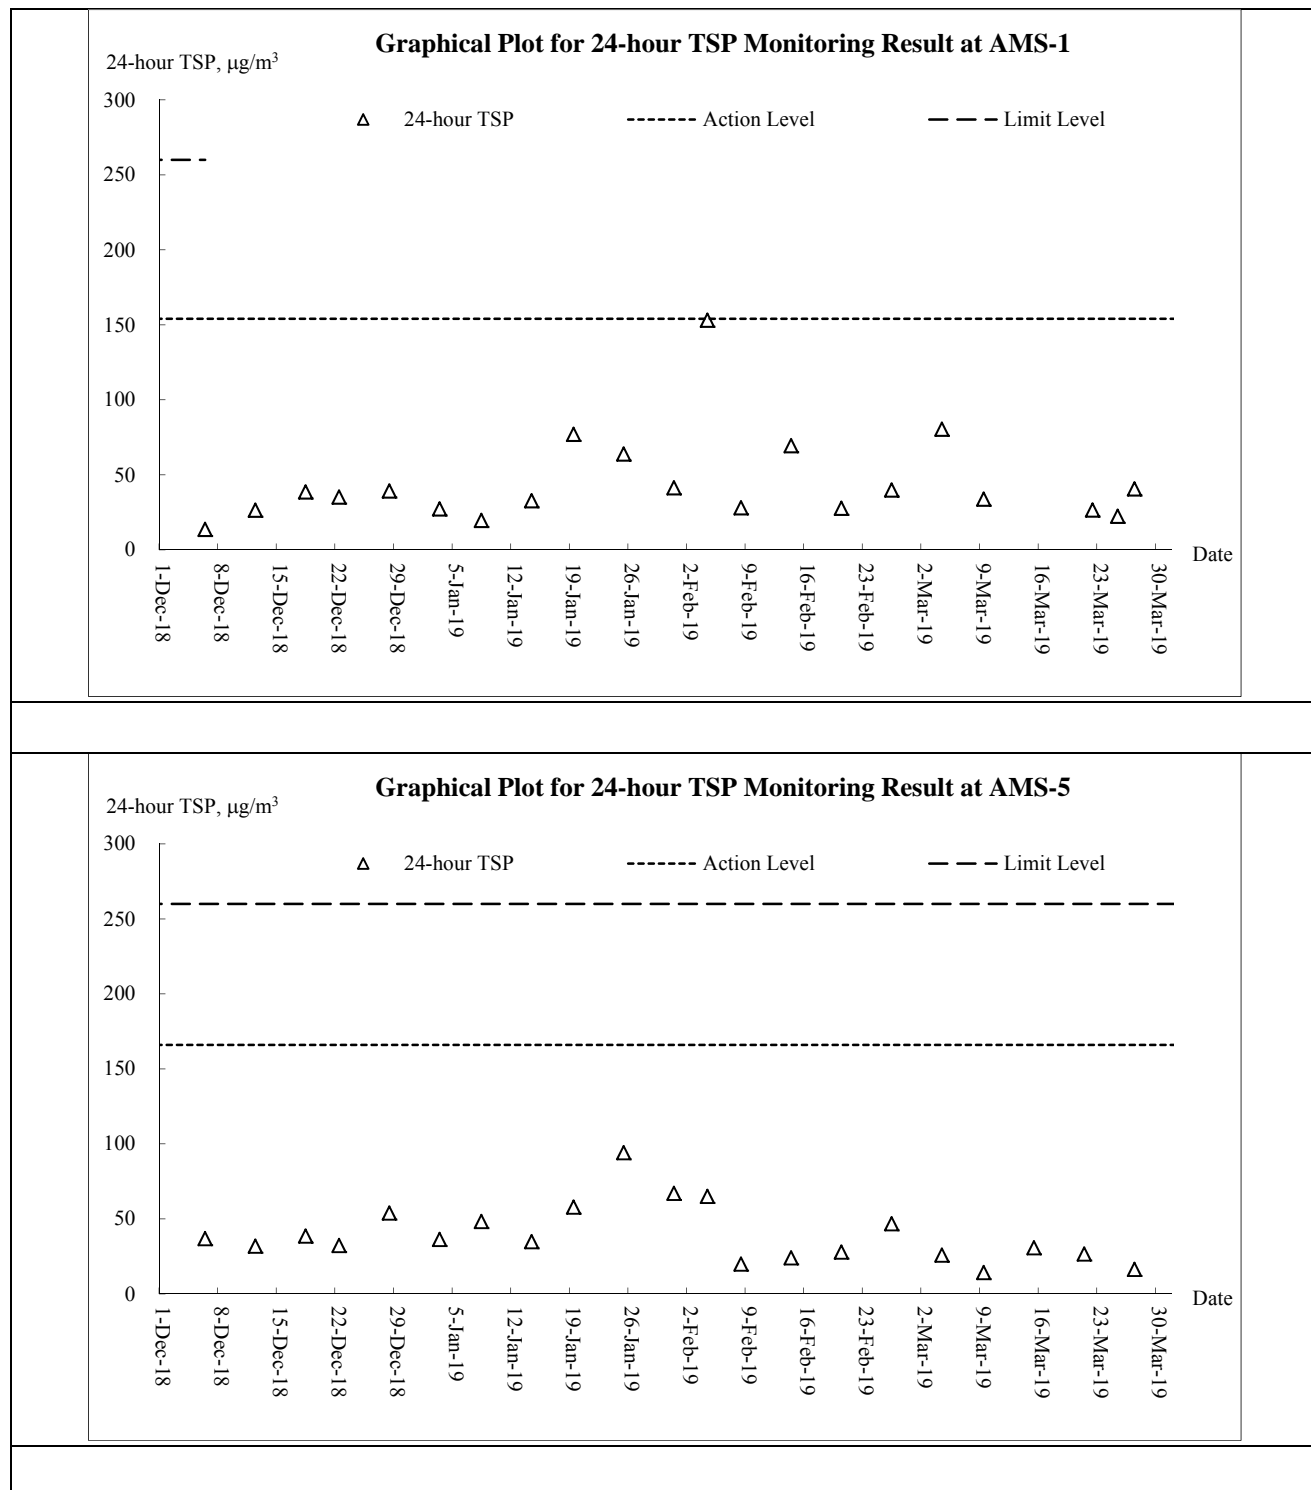


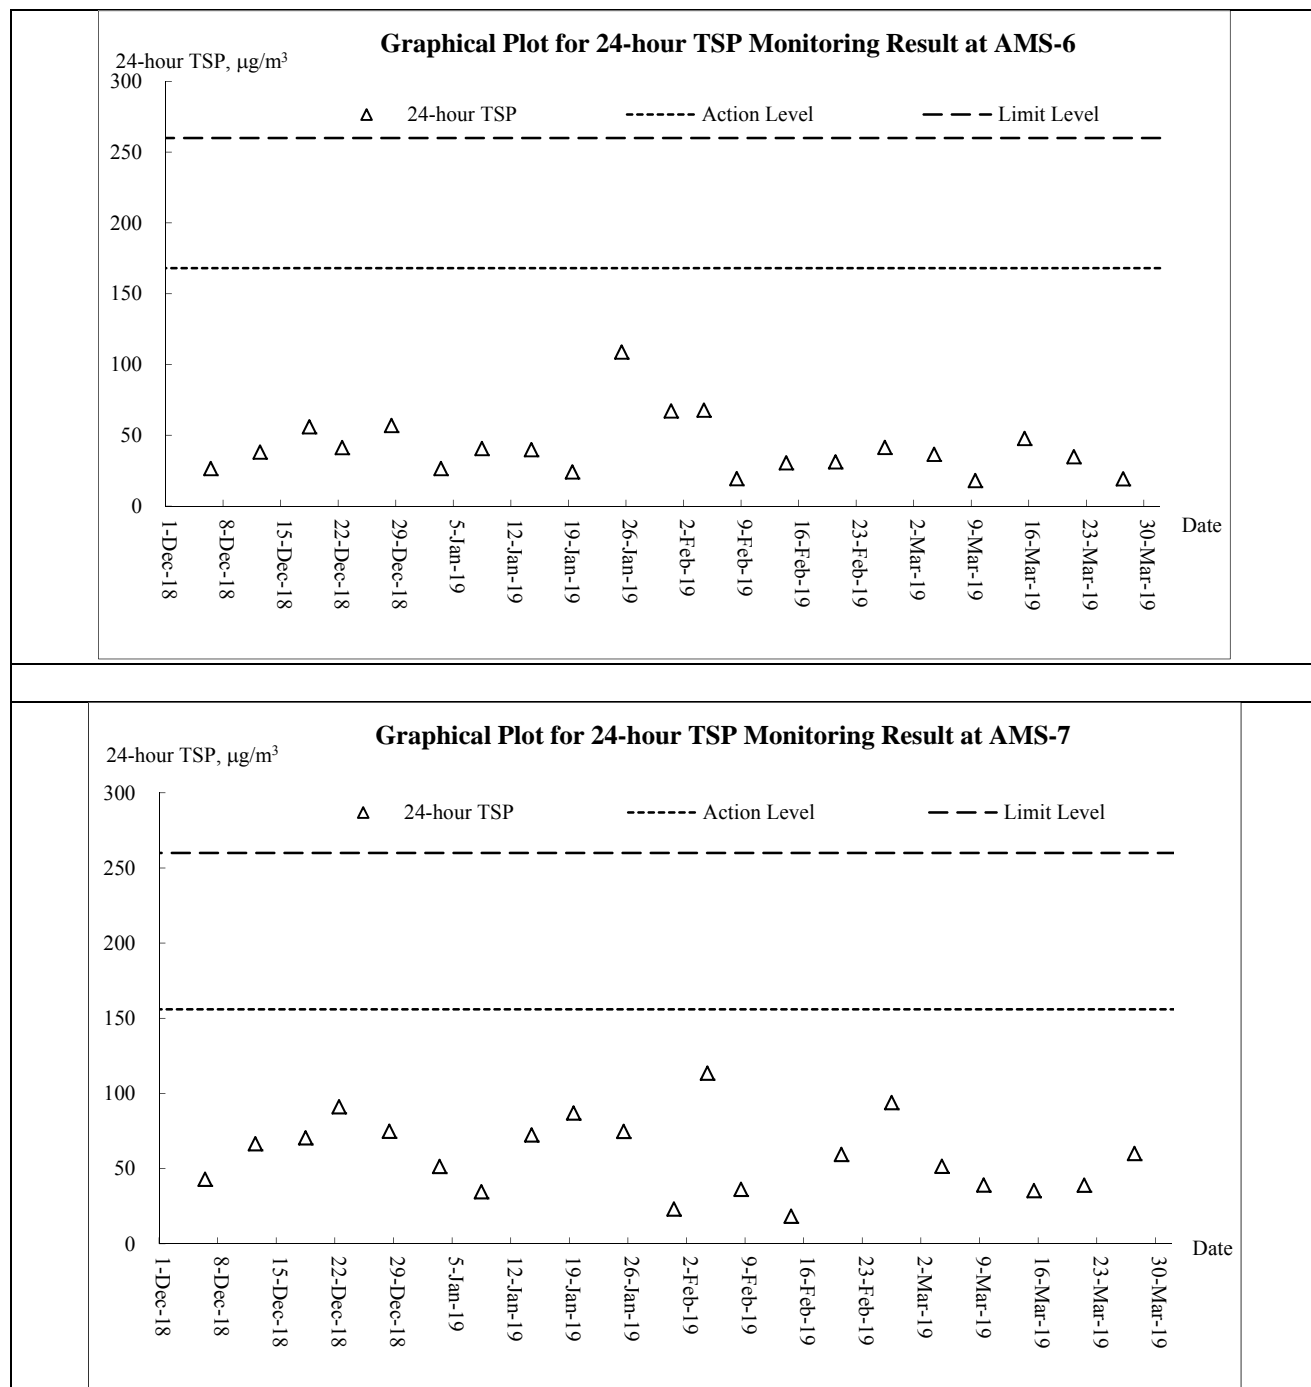


Noise

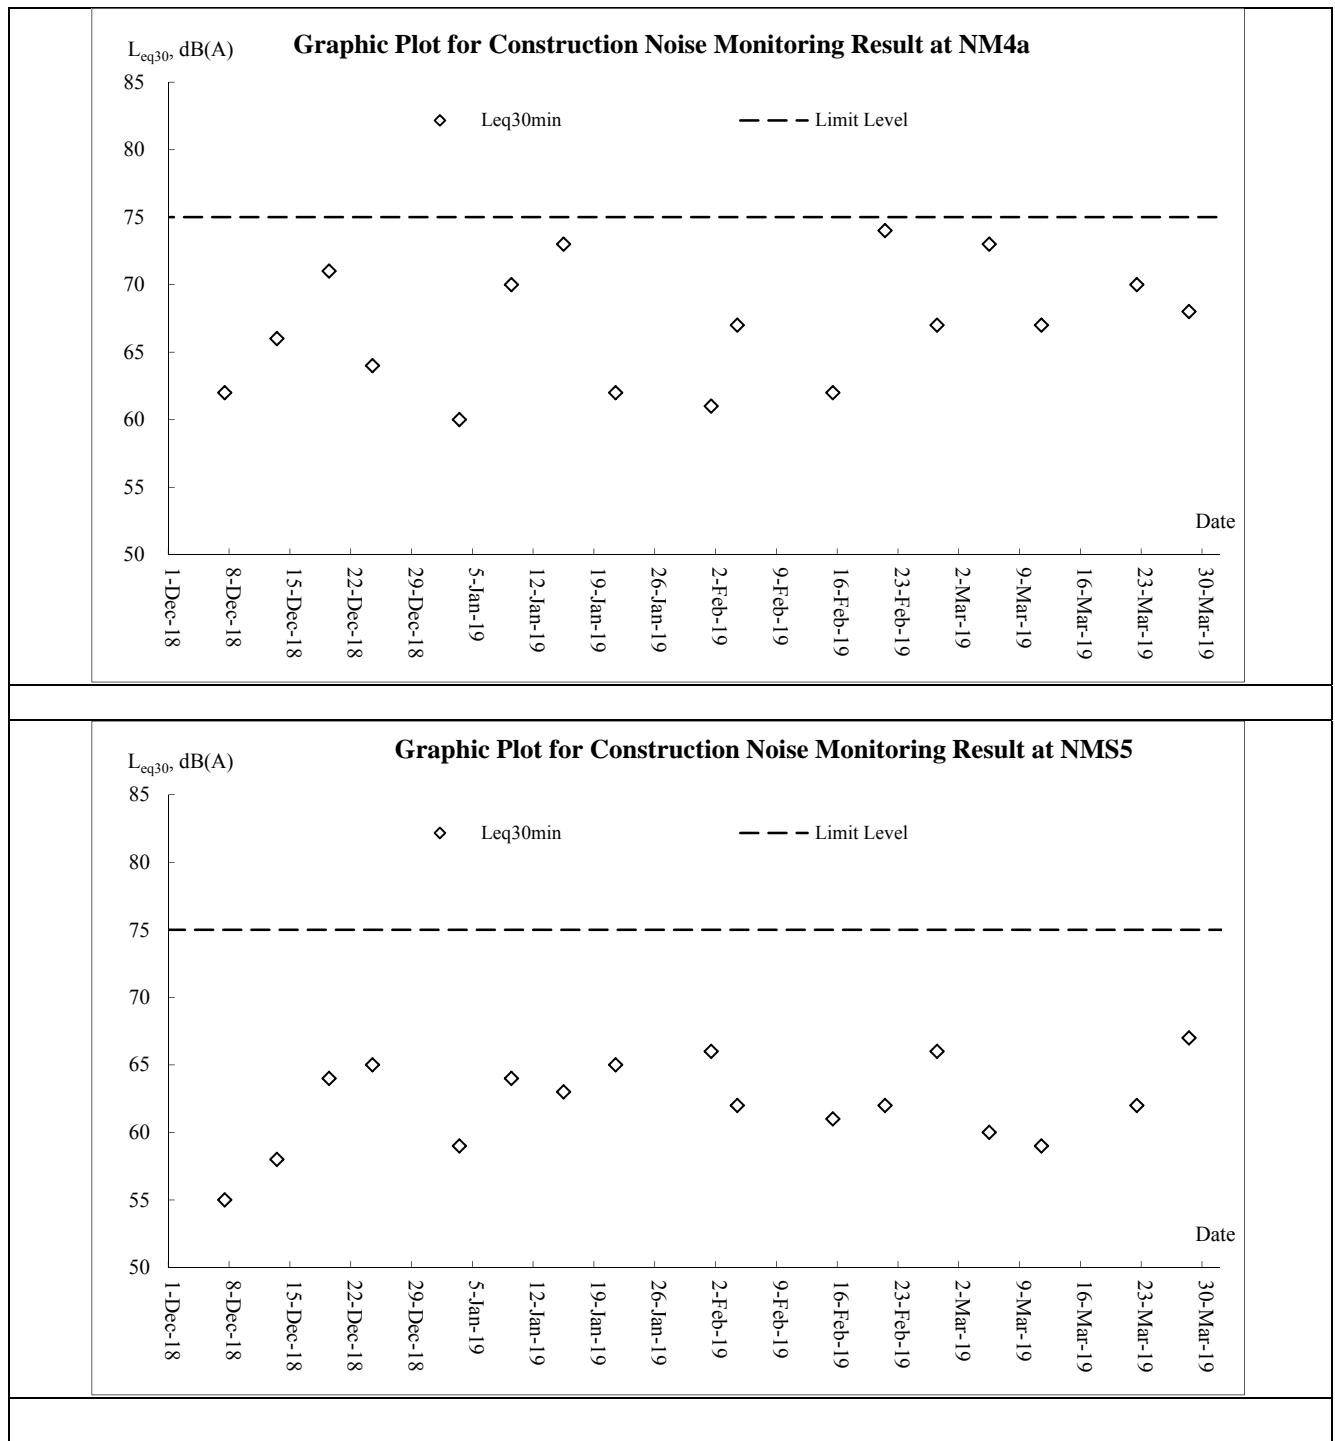

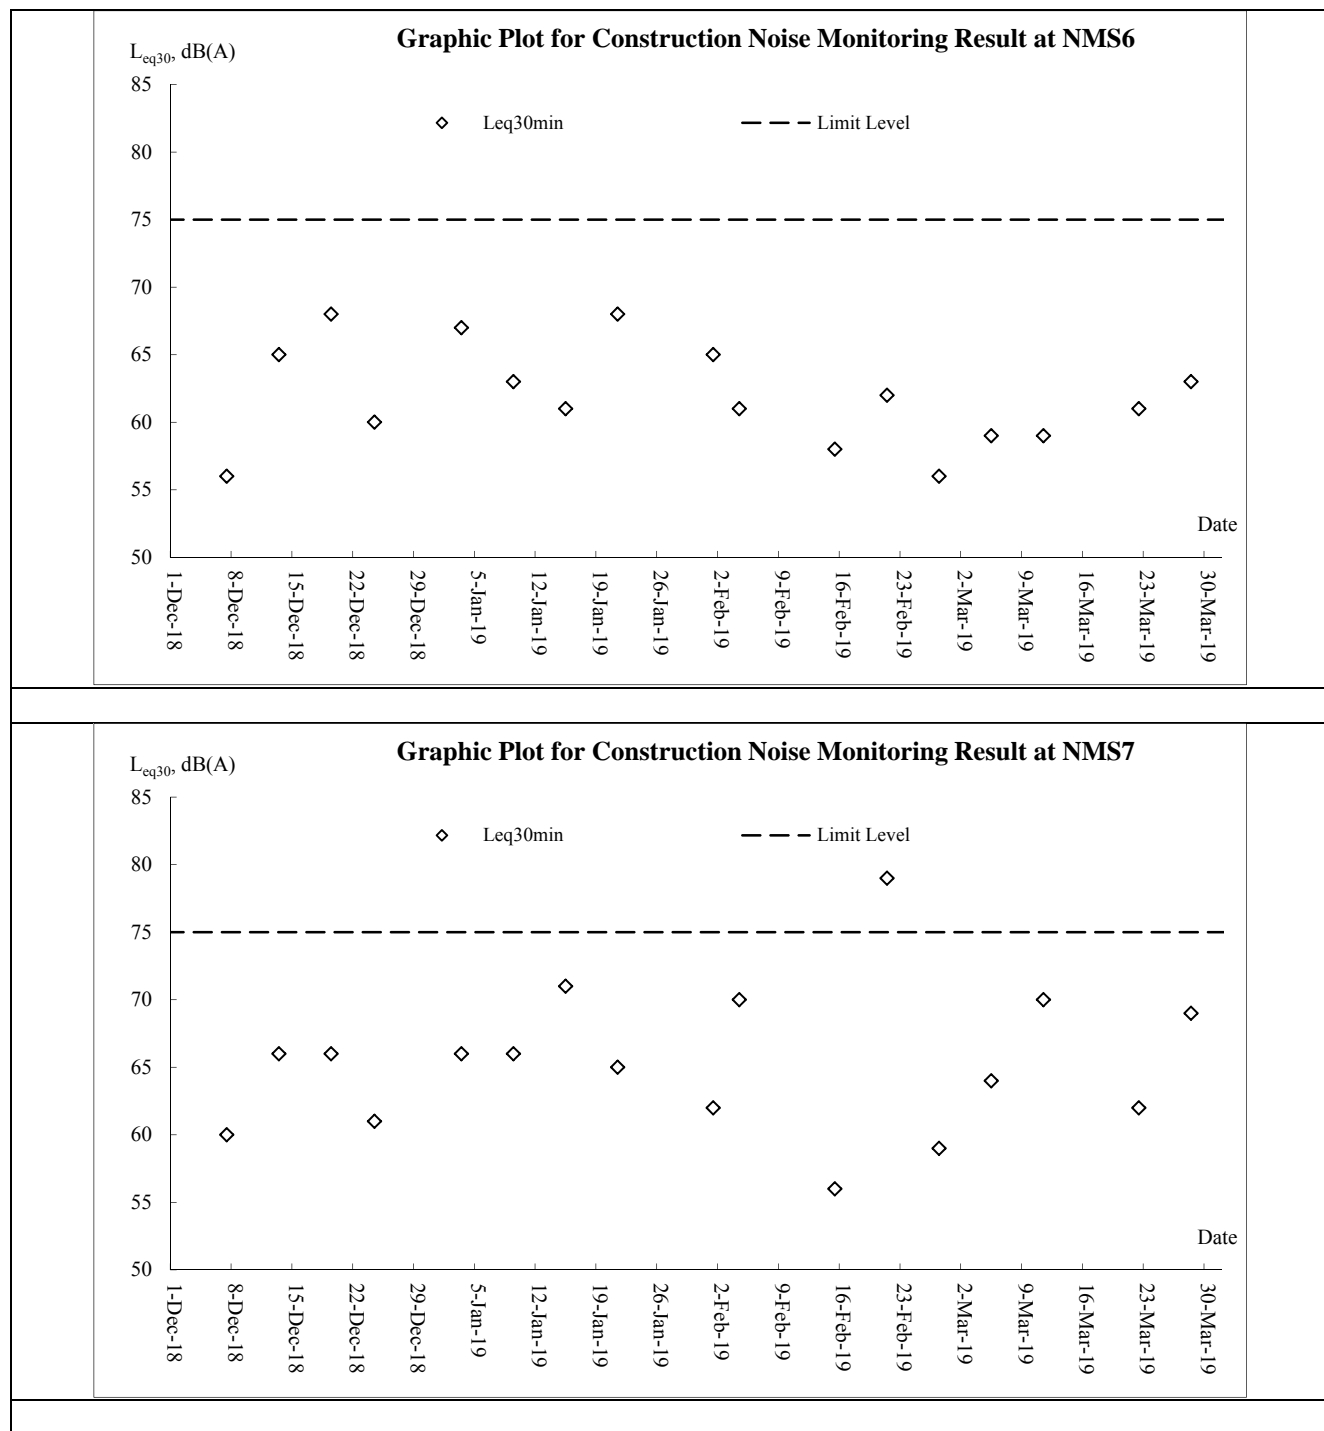

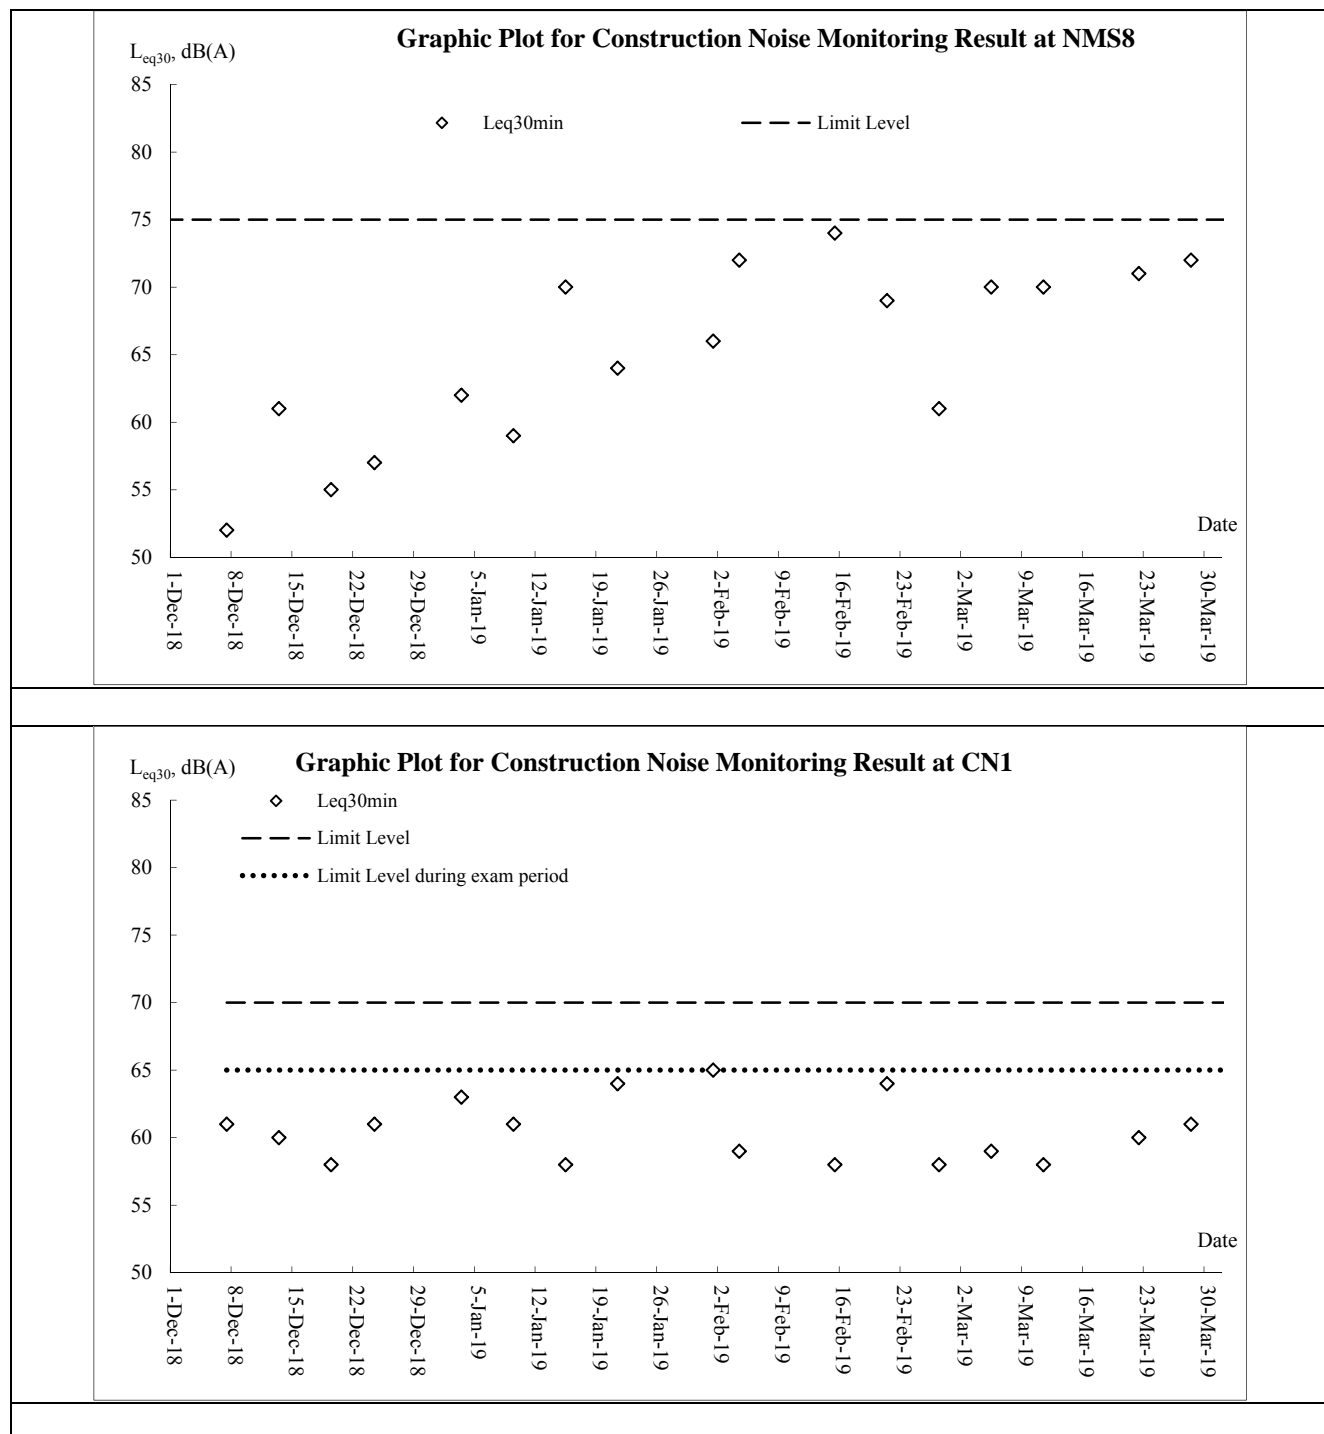

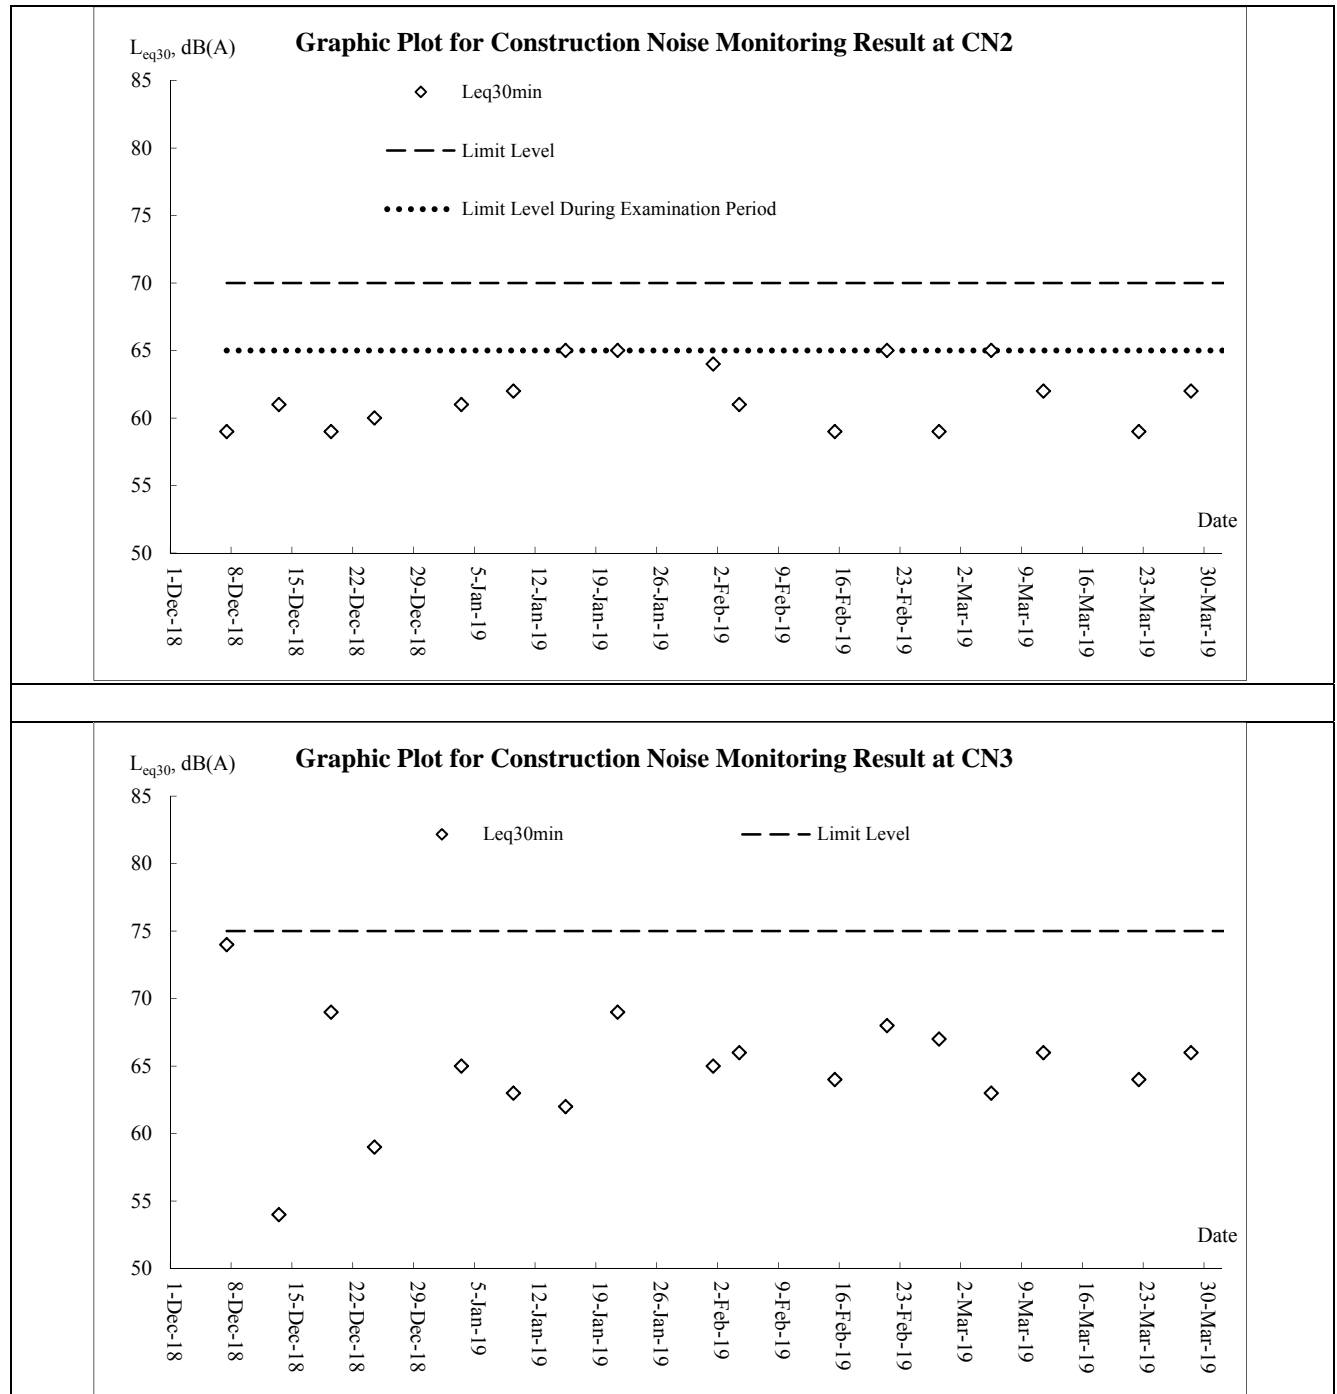

Appendix J

Meteorological Data

Date		Weather	Total Rainfall (mm)	Kwun Tong Station	Kai Tak Station		King's Park Station
				Mean Air Temp. (°C)	Wind Speed (km/h)	Wind Direction	Mean Relative Humidity (%)
1-Mar-19	Fri	Moderate southeasterly winds, occasionally strong on high ground.	0.4	20.2	14.2	E	87
2-Mar-19	Sat	Mainly cloudy with one or two showers.	Trace	20.7	13.3	E/SE	83
3-Mar-19	Sun	Moderate southeasterly winds, occasionally strong on high ground.	6.3	22.1	9.7	SE	83.5
4-Mar-19	Mon	Mainly cloudy with one or two showers.	10.2	20.5	13.6	E/SE	74.5
5-Mar-19	Tue	Moderate to fresh east to northeasterly winds.	30.3	21	17.5	E/SE	83.2
6-Mar-19	Wed	Slightly cooler. Moderate to fresh east to northeasterly winds	45.5	20	16	E/SE	90.7
7-Mar-19	Thu	Cloudy with occasional showers.	29.6	17.5	9	E/SE	88.7
8-Mar-19	Fri	Mainly cloudy with one or two showers.	11.5	Maintenance	17.2	E/SE	97.2
9-Mar-19	Sat	Moderate to fresh east to northeasterly winds.	14.5	17.4	12.5	E/SE	94.2
10-Mar-19	Sun	Slightly cooler. Moderate to fresh east to northeasterly winds	4.6	17.7	6.6	W/NW	83.7
11-Mar-19	Mon	Cloudy with occasional showers.	7.6	18.3	8.2	N/NW	76
12-Mar-19	Tue	Fine. Dry in the afternoon. Moderate east to northeasterly winds.	0	19.7	9.8	E	73
13-Mar-19	Wed	Mainly cloudy with a few showers. More showers later tomorrow.	0	20.8	12.3	E/SE	66
14-Mar-19	Thu	Mainly cloudy. One or two light rain patches at first.	6.4	20.4	12.6	E/SE	80.5
15-Mar-19	Fri	Moderate to fresh east to northeasterly winds, occasionally strong offshore overnight.	0.4	17.8	6.6	N/NE	80.2
16-Mar-19	Sat	Mainly cloudy with one or two showers.	0	19.6	15.1	E/SE	65.5
17-Mar-19	Sun	Moderate to fresh east to northeasterly winds.	0	20.1	12	E/SE	75
18-Mar-19	Mon	Coastal mist tonight. Light to moderate southerly winds.	0	21.4	11.8	E/SE	78.7
19-Mar-19	Tue	Sunny periods. Warm during the day.	0	23.5	11.3	SE	79
20-Mar-19	Wed	Mist patches in the morning. Moderate southeasterly winds.	0	23.1	12	E/SE	87
21-Mar-19	Thu	Warm with sunny periods.	0	25.1	9.1	SE	80
22-Mar-19	Fri	Mainly cloudy. Coastal fog in the morning	Trace	25.2	6.6	SE	82.5
23-Mar-19	Sat	Sunny periods. Warm during the day.	3.3	19	13	E/SE	89
24-Mar-19	Sun	Mainly cloudy. Coastal fog in the morning	0.3	16.2	18.6	E/SE	88.5
25-Mar-19	Mon	Moderate south to southeasterly winds.	1	20.1	11.3	S/SE	83
26-Mar-19	Tue	Moderate south to southeasterly winds.	0	21.6	11.9	E	76.5
27-Mar-19	Wed	Warm with sunny periods during the day.	Trace	22.2	9.6	E/SE	80
28-Mar-19	Thu	Mainly cloudy. A few showers tomorrow.	0	24.5	7.8	SE	82
29-Mar-19	Fri	Mainly cloudy with a few showers. Isolated thunderstorms tonight.	6.9	24.9	8.2	W/SW	84.5
30-Mar-19	Sat	Fresh east to northeasterly winds, strong offshore and on high ground.	Trace	22.4	12.5	E/SE	84.5
31-Mar-19	Sun	Cloudy with a few rain patches.	7.7	20.8	21.3	E/NE	84.5

Appendix K

Waste Flow Table

Contract No.: NE/2016/01

Site Formation and Infrastructure Works for Development of Anderson Road Quarry Site

Monthly Summary Waste Flow Table for 2019 (year)

Month	Actual Quantities of Inert C&D Materials Generated Monthly						Actual Quantities of C&D Wastes Generated Monthly				
	Total Quantity Generated	Hard Rock and Large Broken Concrete	Reused in the Contract (see Note 6)	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastics (see Note 3)	Chemical Waste (see Note 5)	Others, e.g. general refuse
	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000 kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000m ³)
Jan	27.051	8.485	4.795	3.042	10.729	0.000	0.000	0.354	0.000	0.000	0.111
Feb	118.875	13.273	60.959	3.989	40.654	0.000	0.000	0.000	0.000	0.000	0.034
Mar	31.450	1.582	1.433	2.512	25.923	0.000	0.000	0.499	0.000	0.000	0.048
Apr											
May											
Jun											
Sub-total	177.376	23.340	67.187	9.543	77.306	0.000	0.000	0.853	0.000	0.000	0.193
Jul											
Aug											
Sep											
Oct											
Nov											
Dec											
Total	177.376	23.340	67.187	9.543	77.306	0.000	0.000	0.853	0.000	0.000	0.193

Notes:

- (1) The performance targets are given in PS Clause 1.119 (14).
- (2) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (3) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material and waste will be collected by recycler for recycling.
- (4) Use the conversion factor, density of general refuse (1 t/m³) and inert C&D materials (2 t/m³).
- (5) Use the conversion factor for chemical waste (0.88kg/L).
- (6) Assume a dump truck delivers 7.5 m³ material in 1 trip.
- (7) The cut-off date of this summary is 20th of each month.

Kwan On Construction Co Ltd NE/2016/05 - Environmental Management Plan Appendices - Appendix 13	Rev. No.	24
	Issue Date	13 Apr 2019

Name of Department : CEDD

Contract No. : NE/2016/05

Monthly Summary Waste Flow Table for 2019 (year)

[PS Clause 1.129]

Month	Actual Quantities of Inert C&D Materials Generated Monthly						Actual Quantities of C&D Wastes Generated Monthly				
	Total Quantity Generated	Hard Rock & Large Broken Concrete	Reused in the Contract	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastics (see Note 3)	Chemicals Waste	Others, e.g. general refuse
	(in '000 m ³)	(in '000 m ³)	(in '000 m ³)	(in '000 m ³)	(in '000 m ³)	(in '000 m ³)	(in '000 kg)	(in '000 kg)	(in '000 kg)	(in '000 kg)	(in '000 m ³)
Jan	1.3027	1.1947	0.0630	0.00	0.0450	0.00	0.00	0.00	0.00	0.00	0.0008
Feb	0.4010	0.3230	0.0780	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.0000
Mar	0.4800	0.3910	0.0890	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.0025
Apr											
May											
June											
Sub-total											
July											
Aug											
Sept											
Oct											
Nov											
Dec											
Total											

- Notes:
- (1) The performance targets are given in PS Clause 6.14
 - (2) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
 - (3) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material.
 - (4) The Contractor shall also submit the latest forecast of the total amount of C&D materials expected to be generated from the Works. Together with a breakdown of the nature where the total amount of C&D materials expected to be generated from the Works is equal to or exceeding 50,000 m³.

Contract No.: NE/2017/03

Development of Anderson Road Quarry Site – Road Improvement Works and Pedestrian Connectivity Facilities Works Phase 2A

Monthly Summary Waste Flow Table for 2019(year)

Month	Actual Quantities of Inert C&D Materials Generated Monthly						Actual Quantities of C&D Wastes Generated Monthly				
	Total Quantity Generated	Hard Rock and Large Broken Concrete	Reused in the Contract	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastics (see Note 3)	Chemical Waste	Others, e.g. general refuse
	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000 kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000m ³)
Jan	0.514	0.000	0.000	0.000	0.514	0.000	0.000	0.000	0.000	0.000	0.005
Feb	0.419	0.000	0.000	0.000	0.419	0.000	0.010	0.103	0.020	0.000	0.004
Mar	0.672	0.000	0.000	0.000	0.672	0.000	0.001	0.084	0.002	0.000	0.005
Apr											
May											
Jun											
Sub-total	1.605	0.000	0.000	0.000	1.605	0.000	0.010	0.187	0.022	0.000	0.014
Jul											
Aug											
Sep											
Oct											
Nov											
Dec											
Total	1.605	0.000	0.000	0.000	1.605	0.000	0.010	0.187	0.022	0.000	0.014

Contract No.: NE/2017/03

Development of Anderson Road Quarry Site – Road Improvement Works and Pedestrian Connectivity Facilities Works Phase 2A

Forecast of Total Quantities of C&D Materials to be Generated from the Contract*										
Total Quantity Generated	Hard Rock and Large Broken Concrete	Reused in the Contract	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastics (see Note 3)	Chemical Waste	Others, e.g. general refuse
(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000 kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000m ³)
7.000	0	0	0	7.000	0	100.000	2.000	0.300	1.000	3.500

- Notes:
- (1) The performance targets are given in PS Clause 6.14.
 - (2) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
 - (3) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material and waste will be collected by recycler for recycling
 - (4) Use the conversion factor, density of general refuse (1 t/m³) and inert C&D materials (2 t/m³).
 - (5) Use the conversion factor for chemical waste (0.88kg/L)

Appendix L

Implementation Schedule for Environmental Mitigation Measures

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
Dust Impact (Contraction Phase)							
S4.7.2 to S4.7.5	Mitigation measures in form of regular watering under a good site practice should be adopted. Watering once per hour on exposed worksites and haul road is proposed to achieve dust removal efficiency of 91.7%. While the above watering frequencies are to be followed, the extent of watering may vary depending on actual site conditions but should be sufficient to maintain an equivalent intensity of no less than 1.75 L/m ² to achieve the respective dust removal efficiencies.	Minimize dust impact at the nearby sensitive receivers	Contractor	All construction sites	@	V	V
S4.7.6	The Contractor shall follow the procedures and requirements given in the Air Pollution Control (Construction ion Dust) Regulation.	Minimize dust impact at the nearby sensitive receivers	Contractor	All construction sites	V	V	V
S4.7.6	Following dust suppression measures should also be incorporated by the Contractor to control the dust nuisance throughout the construction phase: <ul style="list-style-type: none">Any excavated or stockpile of dusty material should be covered entirely by impervious sheeting or sprayed with water to maintain the entire surface wet and then removed or backfilled or reinstated where practicable within 24 hours of the excavation or unloading;Any dusty materials remaining after a stockpile is removed should be wet ted with water and cleared from the surface of roads;A stockpile of dusty material should not be extend beyond the pedestrian barriers, fencing or traffic cones;The load of dusty materials on a vehicle leaving a construction ion site should be covered entirely by impervious sheeting to ensure that the dusty materials do not leak from the vehicle;Where practicable, vehicle washing facilities with high pressure water jet should be provided at every discernible or designated vehicle exit point. The area where vehicle washing takes place and the road sect ion between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores;When there are open excavation and reinstatement works, hoarding of not less than 2.4m high should be provided as far as practicable along the site boundary with provision for public crossing. Good site practice shall also be adopted by the Contractor to ensure the conditions of the hoardings are properly maintained throughout the construction ion period.The port ion of any road leading only to construction ion site that is within 30m of a vehicle entrance or exit should be kept clear of dusty materials;Surfaces where any pneumatic or power-driven drilling, cutting, polishing or other mechanical breaking operation takes place should be sprayed with water or a dust suppression chemical continuously;Any area that involves demolition activities should be sprayed with water or a dust suppression chemical immediately prior to, during and immediately	Minimize dust impact at the nearby sensitive receivers	Contractor	All construction sites	@	V	V

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<p>after the activities so as to maintain the entire surface wet ;</p> <ul style="list-style-type: none"> Where a scaffolding is erected around the perimeter of a building under construction, effective dust screens, sheeting or netting should be provided to enclose the scaffolding from the ground floor level of the building, or a canopy should be provided from the first floor level up to the highest level of the scaffolding; Any skip hoist for material transport should be totally enclosed by impervious sheeting; Every stock of more than 20 bags of cement or dry pulverised fuel ash (PFA) should be covered entirely by impervious sheeting or placed in an area sheltered on the top and the 3 sides; Cement or dry PFA delivered in bulk should be stored in a closed silo fitted with an audible high level alarm which is interlocked with the material filling line and no overfilling is allowed; and Exposed earth should be properly treated by compact ion, turfing, hydroseeding, vegetation planting or sealing with latex, vinyl, bitumen, shotcrete or other suitable surface stabiliser within six months after the last construction activity on the construction site or part of the construction site where the exposed earth lies. 						
S4.7.7	Implement regular dust monitoring under EM&A programme during the Construction phase.	Control construction airborne noise	Selected Representative dust monitoring station	All construction sites where practicable	V	N/A	N/A
Noise Impact (Contraction Phase)							
S5.6.9	<p>Implement the following good site management practices:</p> <ul style="list-style-type: none"> only well-maintained plant should be operated on-site and plant should be serviced regularly during the construction ion programme; machines and plant (such as trucks, cranes) that may be in intermittent use should be shut down between work periods or should be throttled down to a minimum; plant known to emit noise strongly in one direct ion, where possible, be orientated so that the noise is directed away from nearby NSRs; silencers or mufflers on construction ion equipment should be properly fitted and maintained during the construction ion works; mobile plant should be sited as far away from NSRs as possible and practicable; and material stockpiles, mobile container site office and other structures should be effectively utilised, where practicable, to screen noise from on-site construction activities. 	Control construction ion airborne noise	Contractor	All construction sites where practicable	V	V	V
S5.6.11 to	Use of “ Quiet ” Plant and Working Methods.	Reduce the noise	Contractor	All	V	N/A	N/A

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
S5.6.13		levels of plant items		construction sites where practicable			
S5.6.14	Install temporary site hoarding (approx 2.5m high) located on the site boundaries between noisy construction activities and NSRs. The conditions of the hoardings shall be properly maintained throughout the construction period.	Reduce the construction ion noise levels at low-level zone of NSRs through partial screening.	Contractor	All construction sites where practicable	V	V	V
S5.6.15 to S5.6.18	Install movable noise barriers, full enclosure and acoustic mat, screen the noisy plants including air compressor and generator.	Screen the noisy plant items to be used at all construction sites	Contractor	All construction ion sites where practicable	V	V	N/A
S5.6.19	Sequencing operation of construction plants equipment.	Operate sequentially within the same work site to reduce the construction airborne noise	Contractor	All construction ion sites where practicable	V	V	N/A
S5.6.34	Implement temporary noise barrier along Road L4.	Further reduce the construction ion airborne noise	Contractor	Road L4 of ARQ	N/A	N/A	N/A
S5.6.35	Implement a noise monitoring under EM&A programme.	Monitor the construction noise levels at the selected representative locations	Contractor	Selected Representative Noise monitoring stations	V	N/A	N/A
Water Quality Impact (Contraction Phase)							
S6.6.3	<u>Construction Runoff</u> In accordance with the Practice Note for Professional Persons on Construction ion Site Drainage, Environmental Protection Department, 1994 (ProPECC PN 1/94), best management practices should be implemented as far as practicable as below: <ul style="list-style-type: none"> At the start of site establishment, perimeter cut-off drains to direct off-site water around the site should be constructed with internal drainage works. Channels (both temporary and permanent drainage pipes and culverts), earth bunds or sand bag barriers should be provided on site to direct stormwater to silt removal facilities. Diversion of natural stormwater should be provided as far as possible. The design of temporary on-site drainage should prevent runoff going through site surface, construction machinery and equipment in order to avoid or 	Control construction runoff	Contractor	All construction sites	@	@	@

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<p>minimize polluted runoff. Sediment at ion tanks with sufficient capacity, constructed from preformed individual cells of approximately 6 to 8 m³ capacities, are recommended as a general mitigation measure which can be used for set t ling surface runoff prior to disposal. The system capacity shall be flexible and able to handle multiple inputs from a variety of sources and suited to applications where the influent is pumped.</p> <ul style="list-style-type: none"> The dikes or embankments for flood protect ion should be implemented around the boundaries of earthwork areas. Temporary ditches should be provided to facilitate the runoff discharge into an appropriate watercourse, through a silt /sediment t rap. The silt /sediment t raps should be incorporated in the permanent drainage channels to enhance deposit ion rates. The design of efficient silt removal facilities should be based on the guidelines in Appendix A1 of ProPECC PN 1/94. The detailed design of the sand/silt traps should be undertaken by the contractor prior to the commencement of construction ion. Construction works should be programmed to minimize surface excavation works during the rainy seasons (April to September). All exposed earth areas should be completed and vegetated as soon as possible after earthworks have been completed. If excavation of soil cannot be avoided during the rainy season, or at any time of year when rainstorms are likely, exposed slope surfaces should be covered by tarpaulin or other means. All drainage facilities and erosion and sediment control structures should be regularly inspected and maintained to ensure proper and efficient operation at all times and particularly following rainstorms. Deposited silt and grit should be removed regularly and disposed of by spreading evenly over stable, vegetated areas. Measures should be taken to minimise the ingress of site drainage into excavations. If the excavation of trenches in wet periods is necessary, it should be dug and backfilled in short sect ions wherever practicable. Water pumped out from trenches or foundation excavations should be discharged into storm drains via silt removal facilities. All open stockpiles of construction ion materials (for example, aggregates, sand and fill material) of should be covered with tarpaulin or similar fabric during rainstorms. Measures should be taken to prevent the washing away of construction ion materials, soil, silt or debris into any drainage system. Manholes (including newly constructed ones) should always be adequately covered and temporarily sealed so as to prevent silt, construction ion materials or debris being washed into the drainage system and storm runoff being directed into foul sewers. Precautions to be taken at any time of year when rainstorms are likely, act ions to be taken when a rainstorm is imminent or forecasted, and act ions to 						

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<p>be taken during or after rainstorms are summarized in Appendix A2 of <i>ProPECC PN 1/94</i>. Particular attention should be paid to the control of silty surface runoff during storm events.</p> <ul style="list-style-type: none"> All vehicles and plant should be cleaned before leaving a construction ion site to ensure no earth, mud, debris and the like is deposited by them on roads. An adequately designed and sited wheel washing facilities should be provided at every construction ion site exit where practicable. Wash-water should have sand and silt settled out and removed at least on a weekly basis to ensure the continued efficiency of the process. The sect ion of access road leading to, and exiting from, the wheel-wash bay to the public road should be paved with sufficient back all toward the wheel-wash bay to prevent vehicle tracking of soil and silty water to public roads and rains. Oil interceptors should be provided in the drainage system downstream of any oil/fuel pollution sources. The oil interceptors should be emptied and cleaned regularly to prevent the release of oil and grease into the storm water drainage system after accidental spillage. A bypass should be provided for the oil interceptors to prevent flushing during heavy rain. Construction ion solid waste, debris and rubbish on site should be collected, handled and disposed of properly to avoid water quality impacts. All fuel tanks and storage areas should be provided with locks and sited on sealed areas, within bun ds of a capacity equal to 110% of the storage capacity of the largest tank to prevent spilled fuel oils from reaching water sensitive receivers nearby. Regular environmental audit on the construction site should be carried out in order to prevent any malpractices. Not ices should be posted at conspicuous locations to remind the workers not to discharge any sewage or wastewater into the rivers. 						
S6.6.6 and 6.6.7	<p><u>Sewage from Workforce</u></p> <ul style="list-style-type: none"> Portable chemical toilets should be provided for handling the construction sewage generated by the workforce. Assume that the capacity of the chemical toilets would be 0.4m3 and suck up twice a day under normal practices, around 45 chemical toilets would be required for the whole site at peak hour. And it should be noted that under normal construction periods, less chemical toilets would be needed. In addition, the total number of the chemical toilets would be subject to later detailed design, the capacity of the chemical toilets, and contractor's site practices. Nevertheless, a licensed contractor should be employed to provide appropriate and adequate portable toilets to cater around 37.5 m3/day sewage and be responsible for appropriate disposal and maintenance. Since portable chemical toilets will be provided, no adverse water quality impact from the workforce sewage is anticipated. 	Handling of site sewage	Contractor	All construction sites	V	V	V

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<ul style="list-style-type: none"> Notices should be posted at conspicuous locations to remind the workers not to discharge any sewage or wastewater into the nearby environment during the construction ion phase of the Project . Regular environmental audit on the construction ion site should be conducted in order to provide an effective control of any malpractices and achieve continual improvement of environmental performance on site. It is anticipated that sewage generation during the construction phase of the Project would not cause water quality impact after undertaking all required measure 						
S6.6.8 and 6.6.9	<p><u>Accidental Spillage</u></p> <p>To prevent accidental spillage of chemicals, proper storage and handling facilities should be provided. All the tanks, containers and storage area should be bunded and the locations should be locked as far as possible from the sensitive watercourse and storm drains. The Contractor is required to register as a chemical waste producer if chemical wastes would be generated from the construction ion activities. Storage of chemical waste arising from the construction ion activities should be well managed with suitable labels and warnings while disposal of those chemical wastes should be comply with the requirement states in Waste Disposal Ordinance (Cap 354) as well as Waste Disposal (Chemical Waste) (General) Regulations.</p>	Prevention of accidental spillage	Contractor	All construction sites	V	V	V
S6.6.11- S6.6.14	<p><u>Groundwater from Contaminated Area</u></p> <p>The Contractor should apply for a discharge licence under the WPCO through the Regional Office of EPD for groundwater discharge. Prior to the excavation works within these potentially contaminated areas, the groundwater quality should be reviewed during the process of discharge license application. The compliancy to the TM-DSS and the existence of prohibited substance should be confirmed after further SI. If the review results indicated that the groundwater to be generated from the excavation works would be contaminated, the contaminated groundwater should be either properly treated in compliance with TMDSS or properly recharged into the ground.</p> <p>If wastewater treatment is deployed, the wastewater treatment unit shall deploy suitable treatment process (e.g. oil interceptor / activated carbon) to reduce the pollution level to an acceptable standard and remove any prohibited substances (e.g. Petroleum Carbon Ranges (PCRs)). All treated effluent from wastewater treatment plant shall meet the requirements as stated in TM-DSS and should be discharged into the foul sewers.</p> <p>If groundwater recharging wells are deployed, recharging wells should be installed as appropriate for recharging the contaminated groundwater back into the ground. The recharging wells should be selected at places where the groundwater quality will not be affected by the recharge operation as indicated in the Section 2.3 of TM-DSS. The baseline groundwater quality shall be determined prior to the select</p>	Minimize contaminated groundwater impacts	Contractor	All construction sites	NA	NA	NA

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	ion of the recharge wells, and submit a working plan (including the laboratory analytical results showing the quality of groundwater at the proposed recharge location(s) as well as the pollutant levels of groundwater to be recharged) to EPD for agreement. Pollution levels of groundwater to be recharged shall not be higher than pollutant levels of ambient groundwater at the recharge well. Prior to recharge, any prohibited substances such as PCRs should be removed as necessary by installing the petrol interceptor.						
Waste Management (Contraction Phase)							
S8.5.2	<u>Good Site Practice</u> The following good site practices are recommended throughout the construction ion activities: <ul style="list-style-type: none"> • nomination of an approved personnel, such as a site manager, to be responsible for the implementation of good site practices, arrangements for collect ion and effective disposal to an appropriate facility, of all wastes generated at the site; • training of site personnel in site cleanliness, appropriate waste management procedures and concepts of waste reduction, reuse and recycling; • provision of sufficient waste disposal points and regular collect ion for disposal; • appropriate measures to minimize windblown litter and dust during transportation of waste by either covering trucks or by transporting wastes in enclosed containers; • regular cleaning and maintenance programme for drainage systems, sumps and oil interceptors; 	Minimize generation waste during construction	Contractor	All construction sites	V	V	V
S8.5.2 (6)	The contractor should submit a Waste Management Plan (WMP) as part of the Environmental Management Plan (EMP) in accordance with the <i>ETWB TC(W) No. 19/2005</i> for construction ion phase. The EMP should be submit ted to the Engineer for approval. Mitigation measures proposed in the EIA Report and the EM&A Manual should be adopted.	Minimize generation waste during construction	Contractor	All construction sites	V	V	V
S8.5.3	<u>Waste Reduction Measures</u> Waste reduction is best achieved at the planning and design phase, as well as by ensuring the implementation of good site practices. The following recommendations are proposed to achieve reduction: <ul style="list-style-type: none"> • segregate and store different types of waste in different containers, skip or stockpiles to enhance reuse or recycling o materials and their proper disposal; • proper storage and site practices to minimize the potential for damage and contamination of construction ion materials; • plan and stock construction ion materials carefully to minimize amount of waste generated and avoid unnecessary generation of waste; • sort out demolition debris and excavated materials from demolition works to 	Reduce generation waste	Contractor	All construction sites where practicable	V	V	V

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<p>recover reusable/recyclable portions (i.e. soil, broken concrete, metal etc.);</p> <ul style="list-style-type: none"> provide training to workers on the importance of appropriate waste management procedures, including waste reduction, reuse and recycling. 						
S8.5.5	<p><u>Storage of Waste</u></p> <p>The following recommendation should be implemented to minimize the impacts:</p> <ul style="list-style-type: none"> waste such as soil should be handled and stored well to ensure secure containment; stockpiling area should be provided with covers and water spraying system to prevent materials from wind-blown or being washed away; different locations should be designated to stockpile each material to enhance reuse; 	Minimize waste impacts from storage	Contractor Contractor	All construction sites	V	V	V
S8.5.6	<p><u>Collection and Transportation of Waste</u></p> <p>The following recommendation should be implemented to minimize the impacts:</p> <ul style="list-style-type: none"> remove waste in timely manner; employ the trucks with cover or enclosed containers for waste transportation; obtain relevant waste disposal permits from the appropriate authorities; and disposal of waste should be done at licensed waste disposal facilities. 	Minimize waste impacts from storage	Contractor	All construction sites	V	V	V
S8.5.8	<p><u>Excavated and C&D Material</u></p> <p>Wherever practicable, C&D materials should be segregated from other wastes to avoid contamination and ensure acceptability at public filling areas or reclamation sites. The following mitigation measures should be implemented in handling the excavated and C&D materials:</p> <ul style="list-style-type: none"> maintain temporary stockpiles and reuse excavated fill material for backfilling; carry out on-site sorting; make provisions in the Contract documents to allow and promote the use of recycled aggregates where appropriate; implement a recording system for the amount of waste generated, recycled and disposed of for checking; <p>The recommended C&D materials handling should include:</p> <ul style="list-style-type: none"> On-site sorting of C&D materials Reuse of C&D materials Use of Standard Formwork and Planning of Construction Materials purchasing Provision of wheel wash facilities 	Minimize waste impacts from excavated and C&D materials	Contractor	All construction sites	V	V	V
S8.5.15	<p><u>Contaminated Soil</u></p> <p>As a precaution, it is recommended that standard good site practice should be implemented during the construction phase to minimize any potential exposure to contaminated soils or groundwater. The details of mitigation measures to minimize</p>	Remediate contaminated soil	Contractor	All construction sites where applicable	V	@	N/A

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	the potential environmental implications arising from the handling of contaminated materials refer to Land Contamination Section.						
S8.5.17	<u>Chemical Waste</u> <ul style="list-style-type: none"> If chemical wastes are produced at the construction ion site, the Contractors should register with EPD as chemical waste producer. Chemical wastes should be stored in appropriate containers and collected by a licensed chemical waste Contractor. Chemical wastes (e.g. spent lubricant oil) should be recycled at an appropriate facility as far as possible, while the chemical waste that cannot be recycled should be disposed of at either the Chemical Waste Treatment Cent re, or another licensed facility, in accordance with the Waste Disposal (Chemical Waste) (General) Regulation. 	Control the chemical waste and ensure proper storage, handling and disposal.	Contractor	All construction sites	V	V	V
S8.5.18	<u>General Waste</u> <ul style="list-style-type: none"> General refuse should be stored in enclosed bins separately from construction and chemical wastes. Recycling bins should also be placed to encourage recycling. Preferably enclosed and covered areas should be provided for general refuse collect ion and routine cleaning for these areas should also be implemented to keep areas clean. A reputable waste collector should be employed to remove general refuse on a daily basis. 	Minimize production of the general refuse and avoid odour, pest and litter impacts	Contractor	All construction sites	V	V	V
S8.5.19	<u>Sewage</u> <ul style="list-style-type: none"> The WMP should document the locations and number of portable chemical toilets depending on the number of workers, land availability, site condition and activities. Regularly collect ion by licensed collectors should be arranged to minimize potential environmental impacts. 	Minimize production of sewage impacts	Contractor	All construction sites	V	V	V
Ecology (Contraction Phase)							
S. 10.7.2 to 10.7.6	Re-provision of Wooded Area for ecological function at the future Quarry Park.	Compensate for the loss of three woodland patches of a total area of about 1.13ha.	Contractor/ Detailed Design Consultant (qualified botanist / horticulturist / Certified Arborist to supervise the planting).	Northern part of the proposed Quarry Park.	N/A	N/A	N/A
.10.7.10	Construction phase in situ mitigation measures to minimize impacts on	Minimize impacts on	Contractor	All	V	N/A	V

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<p>hydrological condition and water quality of hillside watercourses include:</p> <ul style="list-style-type: none"> • Temporary sewerage and drainage will be designed and installed to collect wastewater and prevent it from entering nearby watercourses; • Proper locations well away from nearby watercourses will be used for temporary storage of materials (i.e. equipment, fill materials, chemicals and fuel) and temporary stockpile of construction debris and spoil, and these will be identified before commencement of works; • To prevent muddy water entering nearby watercourses, work sites close to nearby watercourses will be isolated, using such items as sandbags or silt curtains with lead edge at bottom and properly supported props. Other protective measures will also be taken to ensure that no pollution or siltation occurs to the water gathering grounds of the works site; • Stockpiling of construction materials, if necessary, will be properly covered and located away from nearby watercourses; • Erection of temporary geotextile silt fences will be carried out around earth-moving works to trap any sediments and prevent them from entering watercourses; • Construction debris and spoil will be covered and/or properly disposed as soon as possible to avoid being washed into nearby watercourses; • Exposed soil will be covered as quickly as possible following formation works, followed, where appropriate, by covering with biodegradable geotextile blanket for erosion control purposes; • Where appropriate, earth-bundling will be carried out of areas where soils have been disturbed or where vegetation has been cleared, to ensure that surface runoff will not move soils off-site; • Construction effluent, site run-off and sewage will be properly collected and/or treated. Wastewater from any construction site will be minimised via the following in descending order: reuse, recycling and treatment; • Proper locations for discharge into wastewater treatment facilities well away from sensitive receivers will be identified and used; • Silt traps will be installed at points where drainage from the site enters local watercourses; • Appropriate sanitary facilities for on-site workers will be provided; • The site boundary will be clearly marked and any works beyond the boundary strictly prohibited, and • Regular water monitoring and site audit will be carried out at suitable points. If the monitoring and audit results show that pollution occurs, adequate measures including temporary cessation of works will be considered. 	Hydrological condition and water quality of hillside watercourses.		construction sites			
S.10.7.11	<p>Implement an emergency contingency plan during the construction phase and the plan will include, but not be limited to, the following:</p> <ul style="list-style-type: none"> • Potential emergency situations; • Chemicals or hazardous materials used on-site (and their location); 	Minimize impacts on Hydrological condition and water quality of hillside	Contractor	All construction sites	N/A	N/A	N/A

EM&A Ref.	Recommended Mitigation Measures	Objectives of the Recommended Measures & Main Concern to Address	Who to implement the measures?	Location of the measure	Implementation Status		
					Contract 1	Contract 2	Contract 3
	<ul style="list-style-type: none"> Emergency response team; Emergency response procedures; List of emergency telephone hot lines; Locations and types of emergency response equipment , and Training plan and testing for effectiveness. 	watercourses.					
Landscape and visual (Contraction Phase)							
S11.14.23 , Table 11.9, CM1 [4]	All existing trees to be retained shall be carefully protected during construction.	Avoid disturbance and protection of the existing trees	Detailed Design Consultant /	The whole project area where applicable	V	V	V
S11.14.23 , Table 11.9, CM2 [3]	Tree Transplantation - Should removal of trees be unavoidable due to construction impacts, trees will be transplanted or felled. Detailed transplanting proposal will be submit ted to relevant government departments for approval in accordance with <u>LAO GN No. 7/2007, ETWB TCW No. 29/2004 and 10/2013</u> . Final locations of transplanted trees shall be agreed prior to commencement of the work.	Minimize landscape impact and retention of landscape resources	Detailed Design Consultant /	Onsite where possible. Otherwise consider offsite locations	*	N/A	V
S11.14.23 , Table 11.9, CM3 [4]	Control of operation night -time glare with well-planned lighting operation system to minimize potential glare impact to adjacent VSRs	Minimize glare impact to adjacent VSRs	Contractor/ CEDD	The whole project area where applicable	V	V	V
S11.14.23 , Table 11.9, CM [4]	Erection of decorative screen hoarding.	Minimize visual impact	Contractor/ CEDD	The whole project area where applicable	N/A	N/A	N/A
S11.14.23 , Table 11.9, CM5 [2]	Minimise disturbance and limitation of run-off – temporary structures and construction works should be planned with care to minimize disturbance to adjacent landscape, vegetation, natural stream habitats.	Minimize visual impact	Contractor/ CEDD	The whole project area where applicable	V	V	V

Legend: V = implemented; x = not implemented; @ = partially implemented; * = pending to be implemented; N/A = not applicable

Appendix M

Complaint Log
And
Investigation Report for Complaint

Appendix M1

Cumulative Complaint and Summons/ prosecution

Reporting Month	Number of Complaints in Reporting Month	Number of Summons/ Prosecution in Reporting Month
March 2017	1	0
April 2017	0	0
May 2017	0	0
June 2017	2	0
July 2017	3	0
August 2017	3	0
September 2017	4	0
October 2017	2	0
November 2017	3	0
December 2017	3	0
January 2018	1	0
February 2018	4	0
March 2018	0	0
April 2018	1	0
May 2018	1	0
June 2018	1	0
July 2018	0	0
August 2018	1	0
September 2018	1	0
October 2018	1	0
November 2018	3	0
December 2018	2	0
January 2019	2	0
February 2019	3#	0
March 2019	1	0
Overall Total	43	0

Updated in March 2019.

Appendix M2 Complaint Log

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
1	23-Mar-17	NA	Anderson Road Quarry site	Resident of On Tat Estate	Construction noise	SPRO hotline	NA	A resident living in On Tat House reported that some night works with noise and flashing caused nuisance to nearby resident after 11:00 pm on 23 March 2017.	According the incident report conducted by the CWSTVJV, demobilization of crawler crane was undertaken on 23 March 2017 11pm and it is TD requirement to carry out demobilization of heavy machine at nighttime. It is considered this complaint was a single incident and would not be happened again in future.	no comment by IEC on 11 Oct 2017	TCS00864/16/300/F0087
2	28-Jul-17	28-Jul-17	Anderson Road Quarry site	Resident of On Tat Estate	Construction noise	SPRO hotline	NA	Mr. Hsu received a complaint from a resident living in the flat on 38/F of Yin Tat House (賢達樓), On Tat Estate. The resident complained about the noise level of our works during daytime.	Noise monitoring by Contractor was conducted in Yin Tat House, On Tat Estate, at around 2 pm on 28-Jul-2017. Another noise monitoring was carried out by ET and representatives of AECOM and JV in the presence of the complainant in her flat at 10 am on 1-Aug-2017 and was witnessed by Mr. Hsu. No exceedance of noise was recorded. The complainant was satisfied about the monitoring results.	no comment by IEC on 9 Aug 2017	TCS00864/16/300/F0060
3	29-Aug-17	29-Aug-17	Anderson Road Quarry site	Resident of On Tat Estate	Construction noise	SPRO hotline	NA	Mr. Hsu Yau Wai reported that he received complaint from a resident (Ms Cheng) living at Shing Tat House 24/F Room 22 about the noise generated from our site this week. The noise heard was mainly rock breaking noise from our site.	Noise monitoring was carried out by ET and representatives of AECOM and JV in the presence of the complainant in her flat at 3pm on 30-Aug-2017. No exceedance of noise was recorded. The complainant was satisfied about the monitoring results.	no comment by IEC on 8 Sep 2017	TCS00864/16/300/F0081
4	21-Jun-17	29-Aug-17	Anderson Road Quarry site	Resident of Po Tat Estate	Construction noise	EPD	EPD (ref.N08/RE/00019373-17)	day time construction noise of breakers (8am to 6pm)	These two complaints were forwarded by CEDD to ET on 31 August 2017 which after the complaint dates. Investigation was conducted based on the site information by the Contractor of Contract 1 as well as the observation during weekly site inspection carried out ET during June 2017. In our investigation, CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident and the working hour 08:00 to 18:00 did not breach any legal requirement. To eliminate the inconvenience caused to the nearby resident CWSTVJV was advised to further enhance the noise mitigation measures as appropriately.	no comment by IEC on 3 Nov 2017	TCS00864/16/300/F0093
5	22-Jun-17	29-Aug-17	Anderson Road Quarry site	Resident of Po Tat Estate	Dust & Construction noise	EPD	EPD (ref. N08/RE/0019428-17)	Day time construction noise of breakers (8AM to 6PM). Requested to delay the operating hour of breakers to 10AM or 11AM			TCS00864/16/300/F0093
6	15-Jul-17	29-Aug-17	Anderson Road Quarry site	Resident of Po Tat Estate	Construction noise	EPD	EPD (ref.N08/RE/00022479-17)	Construction noise	CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident and the working hour 08:00 to 18:00 did not breach any legal requirement. To eliminate the inconvenience caused to the nearby resident, CWSTVJV was advised to further enhance the noise mitigation measures as appropriately.	no comment by IEC on 3 Nov 2017	TCS00864/16/300/F0094
7	28-Jul-17	29-Aug-17	Anderson Road Quarry site	unknown	Dust	EPD	EPD (ref.N08/RE/00023986-17)	Poor control on dust emission at Anderson Road Construction Site	CWSTVJV has implemented dust mitigation measures to eliminate the inconvenience caused to the nearby resident and status of the implementation of dust mitigation measures was considered effective based on the site observation.	no comment by IEC on 15 Nov 2017	TCS00864/16/300/F0097

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
8	2-Aug-17	29-Aug-17	Anderson Road Quarry site	Resident of On Tat Estate	Construction noise	EPD	EPD (ref.N08/RE/00024557-17)	Day time construction noise of breakers (8AM to 6PM)	CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. According to the impact noise monitoring result obtained in August 2017, there were no breaches of EM&A requirement. However, to eliminate the inconvenience caused to the nearby resident, CWSTVJV should further enhance the noise mitigation measures as appropriately. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 15 Nov 2017	TCS00864/16/300/F0098
9	19-Sep-17	19-Sep-17	Anderson Road Quarry site	Resident of Sau Mau Ping Estate	Construction noise	SPRO hotline	NA	The complainant is living at Sau Mau Ping Estate Sau Nga House 38/F. He complained about the noise nuisance recently from August to September especially during night time after 12:00 am, even in Saturdays and Sundays. The noise nuisance caused a great disturbance to him. He made a request to conduct investigation about the source of the noise during night time.	ET has conducted an ad-hoc noise measurement for Leq (30min) on the rooftop of 秀雅樓 and 秀義樓 in the afternoon of 22 September 2017. During the course of noise measurement, construction activities such as excavation and breaking were conducted in the Quarry Site. The measurement results taken at both 秀雅樓 and 秀義樓 were 63dB(A) which below the Limit Level under the EM&A Programme.	no comment by IEC on 18 Oct 2017	TCS00864/16/300/F0088
10	21-Sep-17	13-Oct-17	Anderson Road Quarry site	Resident of Sau Mau Ping Estate	Construction noise	EPD	EPD (ref.N08/RE/00031074-17)	On 21 September 2017, the same complaint further reported that the noise can be heard at both Sau Yee House and Sau Nga House even in daytime and he strongly requested the Contractor to follow up the case immediately.			TCS00864/16/300/F0088
11	27-Sep-17	13-Oct-17	Anderson Road Quarry site	Resident of On Tat Estate	Construction noise	EPD	EPD (ref.N08/RE/00029489-17)	The complainant questioned why there were 6 to 7 breakers operating in the morning but only 1 operating in the afternoon. He requested to shift the operation of the breakers to afternoon.	CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. According to the impact noise monitoring result obtained in September and October 2017, there were no breaches of EM&A requirement. However, to eliminate the inconvenience caused to the nearby resident, CWSTVJV should properly maintain the noise mitigation measures as appropriate. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 30 Nov 2017	TCS00864/16/300/F0106
12	3-Oct-17	13-Oct-17	Anderson Road Quarry site	Resident of On Tat Estate	Construction noise	EPD	EPD (ref. N08/RE/00032407-17)	Day time construction noise, the complainant requested using less breaker at one time, erecting taller noise barrier to cover the equipment. In addition, the complainant would like to know the construction schedule whether there will be more breaking activities in near future			TCS00864/16/300/F0106
13	25-Oct-17	26-Oct-17	Anderson Road Quarry site	Resident of Po Tat Estate	Dust	EPD	NA	投訴安達臣道地盤的泥車落泥，令他達貴樓的住所受到大塵影響，要求跟進及回覆	Investigation revealed that CWSTVJV has implemented dust mitigation measures to eliminate the inconvenience caused to the nearby resident. Nevertheless, based on the observation during site inspection on 31 October 2017, CWSTVJV was advised to enhance the dust mitigation measures particularly during dry season.	no comment by IEC on 15 Nov 2017	TCS00864/16/300/F0100

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
14	6-Nov-17	7-Nov-17	Anderson Road Quarry site	Resident of On Tat Estate	Noise	EPD	NA	安達邨後達樓居民投訴石礦場地盤又再於早上 07:45 開始傳出機器不停採石的噪音(幾乎每日在 08:00-19:00 進行工程),已持續一年,他全家人受到滋擾。	Ad-hoc noise measurement was conducted by ET at rooftop of Chun Tat House in the morning of 20 November 2017 and measurement result was below the Limit Level under the EM&A Programme. CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 30 Nov 2017	TCS00864/16/3 00/F0109
15	13-Nov-17	14-Nov-17	Anderson Road Quarry site	Mr. Lam Wai	light pollution and noise	SPRO hotline	NA	1. 智泰樓面向安達臣地盤方向,有照射燈深夜時分仍然常開,影響居民正常睡眠質素,照成一定的精神壓力。 2. 隔音布未固定,大風吹過發出極大的聲浪	To ease the concern by the complaint, CWSTVJV has adjusted the lights to the orientation pointing the ground and that to minimise the nuisance. For the maintenance of noise barrier, CWSTVJV has immediately fixed the noise barrier nearest to On Tai Estate and prolonged the cover area of the noise barrier to reduce the noise impact to the public.	no comment by IEC on 24 Nov 2017	TCS00864/16/3 00/F0104
16	1-Nov-17	14-Nov-17	Anderson Road Quarry site	Resident of Po Tat Estate	Noise	EPD	NA	居住於安達邨誠達樓高層的投訴人投訴由早上八時半至下午六時聽到採鐵噪音。	CWSTVJV had already deployed the acoustic mat as noise barrier at the site boundary near Shing Tat House. To enhance the noise mitigation measures, CWSTVJV deployed an acoustic mat as noise barrier for the breaking work in order to reduce construction noise affecting the upper floor of On Tat Estate.	no comment by IEC on 13 Dec 2017	TCS00864/16/3 00/F0110
17	25-Aug-17	26-Oct-17	Anderson Road Quarry site	Resident of Sau Mau Ping Estate	Construction Noise	EPD	EPD (ref.N08/RE/00027 738-17)	Night time construction noise of hammering (around 12AM)	It is confirmed by CWSTVJV and checked against the site diary that no construction activities were carried out after 19:00 at the subject site. Therefore, the complaint about noise nuisance during night time should not be related to the Project.	no comment by IEC on 14 Dec 2017	TCS00864/16/3 00/F0114
18	12-Sep-17	26-Oct-17	Anderson Road Quarry site	Resident of On Tat Estate	Construction Noise	EPD	EPD (ref. N08/RE/0 0029489-17)	Day time construction noise of breakers (8AM to 5PM)	Noise mitigation measures were implemented to reduce the noise impact to the nearby resident. According to the impact noise monitoring result in September 2017, there were no breaches of EM&A requirement. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 10 Jan 2018	TCS00864/16/3 00/F0117
19	15-Dec-17	21-Dec-17	Anderson Road Quarry site	Resident of Sau Mau Ping Estate	Construction Noise	EPD	NA	Resident of Sau Yee House complained suspected construction noise from Anderson Construction Site at restricted hour (7pm to 7am).	It is confirmed by CWSTVJV and checked against the site diary that no construction activities were carried out after 19:00 at the subject site. Therefore, the complaint about noise nuisance during night time should not be related to the Project.	no comment by IEC on 10 Jan 2018	TCS00864/16/3 00/F0118
20	20-Dec-17	21-Dec-17	Anderson Road Quarry site	Resident of On Tat Estate	Dust	EPD	NA	投訴安達臣道信和地盤水車已經壞了十多天,一直無灑水,四周非常大塵。投訴人住於安達邨,投訴安達臣道石礦場有大地盤,地盤大車工作時間不停出入揚起沙塵,吹到安達邨,影響空氣環境,要求部門到場視察。	CWSTVJV has implemented dust mitigation measures to eliminate the inconvenience caused to the nearby resident. It is considered that the complaint was an isolated case due to malfunction of water tanker and CWSTVJV has promptly rectified the deficiency. As advised by CWSTVJV, another water tanker will be deployed in mid-January 2018 to enhance the dust suppression measures throughout the construction site.	no comment by IEC on 25 Jan 2018	TCS00864/16/3 00/F0121
21	28-Dec-17	10-Jan-18	Anderson Road Quarry site	Resident of Sau Mau Ping Estate	Construction Noise	CE's office	NA	日間及凌晨均聽到轟隆聲的噪音及震動,懷疑是由附近工程引起	ET has conducted an ad-hoc noise measurement for Leq (30min) in the complainant's flat in the monitoring of 17 January 2018. It was noted that the complainant's flat is not in direct line of sight to the Anderson Road Quarry Site. The measurement noise	no comment by IEC on 8 Feb 2018	TCS00864/16/3 00/F0129

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
									result was below the Limit Level under the EM&A Programme. Moreover, it is confirmed by CWSTVJV and checked against the site diary that no construction activities were carried out during restricted hour at the subject site. Therefore, the complaint about noise nuisance during restricted hour should not be related to the Project.		
22	15-Jan-18	15-Jan-18	Anderson Road Quarry site	Resident of Chun Tat House of On Tat Estate, 40/F	Construction Noise	SPRO mobile	NA	She is irritated by the construction noise of breaking rock for a long time and strongly requested to know exactly when will be the completion date of the breaking rock part of works opposite to Chun Tat House. She said we should do more on the mitigation measures because our site is very close to the residents nearby.	CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. According to the impact noise monitoring result obtained in January 2018, there were no breaches of EM&A requirement. However, to eliminate the inconvenience caused to the nearby resident, CWSTVJV should properly maintain the noise mitigation measures as appropriate. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 8 Feb 2018	TCS00864/16/300/F0130
23	1-Feb-18	2-Feb-18	Anderson Road Quarry site	Resident of On Tai Estate (referred by Mr. Lam Wai)	Construction Noise	SPRO hotline	NA	"智泰對出，白天噪音過大，可否加裝隔音板？高層受影響"	The Environmental Team has conducted an ad-hoc noise measurement for Leq(30min) at the corridor of 22/F of Chi Tai House on 2 February 2018 facing the construction site. The measurement noise result was 65dB(A) which below the Limit Level under the EM&A Programme. In our investigation, CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. According to the impact noise monitoring result obtained in January 2018, there were no breaches of EM&A requirement.	no comment by IEC on 22 Feb 2018	TCS00864/16/300/F0137
24	1-Feb-18	2-Feb-18	Anderson Road Quarry site	Resident of Shing Tat House (referred by Mr. Hsu Yau Wai)	Construction Noise	SPRO hotline	NA	Mr. Hsu reported that some disturbing noise was heard after 6:00 pm from the site near Shing Tat House of On Tat Estate.	AECOM has liaised with Mr. Hsu on 2 February 2018 for the complaint matter and he reported to AECOM that the noise was generated until 7:00 pm on 1 February 2018. 3. As advised by Contractor of Contract 1, breaking works at USRT area which opposite to Shing Tat House was only carried out from 8:00 to 18:00. However, rock breaking at System A was extended to 19:00 on 1 February 2018. As noise mitigation measures, noise barriers were erected for the works area. Further to the complaint case, CWSTVJV would seek for other quiet work method such as using drilling machine to reduce noise level and speed up the rock breaking process, so that to reduce the noise intensity level and the duration of exposure.	no comment by IEC on 28 Feb 2018	TCS00864/16/300/F0140
25	28-Feb-18	28-Feb-18	Anderson Road Quarry site	Resident of Shing Tat House	Construction Noise	EPD	NA	安達邨誠達樓居民，投訴人是返夜班，一年半以來長期受對出地盤日間掘石仔噪音滋擾，由於單位與地盤太近，堅持環保署跟進及回覆如何處理及減低噪音，他亦要求知道何日完工。	Breaking works at Underground Stormwater Retention Tank area which opposite to Shing Tat House was carried out from 8:00 to 18:00. The Contractor has implemented noise mitigation measures to reduce the noise impact to the nearby resident. It was advised that the rock breaking works shall tentatively be completed by end of April and it is believe that the noise impact should be minimized. Since the works were carried out within the non-restricted hours and noise monitoring noise were within acceptable level, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 19 Mar 2018	TCS00864/16/300/F0143

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
26	11-Apr-18	12-Apr-18	Anderson Road Quarry site	Resident of HimTat House	Construction Noise	SPRO Hotline	NA	Mr. Hui Yau Wai reported that the noise irritation was becoming more severe recently and asked about the completion date of the works close to Him Tat House. The resident suspected that the noise comes from piling works nearby.	In our investigation, since construction noise was generating from other construction site next to Him Tat House, it is considered that the complaint is due to cumulative noise generated by both construction sites. However, CWSTVJV should properly provide the noise mitigation measures at works area in System B to minimize the noise impact to the resident nearby. As advised by CWSTVJV on 20 April 2018, noise barrier was being erected at works area in System B as noise mitigation measures. According to the site photo, it is considered that the coverage of noise barrier is not sufficient and CWSTVJV should enhance the measure as far as practicable. The implementation of noise mitigation measures will be kept in view in subsequent site inspection.	no comment by IEC on 7 May 2018	TCS00864/16/300/F0160b
27	25-Apr-18	7-May-18	Junction of Hiu Kwong Street and Hiu Ming Street	A school but name of school not disclosed	Construction Noise	EPD	NA	This case is considered as an enquiry and no investigation is required under the EM&A Programme.		NA	NA
28	18-May-18	24-May-18	Anderson Road Quarry Site	Undisclosed	Construction Noise	EPD	NA	投訴人指安達臣道石礦場地盤 (NE/2016/01)在入夜 19:00 後仍見到有長臂喉工程車在運作，及持續產生大噪音及閃燈，非常擾民。	As advised by CWSTVJV and confirmed by RE/AECOM, there were no construction activities carried out after 19:00 and concreting was completed before 19:00. It is concluded that the retracting process is not a general construction work using Powered Mechanical Equipment and complaint was an isolated case due to misunderstanding of the site operation. To prevent similar incidents in future, CWSTVJV has recommended several mitigation measures.	no comment by IEC on 30 July 2018	TCS00864/16/300/F0174b
29	25-Jun-18	19-Jul-18	Pedestrian Connective ly E8 under Contract 3	Kwun Tong DC member Ms. So Lai-chun	Waste Management	CEDD	NA	A public complaint was referred from CEDD on 4 July 2018 regarding accumulation of dead leaves and branches found at slope (GLA-TNK 2458) near Hiu Yuk Path on 25 June 2018. The complainant requested the relevant department to clear the leaves and branch asap	CW-CMGC-JV has immediately clear the dead leaves and maintain the site cleanliness. Since the construction work has not yet commenced and the dead leaves and overgrown branches were not related project works, it is considered that the complaint is not valid the project.	no comment by IEC on 24 Sep 2018	TCS00864/16/300/F0189b
30	22-Aug-18	29-Aug-18	Hong Wah Court	Resident of Hong Wah Court	Construction Noise	1823 Hotline	NA	投訴人指馬游塘區堆填區往將軍澳方向行車入口因配合項目需要而進行移除山坡工程，但其鑽地鑿石的噪音嚴重影響藍田康雅苑*居民，要求有關部門跟進。 *註:投訴人於 2018 年 8 月 27 日更正指受影響屋苑應為藍田康華苑。	to reduce the inconvenience caused to the nearby resident, Kwan On should properly maintain the noise mitigation measures as appropriate, such as maintain good site practice including intermittent use of machine and plant and Sequencing operation of construction plant equipment. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 7 Sep 2018	TCS00864/16/300/F0196a

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
31	26-Feb-18	31-Jul-18	Anderson Road Quarry Site	Undisclosed	Construction Noise	EPD	NA	安達邨誠達樓後面地盤，2月26日晚，晚上7時後，還在落石屎，相片拍攝時間大概晚上9時半，一直至晚上十一時五十分還有工程車在地盤行駛。影響居民休息。	According to the site diary which countersigned by RE, there was no concreting work carried out after 18:00 and the construction activities conducted during restricted hours with valid CNP were completed at 23:00. It is considered that the complaint was not valid to the Project. Nevertheless, CWSTVJV was reminded that in case of any work activities need to be carried out during restricted hours, CWSTVJV should strictly follow the requirements specified in the valid CNP.	no comment by IEC on 10 Oct 2018	TCS00864/16/300/F0197a
32	6-Sep-18	7-Sep-18	Tsui Yeung House	Resident of Tsui Yeung House	Construction Noise	Verbal	NA	Mr. CHENG Keung-fung complained that the contractor has conducted the noisy works such as rock excavation beyond the normal hours.	Kwan On has implemented noise mitigation measures to reduce the noise impact to the nearby resident. As advised by Kwan On, the rock breaking works shall tentatively be completed by end of December 2018 and the mitigation measures will implemented continuously during slope construction work and the slope construction will be carried out within the working hours at Portion 2. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 22 Oct 2018	TCS00864/16/300/F0201
33	24-Oct-18	25-Oct-18	E3	Kwun Tong DC member Ms. So Lai-chun	Construction Noise	Whatsapp Message	NA	KTDC member, Ms. Ann So, complaining the noise of the breaker at E3	As advised by the Contractor, the acoustic material wrapped on the breaker was worn-out on 24 October 2018 and replacement of new acoustic materials has been installed on the breaker immediately on 25 October 2018. The rock breaking works shall tentatively be completed to the road level in the middle of November 2018 and the mitigation measures will implemented continuously during slope construction work and the slope construction will be carried out within the working hours at Portion 2. It is considered the complaint was an isolate case.	no comment by IEC on 23 Nov 2018	TCS00864/16/300/F0209a
34	12-Nov-18	13-Nov-18	Anderson Road Quarry Site	Resident of Ching Tat House (referred by Mr. Hui Yau Wai)	Construction Noise	SPRO Hotline	NA	Mr. Hui reported that he received complaint from a resident living in Ching Tat House about noise nuisance recently. Mr. Hui asked if project team can arrange some noise monitoring to check the noise level at the concerned flat or the same level at Ching Tat House.	The SPRO contacted Mr. Hui and explained to him about the purpose and benefits of the tunnel to the residents nearby and the expected date of completion of the tunnel will be earlier than 2020. Moreover, the noise mitigation measures had implemented to reduce the noise level effectively and the work progress will be closely updated to nearby stakeholders to enhance communication. Mr. Hui satisfied with the reply from SPRO and he agreed that the proposed noise monitoring in Ching Tat House was not needed. Since the works were conducted within approved normal hours with implementation of noise mitigation measures, there were no breaches of legislative requirement.	no comment by IEC on 12 Dec 2018	TCS00864/16/300/F0222a
35	14-Nov-18	14-Nov-18	Anderson Road Quarry Site	Undisclosed	Light and Noise	EPD	NA	凌晨1時，地盤仍有大光燈正射民居和機器移動聲音，影響附近居民睡眠及違反環保條例。	CWSTVJV immediately adjusted the angle and brightness of the lighting to minimize the nuisance to the resident nearby. In response to the complaint, CWSTVJV immediate carried out remedial action to minimize the nuisance to the public. It was considered that complaint for noise generated by machine moving was an isolated case. CWSTVJV was reminded to closely monitor the plant use and sequence of night work and do not to violate CNP conditions.	no comment by IEC on 3 Jan 2019	TCS00864/16/300/F0223a

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
36	13-Nov-18	14-Nov-18	Anderson Road Quarry Site	Undisclosed	Noise and dust	1823	NA	Complainant requested to postpone the starting time of construction work at project site and also to solve the problem of construction noise and dust.	In our investigation, acoustic barrier and site hoarding were in place along the works area. No noticeable noise and dust impact was observed during the site inspection. As advised by CWSTVJV, the normal working hour of the construction site is 8am to 6pm and there were no violation of the relevant regulations. The senior public relation officer contacted the complainant Ms. Ma on 26 November 2018 to explain the site situation and she was satisfied with the reply. Investigation Report has been completed by ET without comment from IEC.	no comment by IEC on 18 Feb 2019	TCS00864/16/300/F0224
37	9-Dec-18	12-Dec-18	Anderson Road Quarry Site	Undisclosed	Construction noise	1823	2-4927907305	1823 has referred a case to CEDD on 10 December 2018, which the complainant complained that construction noise was generated from project site on Sunday and was affecting the resident at Hau Tai House, On Tat Estate. The complainant requested follow up action from related department as soon as possible.	In our investigation based on the information provided by CWSTVJV, there was no site activities undertaken at site access road as concerned by the complainant. The construction work carried out on Sunday was fully compliance with the CNP requirement. In response to the complaint, CWSTVJV was reminded to closely monitor the plant use and sequence of night work and do not to violate CNP conditions.	no comment by IEC on 10 Jan 2019	TCS00864/16/300/F0230a
38	19-Dec-18	27-Dec-18	Anderson Road Quarry Site	Undisclosed	Construction noise	1823	2-4948074127	1823 has referred a case to CEDD on 27 December 2018, which the complainant complained that noise barriers near the round-about at On Sau Road were not enough, and construction noise generated from the project site was affecting the resident at Ming Tai House, On Tai Estate. The complainant requested follow up actions from related department as soon as possible.	Joint site inspection was carried out on 3 January 2019 the status of implemented mitigation measures provided by CWSTVJV was inspected. It was observed that noise mitigation measures including temporary noise barrier, acoustic mat and wrapped by acoustic materials are implemented on site. However, CWSTVJV was advised to extend the coverage of noise barrier as far as practicable and fully enclose the concerned works area which has been completed on 15 January 2019. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.	no comment by IEC on 31 Jan 2019	TCS00864/16/300/F0237a
39	24-Jan-19	29-Jan-19	Anderson Road Quarry Site	Undisclosed	wastewater	Referred from DSD	NA	DSD has referred a case to CEDD on 24 January 2019 regarding suspended illegal discharge of cementitious slurry from construction site of Development of ARQ Site to nearby Public Stormwater Drainage System.	In our investigation, the concerned catchpit and U-channel mainly received the runoff from Po Lam Road as well as the discharge from the Anderson Road Quarry Site. It is suspected that the mud and silt found on the downstream has been accumulated over time particularly by rainstorm as well as routine discharge from construction site. As remedial action, CWSTVJV immediately clean the affected area where accessible. Nevertheless, in order to protection the watercourse at downstream of the construction site, CWSTVJV has some enhancement measures.	no comment by IEC on 29 Mar 2019	TCS00864/16/300/F0248a
40	30-Jan-19	30-Jan-19	Anderson Road Quarry Site	Undisclosed	noise	SPRO hotline	NA	A public complaint was received by SPRO hotline on 30 January 2019 regarding the construction noise near Ma Yau Tong Village and requested to add noise barrier as soon as possible.	In our investigation, CWSTVJV had provided the noise mitigation measures to minimize the noise impact to the resident nearby. The impact monitoring result obtained at Ma Yau Tong Village revealed that the construction noise were within acceptable level. Since the works were conducted within approved normal hours with implementation of noise and dust mitigation measures, there were no breaches of legislative requirement.	no comment by IEC on 15 Mar 2019	TCS00864/16/300/F0249a

Log ref.	Date of Complaint	Date of Received by ET	Complaint Location	Complainant	Complaint nature	Channel	Ref. no.	Complaint details	Follow up action	Status	Investigation Report Ref.
41	15-Feb-19	25-Feb-19	Anderson Road Quarry Site	Undisclosed	noise	1823	2-4948074127	1823 has referred a case to CEDD on 15 February 2019, which the complainant complained about the construction noise generated from the CEDD site near 法源寺 (Ma Yau Tong Village). The complainant requested for the details of works and the completion date, the complainant also requested CEDD to use other construction methods in order to re	In response to the complainant, CWSTVJV has proposed alternative quiet work method to alleviate the noise impact to the public. They will schedule the noisy activities to be carried out after 10am as far as practicable to minimize the impact to resident nearby, given that not affecting the site progress. Moreover, the coverage of acoustic barriers will be extended in view of the works programme.	no comment by IEC on 29 Mar 2019	TCS00864/16/300/F0251a
42	21-Feb-19	25-Feb-19	Anderson Road Quarry Site	Undisclosed	noise	EPD	NA	The resident from Sau Hong House complained that the noise from the Anderson Road Quarry construction site has gotten worse. In addition, sometimes even after midnight there are noise coming from the site. With the echo produces from the environment, this is not helping at all. Really a big disturbance to the residence in the area. The complainant suspecting the sound proof measure has lessen as time goes. Follow action is requested.	In our investigation, CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. However, to eliminate the inconvenience caused to the nearby resident, CWSTVJV should properly maintain the noise mitigation measures as appropriate, such as maintain good site practices such as intermittent use of machine and plant and Sequencing operation of construction plant equipment. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance. erway by ET.	no comment by IEC on 28 Mar 2019	TCS00864/16/300/F0250
43	21-Feb-19	26-Feb-19	Anderson Road Quarry Site	Undisclosed	noise	received by DEVB and referred to CEDD	NA	A public complaint was received by DEVB and referred to CEDD on 25 February 2019 regarding on the noise generated from the construction works of the Anderson Road Quarry Site affecting a local resident residing at the Anderson Road Squatter Area	Additional acoustic mat has been erected in front of the Squatter Area to minimize the noise impact. Noise mitigation measures such as acoustic barriers erected along the works area and breaker head wrapped with acoustic material were implemented continually. Alternative quiet work method was adopted such as drilling the hard rock before the breaking work to reduce the breaking duration. In our investigation, CWSTVJV had enhanced the noise mitigation measures to ease the complainant's concerns.. CWSTVJV will continually implement the noise mitigation measures to reduce to noise impact to the public.	no comment by IEC on 29 Mar 2019	TCS00864/16/300/F0252a
44	1-Mar-19	26-Feb-19	E3 of Contract 2	Undisclosed	noise	CEDD	NA	A complaint is forwarded by CEDD which was received by KTDC member Mr CHENG Keung Fung from the residents of Tsui Yeung House(翠楊樓) about the noise nuisance generated and the working time up to 7:00 pm from the rock excavation of E3 lift tower. Follow up action is requested.	Under investigated by ET.		

To **Mr. Tommy Li** Fax No **By e-mail**

Company **AECOM**

cc

From **Nicola Hon** Date **19 March 2019**

Our Ref **TCS00864/16/300/F0248a** No of Pages **6** (Incl. cover sheet)

RE **CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works
Investigation Report for Environmental Complaint for Polluted Water Suspected
Discharge from Construction Site**

If you do not receive all pages, or transmission is illegible, please contact the originator on (852) 2959-6059 to re-send. Should this facsimile be sent to the wrong fax number, would receiver please destroy this copy and notify Action-United Environmental Services & Consulting immediately. Thank you.

Dear Sir,

Enclosed please find the investigation report for the captioned for your follow up action.

Should you have any queries or need further information, please do not hesitate to contact us or the undersigned at **Tel: 2959-6059 or Fax: 2959-6079**.

Yours Faithfully,
For and on Behalf of
Action-United Environmental Services & Consulting



Nicola Hon
Environmental Consultant

Encl.

EPD	Ms. Hsu Ping Ping, Alice	Fax: 2591 0558
EPD	Mr. Paul Wong	Fax: 2756 8588
CEDD/BCP	Mr. Kelvin Leung (Ch Eng/E2)	Fax: 2739 0076
ANewR (IEC)	Mr. Adi Lee	By e-mail
CWSTVJV	Mr. TY Leung	By e-mail

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

Complaint Log No.	NTE/07/2016 – 39
Received Date by ET	29 January 2019
Related Contracts	Contract 1 (NE/2016/01)
Complaint Details	Complainant discovered a stream in Po Lam Road and Ma Yau Tong Village was polluted by silt and mud that was discharged from a nearby outfall. The catchpit, the U-channel and the stream bed of the natural section of this stream were unusually covered by mud and silt. Since there is construction work at the nearby Anderson Road Quarry, the polluted water was suspected discharged from this construction site.
Complaint Location	Anderson Road Quarry Site
Date of Complaint	22 January 2019
Environmental Aspect	Water quality
Complainant	World Wide Fund (WWF)
Complaint Route	Received by EPD
Investigation Result	<ol style="list-style-type: none"> On 22 January 2019, WWF raised concerns to relevant government department including DSD, EPD and AFCD regarding a stream in Po Lam Road and Ma Yau Tong Village was polluted by silt and mud that was discharged from a nearby outfall. The catchpit, the U-channel and the stream bed of the natural section of this stream were unusually covered by mud and silt. Since there is construction work at the nearby Anderson Road Quarry, the polluted water was suspected discharged from this construction site. Photos provided by the complainant are shown in Photos 1 to 4 and the complaint location is shown in Figure 1. As advised by Contractor of Contract 1 (CWSTVJV), as water quality mitigation measures, wastewater treatment facilities were implemented at outfalls and wastewater generated from the construction site was treated before discharge of site. All discharge from construction site was treated by wastewater treatment facilities before discharge into public storm drainage system. Joint site inspection among the RE, CWSTVJV and ET was carried out on 29 January 2019 for the complaint investigation. It was observed that the flowing water in the concerned catchpit and channel was clear. However, accumulation of silt was found at the bed of the catchpit. There were no mud and silt found on the concerned U-channel, however at further downstream, the natural section of the stream was covered by mud and silt. (Photos 5 to 9) As advised by CWSTVJV, the discharge from construction site was limited during dry season. In response to the complainant, they would conduct cleaning work on the affected area where accessible to prevent further contamination. Follow up site inspection was conducted on 14 and 21 February 2019. It was observed that the silt in the catchpit has been cleaned. (Photo 10) As advised CWSTVJV, the cleaning work at

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works
Investigation Report on Environmental Complaint / Enquires

	<p>natural section is not feasible as entey to natural river course area is prohibited unless approved by relevant government department. Moreover, inspection was conducted on the wastewater treatment facilities and it was observed that the effluent quality was visually clear. <i>(Photos 11 & 12)</i> No adverse water quality impact was recorded during the site inspection.</p> <p>5. In our investigation, the concerned catchpit and U-channel mainly received the runoff from Po Lam Road as well as the discharge from the Anderson Road Quarry Site. It is suspected that the mud and silt found on the downstream has been accumulated over time particularly by rainstorm as well as routine discharge from construction site. As remedial action, CWSTVJV immediately clean the affected area where accessible. Nevertheless, in order to protection the watercourse at downstream of the construction site, CWSTVJV has some enhancement measures as following.</p> <p>(a) Maintain daily check of the water at discharge point from Q3 & Q5 by on Site operation staff;</p> <p>(b) Check the condition of discharge point once a week for Q3 to ensure the situation that is fine and reduce the risk of silty / muddy material wash to downstream by on Site operation staff;</p> <p>(c) Sediment level inside the Wastewater Treatment Systems (WWTS) (including but not limited to sedimentation tank(s) and AquaSed(s) or equivalent) shall be maintained below one-third of the effective sedimentation depth and to a status that not hinder the water flow at all time; and</p> <p>(d) The WWTS and their ancillary equipment (e.g. pump(s), pipe(s), power connection(s), etc.) must be properly maintained to ensure their effectiveness & efficiency.</p> <p>6. The RE will review the enhancement measures have been implemented properly. Moreover, ET will carry out regular inspection at the concerned area and implementation status of mitigation measure to ensure no non-compliance of water quality happened in the construction site.</p>
--	---

Prepared By : Nicola Hon

Designation : Environmental Consultant

Signature :



Date : 19 March 2019

Photo Record



Photo 1

Photo provided by the complainant.



Photo 2

Photo provided by the complainant.



Photo 3

Photo provided by the complainant.



Photo 4

Photo provided by the complainant.



Photo 5

Joint site inspection on 29 January 2019, it was observed that the flowing water in the concerned catchpit and channel was clear.



Photo 6

However, accumulation of silt was found at the bed of the catchpit.



Photo 7

It was observed that the flowing water in the concerned U-channel was clear and no mud and silt were observed.



Photo 8

It was observed that the flowing water in the concerned U-channel was clear and no mud and silt were observed.



Photo 9

At further downstream, the natural section of the stream was covered by mud and silt.



Photo 10

Follow up site inspection was conducted on 14 and 21 February 2019. It was observed that the silt in the catchpit was cleaned.



Photo 11

Inspection was conducted on the wastewater on 14 February 2019 and it was observed that the effluent quality was visually clear.



Photo 12

Inspection was conducted on the wastewater on 21 February 2019 and it was observed that the effluent quality was visually clear.

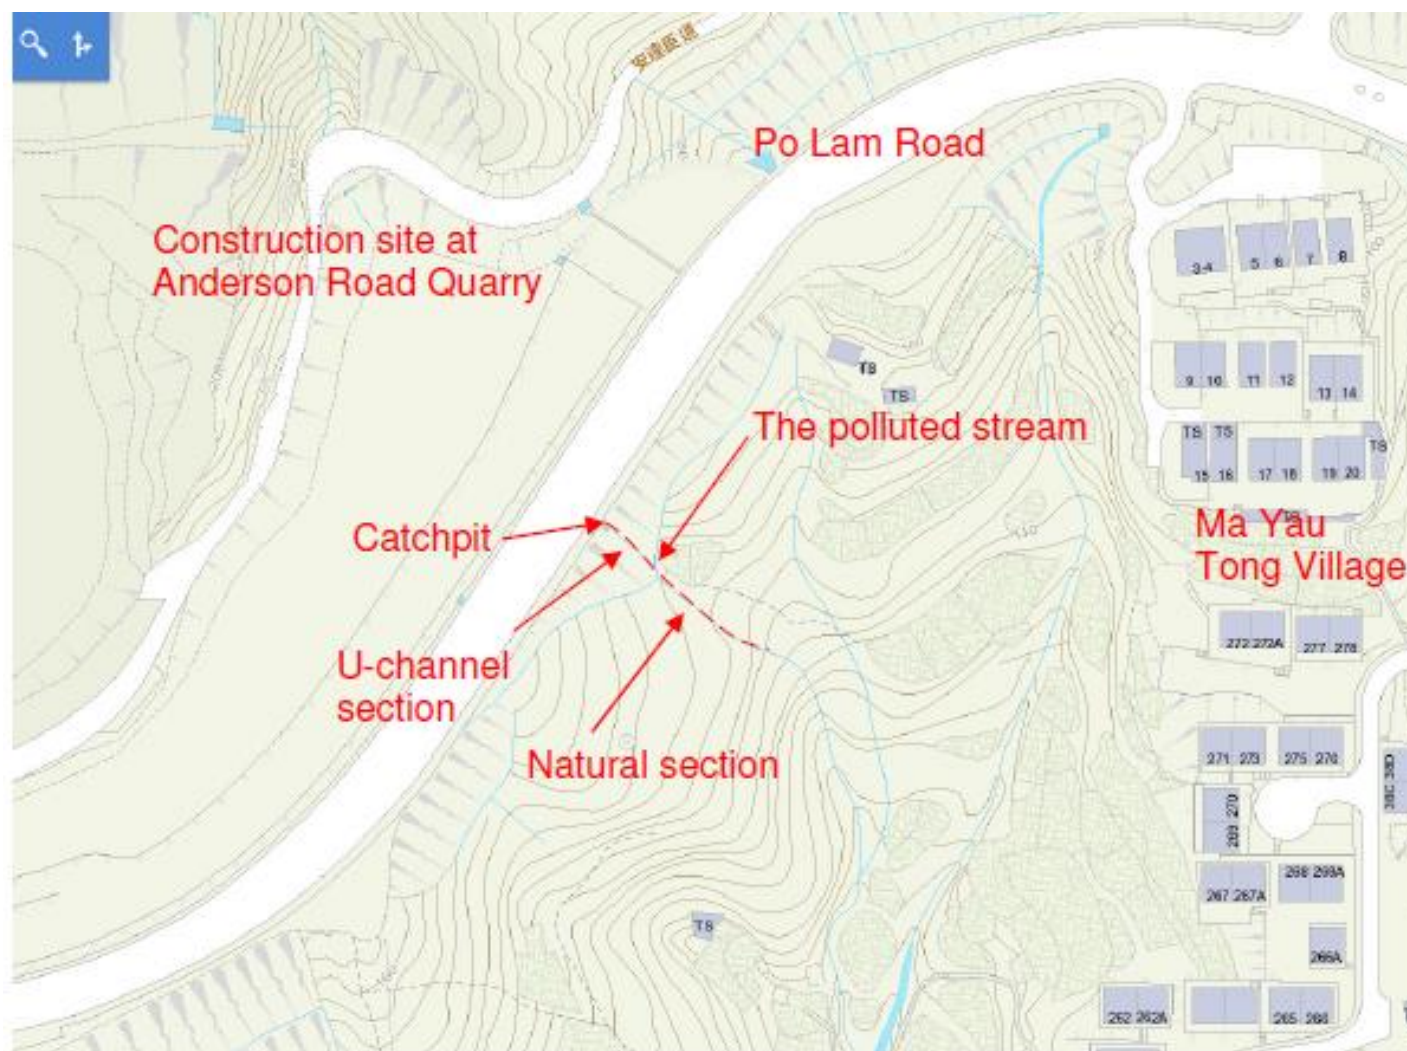


Figure 1 The Complaint Location

To **Mr. Tommy Li** Fax No **By e-mail**

Company **AECOM**

cc

From **Nicola Hon** Date **25 March 2019**

Our Ref **TCS00864/16/300/F0250** No of Pages **5** (Incl. cover sheet)

RE **CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works
Investigation Report for Noise Complaint from resident of Sau Hong House of Sau
Mau Ping Estate**

If you do not receive all pages, or transmission is illegible, please contact the originator on (852) 2959-6059 to re-send. Should this facsimile be sent to the wrong fax number, would receiver please destroy this copy and notify Action-United Environmental Services & Consulting immediately. Thank you.

Dear Sir,

Enclosed please find the investigation report for the captioned for your follow up action.

Should you have any queries or need further information, please do not hesitate to contact us or the undersigned at **Tel: 2959-6059 or Fax: 2959-6079**.

Yours Faithfully,
For and on Behalf of
Action-United Environmental Services & Consulting



Nicola Hon
Environmental Consultant

Encl.

EPD	Ms. Hsu Ping Ping, Alice	Fax: 2591 0558
EPD	Mr. Paul Wong	Fax: 2756 8588
CEDD/BCP	Mr. Kelvin Leung (Ch Eng/E2)	Fax: 2739 0076
ANewR (IEC)	Mr. Adi Lee	By e-mail
CWSTVJV	Mr. TY Leung	By e-mail

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

Complaint Log No.	NTE/07/2016 – 41
Received Date by ET	25 February 2019
Related Contracts	Contract 1 (NE/2016/01)
Complaint Details	Resident from Sau Hong House complained that the noise from the Anderson Road Quarry construction site has gotten worse. In addition, sometimes even after midnight there are noise coming from the site. With the echo produces from the environment, this is not helping at all. Really a big disturbance to the residence in the area. The complainant suspecting the sound proof measure has lessen as time goes.
Complaint Location	Anderson Road Quarry Site
Date of Complaint	21 February 2019
Environmental Aspect	Noise
Complainant	Resident of Sau Mau Ping Estate Sau Hong House
Complaint Route	EPD
Investigation Result	<ol style="list-style-type: none"> 1. A public complaint was received by EPD regarding the construction noise generated from the Anderson Road Quarry construction site and sometimes even after midnight as described in “Complaint Details”. According to the information provided by the complainant, the site layout and complaint location are shown in <i>Figure 1</i>. 2. Joint site inspection among the RE, Contractor of Contract NE/2016/01 (CWSTVJV) and ET was carried out on 26 February 2019 for investigation. It was observed that construction of permanent Retaining Wall and temporary drain was conducted near System A which opposite to the complaint location - Sau Hong House. As noise mitigation measures, erection of acoustic mat as temporary noise barrier was installed to screen the works area. (<i>Photo 1</i>) Moreover, alternative quiet work method such as drilling on hard rock before the breaking work was applied to reduce the duration of breaking activities. (<i>Photo 2</i>) 3. According to the site information provided by CWSTVJV, construction of Underpass was the only construction work carried out in Restricted hour with valid CNP no. GW-RE0060-19. As noise mitigation measures, acoustic door was closed and no Powered Mechanical Equipment (PME) would be operated and mobilized outside the tunnel area to comply with the CNP requirement. (<i>Photo 3</i>) There were no construction activities near the works area as concerned by the complainant. 4. According to the impact noise monitoring result obtained at On Tai Estate in February 2019, there were no breaches of EM&A requirement. In our investigation, CWSTVJV has implemented noise mitigation measures to reduce the noise impact to the nearby resident. However, to eliminate the inconvenience caused to the nearby resident, CWSTVJV should properly maintain the noise mitigation measures as appropriate, such as maintain good site

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

	<p>practices such as intermittent use of machine and plant and Sequencing operation of construction plant equipment. Since the works were carried out within the non-restricted hours, it is considered that the works under the project did not breach the Noise Control Ordinance.</p> <p>5. Nevertheless, in view of the subject site of the project is close to the residential area, CWSTVJV was reminded to implement the mitigation measures as far as practicable as recommended in the EM&A Programme.</p>
--	---

Prepared By : Nicola Hon

Designation : Environmental Consultant

Signature :



Date : 25 March 2019

Photo Record



Photo 1

During joint site inspection carried out on 26 February 2019, it was observed that construction of permanent Retaining Wall and temporary drain was conducted near System A which opposite to the complaint location - Sau Hong House. As noise mitigation measures, erection of acoustic mat as temporary noise barrier was installed to screen the works area.



Photo 2

Alternative quiet work method such as drilling on hard rock before the breaking work was applied to reduce the duration of breaking activities.



Photo 3

As noise mitigation measures, acoustic door was closed and no Powered Mechanical Equipment (PME) would be operated and mobilized outside the tunnel area to comply with the CNP requirement.

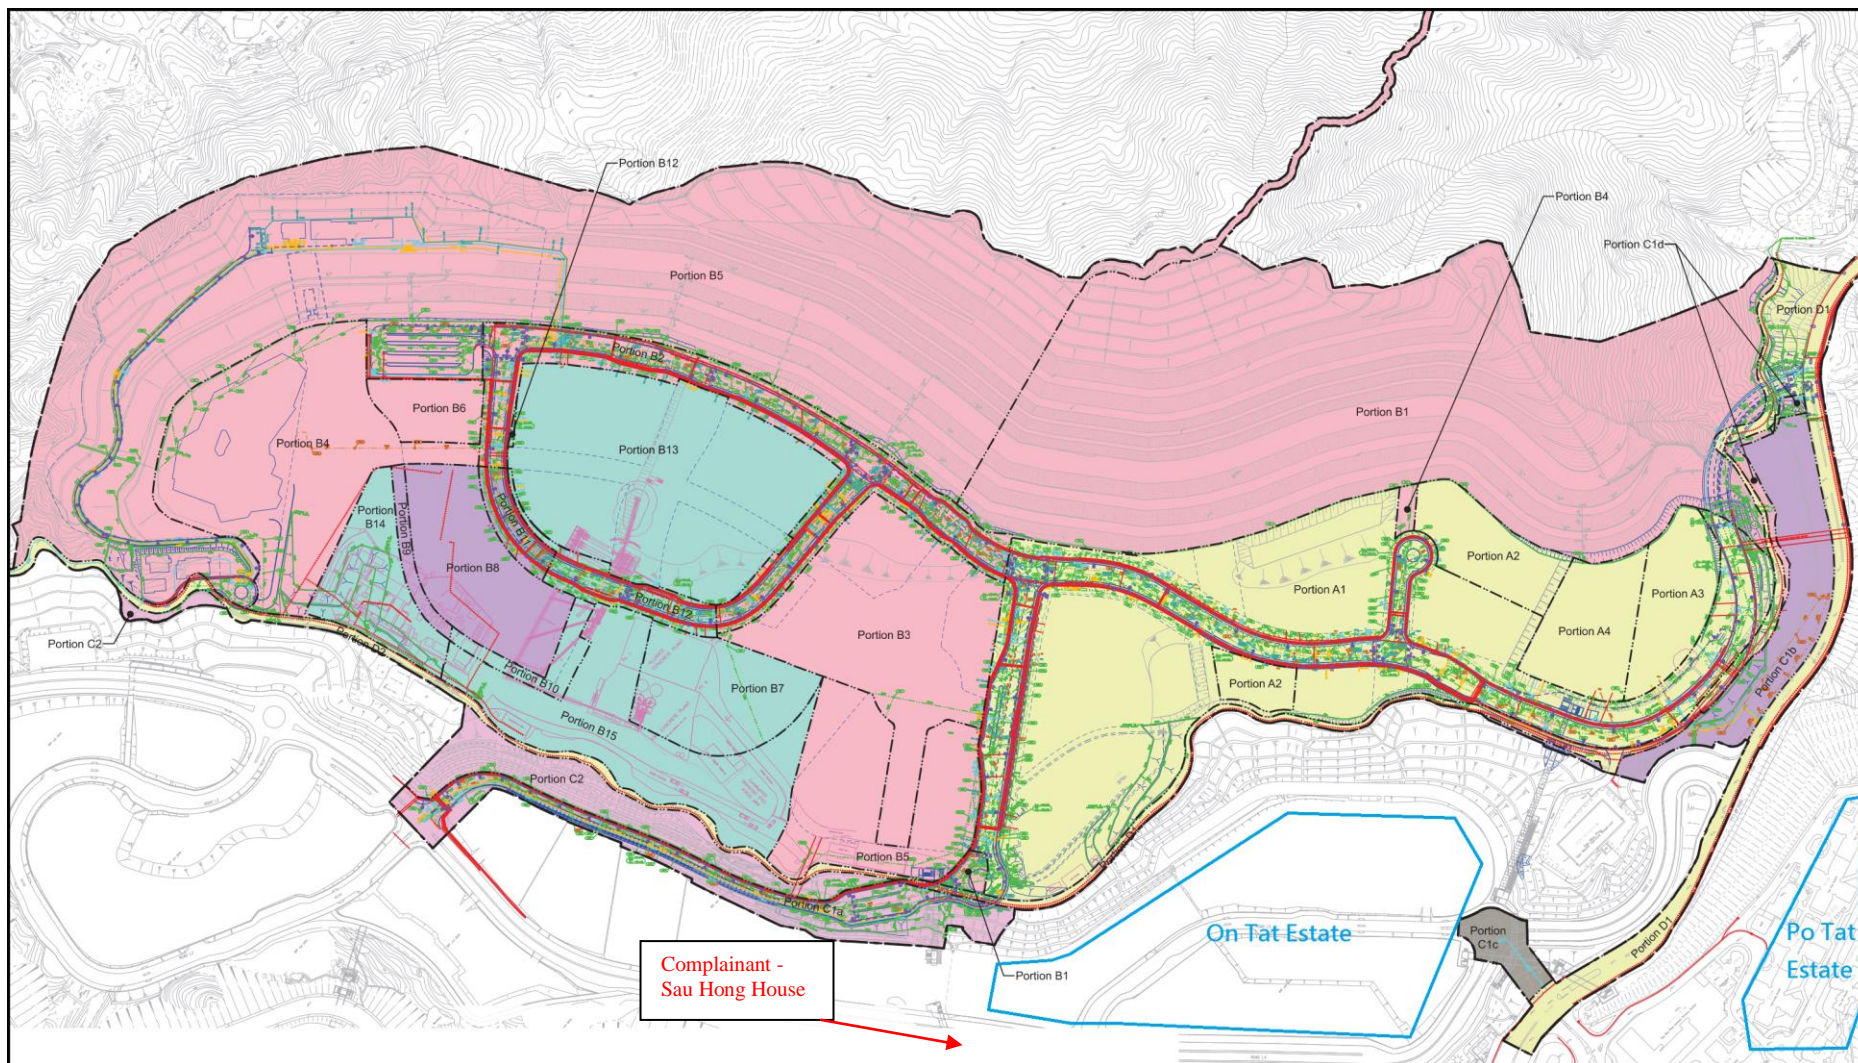


Figure 1 The Layout of NE/2016/01 and the Complaint Location

To **Mr. Tommy Li**

Fax No

By e-mail

Company **AECOM**

cc

From **Nicola Hon**

Date

25 March 2019

Our Ref **TCS00864/16/300/F0251a**

No of Pages

6

(Incl. cover sheet)

RE

CEDD Service Contract No. NTE/07/2016

Environmental Team for Development of Anderson Road Quarry Site –

Site Formation and Associated Infrastructure Works

Investigation Report for Noise Complaint from Villagers of Ma Yau Tong Village

If you do not receive all pages, or transmission is illegible, please contact the originator on (852) 2959-6059 to re-send. Should this facsimile be sent to the wrong fax number, would receiver please destroy this copy and notify Action-United Environmental Services & Consulting immediately. Thank you.

Dear Sir,

Enclosed please find the investigation report for the captioned for your follow up action.

Should you have any queries or need further information, please do not hesitate to contact us or the undersigned at **Tel: 2959-6059 or Fax: 2959-6079**.

Yours Faithfully,

For and on Behalf of

Action-United Environmental Services & Consulting



Nicola Hon

Environmental Consultant

Encl.

EPD

EPD

CEDD/BCP

ANewR (IEC)

CWSTVJV

Ms. Hsu Ping Ping, Alice

Mr. Paul Wong

Mr. Kelvin Cheung (Ch Eng/E2)

Mr. Adi Lee

Mr. TY Leung

Fax: 2591 0558

Fax: 2756 8588

Fax: 2739 0076

By e-mail

By e-mail

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

Complaint Log No.	NTE/07/2016 – 42
Received Date by ET	25 February 2019
Related Contracts	Contract 1 (NE/2016/01)
Complaint Details	1823 has referred a case to CEDD on 15 February 2019, which the complainant complained about the construction noise generated from the CEDD site near 法源寺 (Ma Yau Tong Village). The complainant requested for the details of works and the completion date, the complainant also requested CEDD to use other construction methods in order to reduce the impact bring to the resident nearby.
Complaint Location	East Portal opposite to Ma Yau Tong Village
Date of Complaint	15 February 2019
Environmental Aspect	Noise
Complainant	Miss Wong
Complaint Route	1823
Investigation Result	<ol style="list-style-type: none"> 1. A public complaint was received by 1823 and referred to CEDD on 15 February 2019 regarding the construction noise generated from the CEDD site near 法源寺 (Ma Yau Tong Village) as described in “Complaint Details” above. On 25 February 2019, the complainant contacted the SPRO and requested follow up action and improvement as soon as possible. She is not satisfied about the existing noise mitigation measures near Ma Yau Tong Village. Her additional requests are listed below: <ol style="list-style-type: none"> 1. To arrange additional noise monitoring near 法源寺，摘星台及傲雲峰 2. To find another appropriate machinery to replace the existing type for excavation and rock breaking 3. Further improvement of noise barriers 4. To expedite the works progress of the rock breaking 2. As advised Contractor of Contract 1 - NE/2016/01 (CWSTVJV), site formation for East Portal was conducted at East Portal which opposite to Ma Yau Tong Village. The works involved breaking activities generated noise impact and corresponding noise mitigation measures were in place properly to minimize the impact to resident nearby. The site layout and complaint location are shown in <i>Figure 1</i>. 3. During the RE’s inspection on 25 February 2019, it mentioned that the noise mitigation measure was insufficient to reduce the construction noise of east portal site formation work. CWSTVJV replied that the noise barriers, acoustic mat and screen were in place for noise mitigation based on the goodwill of JV to reduce the impact of noise to NSRs. They also deployed the drill to lower the overall intensity of rock breaking by making the holes / voids to aid the rock breaking process. Moreover, they had already extended the noise mitigation for rock breaking up the current excavation level and the ramp at Po Lam Road base on the

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

	<p>good intention of the Contractor.</p> <p>4. Joint site inspections among the RE, CWSTVJV and ET were carried out on 26 February 2019. It was observed that as noise mitigation measures, acoustic barriers were erected along the works area and breaker head were wrapped with acoustic material. (Photos 1 and 2) As advised by CWSTVJV, alternative quiet work method was adopted such as drilling the hard rock before the breaking work to reduce the breaking duration. (Photo 3)</p> <p>5. According to the impact noise monitoring result obtained at Ma Yau Tong Village in February 2019, there were no breaches of EM&A requirement which revealed that the construction noise received at representative NSR were within acceptable level. Since the existing noise monitoring station was selected as the representative sensitive receiver which agreed by ER, no additional noise monitoring at near 法源寺，摘星台及傲雲峰 is considered necessary which located farther to construction site.</p> <p>6. The SPRO made a reply to Mrs Wong on 28 February 2019 and she was satisfied with the reply. But she asked if it is possible to add one more layer of noise barrier where appropriate to further reduce the noise nuisance. Additional noise barrier was added in response to Mrs Wong's request. (Photo 4)</p> <p>7. In response to the complainant, CWSTVJV has proposed alternative quiet work method to alleviate the noise impact to the public. They will schedule the noisy activities to be carried out after 10am as far as practicable to minimize the impact to resident nearby, given that not affecting the site progress. Moreover, the coverage of acoustic barriers will be extended in view of the works programme.</p> <p>8. In our investigation, CWSTVJV had provided the noise mitigation measures to minimize the noise impact to the resident nearby. The impact monitoring result obtained at Ma Yau Tong Village revealed that the construction noise were within acceptable level. Since the works were conducted within approved normal hours with implementation of noise mitigation measures, there were no breaches of legislative requirement.</p>
--	--

Prepared By : Nicola Hon


Designation : Environmental Consultant

Signature :



Date : 25 March 2019

Photo Record

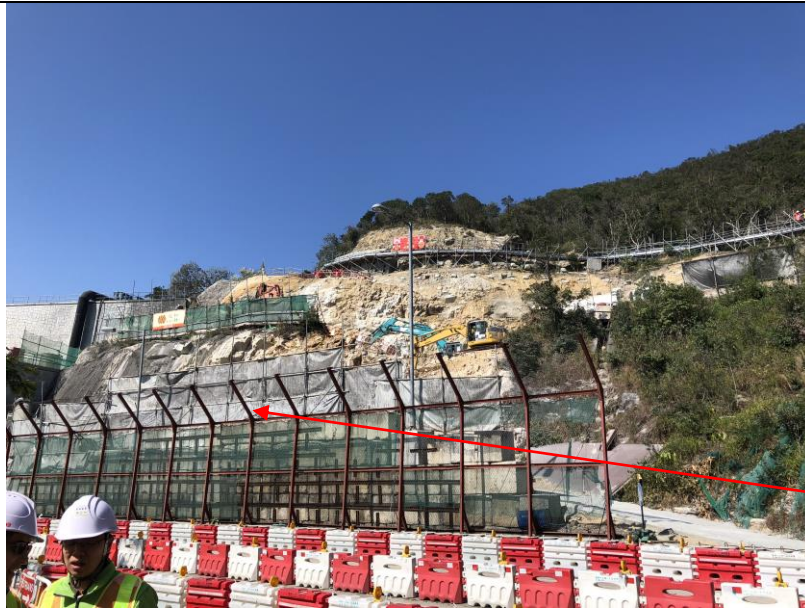

Acoustic barrier

Photo 1

Joint site inspections among the RE, CWSTVJV and ET were carried out on 26 February 2019. It was observed that as noise mitigation measures, acoustic barriers were erected along the works area.



Acoustic barrier

Breaker head were wrapped with acoustic material

Photo 2

Joint site inspections among the RE, CWSTVJV and ET were carried out on 26 February 2019. It was observed that as noise mitigation measures, acoustic barriers were erected along the works area and breaker head were wrapped with acoustic material.



Driller

Photo 3

As advised by CWSTVJV, alternative quiet work method was adopted such as drilling the hard rock before the breaking work to reduce the breaking duration.



Photo 4

Additional noise barrier was added in response to Mrs Wong's request.

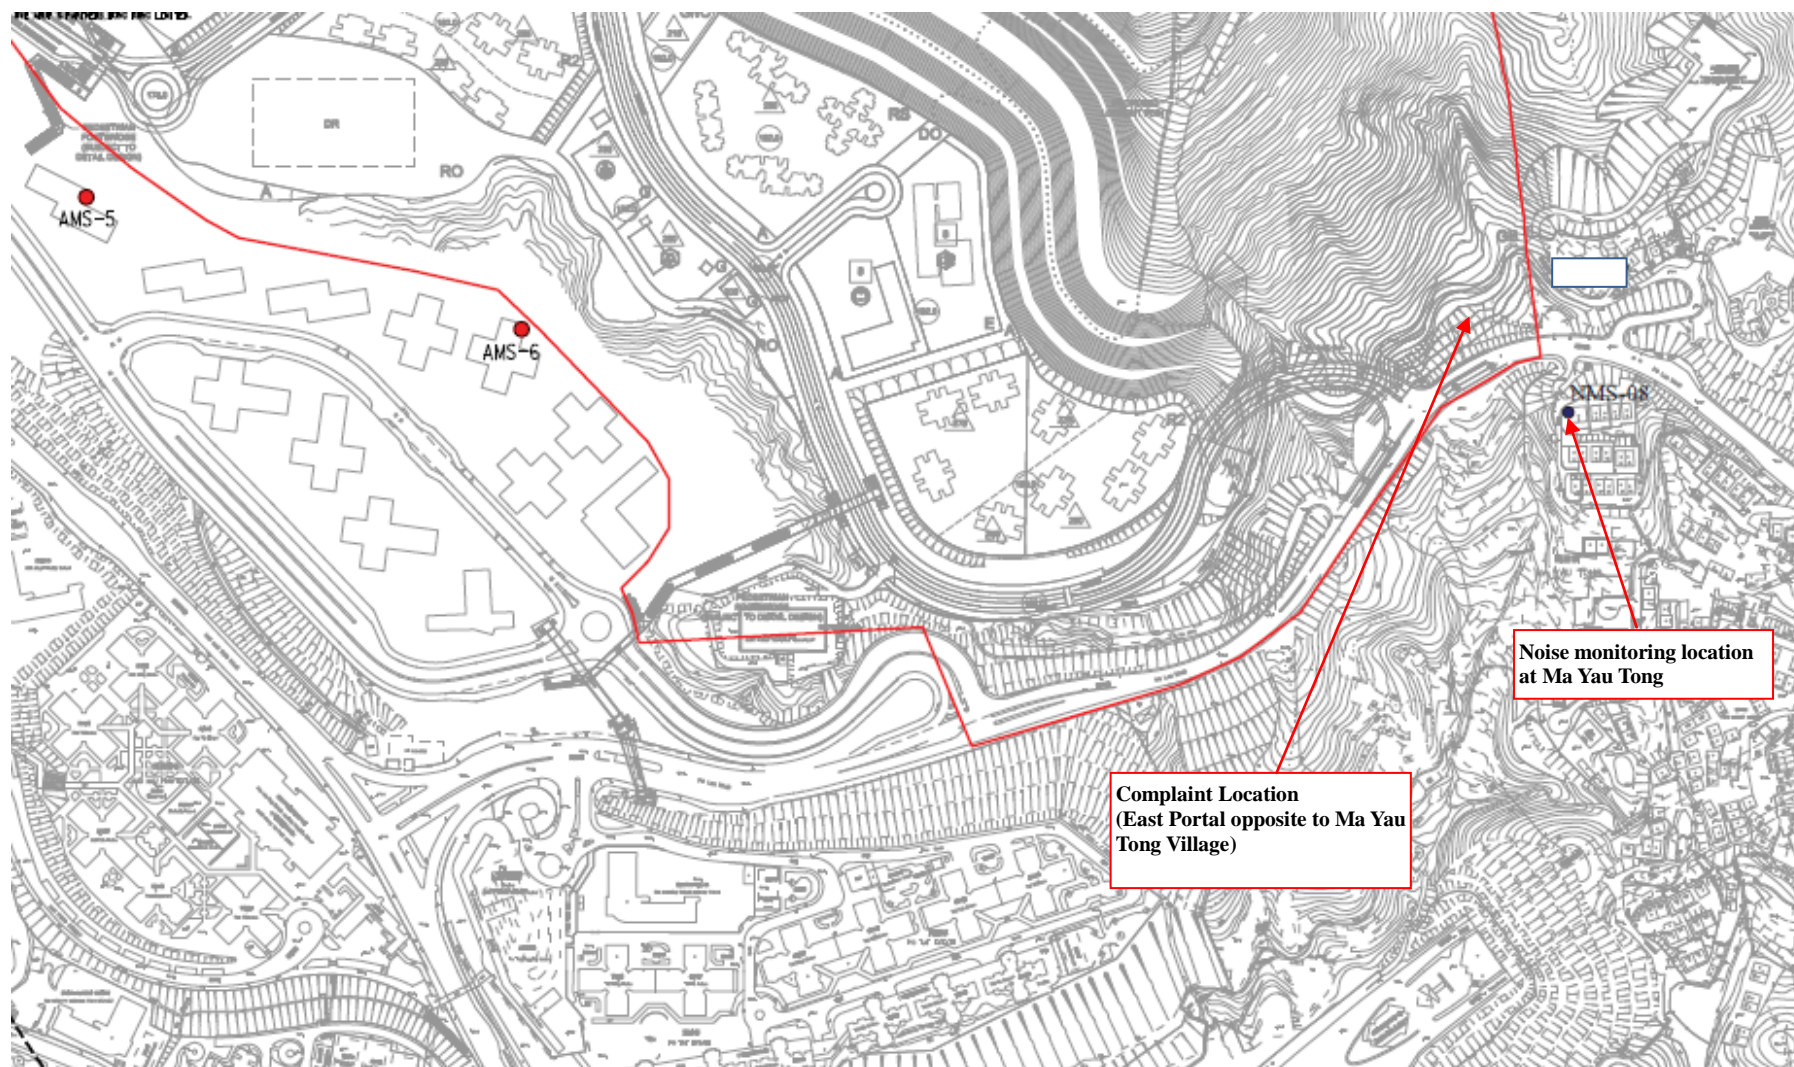


Figure 1 The Layout of NE/2016/01 and the Complaint Location

To **Mr. Tommy Li**

Fax No

By e-mail

Company **AECOM**

cc

From **Nicola Hon**

Date

29 March 2019

Our Ref **TCS00864/16/300/F0252a**

No of Pages

5

(Incl. cover sheet)

RE

CEDD Service Contract No. NTE/07/2016

Environmental Team for Development of Anderson Road Quarry Site –

Site Formation and Associated Infrastructure Works

Investigation Report for Noise Complaint from resident at the Anderson Road

Squatter Area

If you do not receive all pages, or transmission is illegible, please contact the originator on (852) 2959-6059 to re-send. Should this facsimile be sent to the wrong fax number, would receiver please destroy this copy and notify Action-United Environmental Services & Consulting immediately. Thank you.

Dear Sir,

Enclosed please find the investigation report for the captioned for your follow up action.

Should you have any queries or need further information, please do not hesitate to contact us or the undersigned at **Tel: 2959-6059 or Fax: 2959-6079.**

Yours Faithfully,

For and on Behalf of

Action-United Environmental Services & Consulting



Nicola Hon

Environmental Consultant

Encl.

EPD

Ms. Hsu Ping Ping, Alice

Fax: 2591 0558

EPD

Mr. Paul Wong

Fax: 2756 8588

CEDD/BCP

Mr. Kelvin Cheung (Ch Eng/E2)

Fax: 2739 0076

ANewR (IEC)

Mr. Adi Lee

By e-mail

CWSTVJV

Mr. TY Leung

By e-mail

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

Complaint Log No.	NTE/07/2016 – 43
Received Date by ET	26 February 2019
Related Contracts	Contract 1 (NE/2016/01)
Complaint Details	投訴人表示現在與太太居住於安達臣道寮屋區，其表示由於安達臣道工程就在其家中旁邊，而工程機械所產生的噪音非常大，而且令其不能入睡，而令其精神狀況不佳
Complaint Location	East Portal opposite to Ma Yau Tong Village
Date of Complaint	21 February 2019
Environmental Aspect	Noise
Complainant	Mr. Liu (referred by Kwun Tong DC member)
Complaint Route	received by DEVB and referred to CEDD
Investigation Result	<ol style="list-style-type: none"> 1. A public complaint was received by DEVB and referred to CEDD on 25 February 2019 regarding on the noise generated from the construction works of the Anderson Road Quarry Site affecting a local resident residing at the Anderson Road Squatter Area as described in “Complaint Details” above. The site layout and complaint location are shown in Figure 1. 2. As advised Contractor of Contract 1 - NE/2016/01 (CWSTVJV), site formation for East Portal was conducted at East Portal which opposite to Ma Yau Tong Village. The works involved breaking activities generated noise impact and corresponding noise mitigation measures were in place properly to minimize the impact to resident nearby. 3. On 26 February 2019, the SPRO of AECOM and CWSTVJV visited the complainant at the Squatter Area to understand his concerns. CWSTVJV agreed to add temporary noise barrier to the pedestrian roads which in front of his home in order to reduce the noise of the works. The proposed remedial measure was satisfied by complainant upon the site visit. 4. Joint site inspections among the RE, CWSTVJV and ET were carried out on 7 March 2019. It was observed additional acoustic mat has been erected in front of the Squatter Area to minimize the noise impact. (Photo 1) Moreover, noise mitigation measures such as acoustic barriers erected along the works area and breaker head wrapped with acoustic material were implemented continually. Alternative quiet work method was adopted such as drilling the hard rock before the breaking work to reduce the breaking duration. (Photo 2) 5. According to the impact noise monitoring result obtained at Ma Yau Tong Village in February 2019, there were no breaches of EM&A requirement which revealed that the construction noise received at representative NSR were within acceptable level. 6. In our investigation, CWSTVJV had enhanced the noise mitigation

CEDD Service Contract No. NTE/07/2016
Environmental Team for Development of Anderson Road Quarry Site –
Site Formation and Associated Infrastructure Works

Investigation Report on Environmental Complaint / Enquires

	measures to ease the complainant's concerns. As advised by CWSTVJV, the breaking work is expected to be completed in July 2019. CWSTVJV will continually implement the noise mitigation measures to reduce to noise impact to the public. Since the works were conducted within approved normal hours with implementation of noise mitigation measures, there were no breaches of legislative requirement.
--	--

Prepared By : Nicola Hon

Designation : Environmental Consultant

Signature :



Date : 29 March 2019

Photo Record



Photo 1

Joint site inspections among the RE, CWSTVJV and ET were carried out on 7 March 2019. It was observed additional acoustic mat has been erected in front of the Squatter Area to minimize the noise impact.

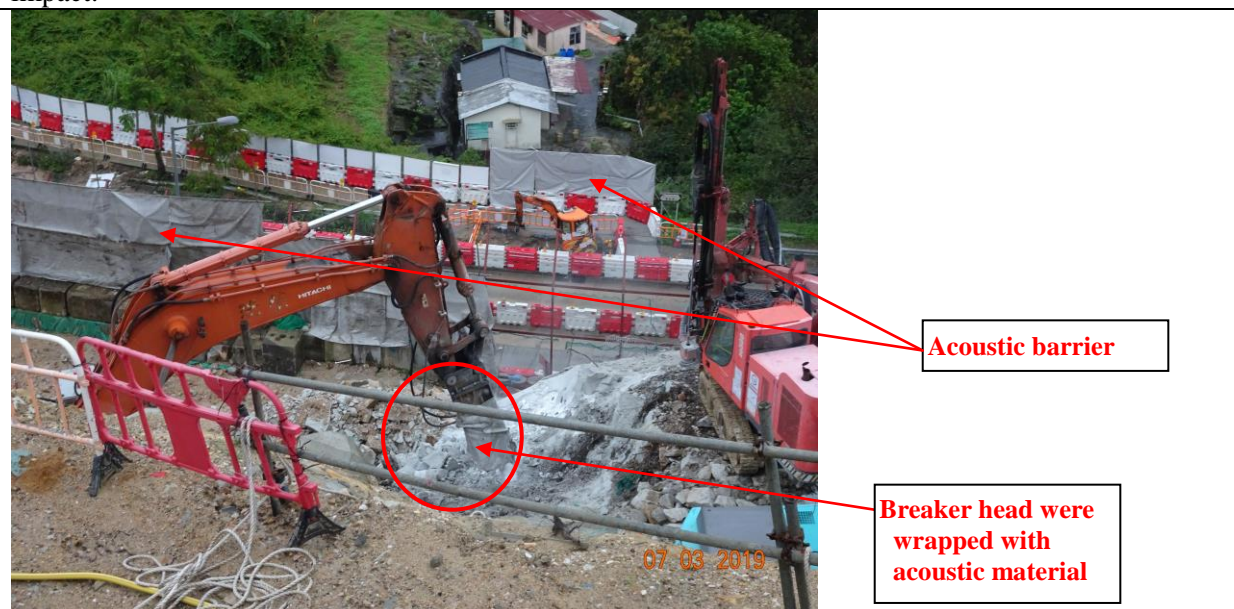


Photo 2

Joint site inspections among the RE, CWSTVJV and ET were carried out on 26 February 2019. It was observed that as noise mitigation measures, acoustic barriers were erected along the works area and breaker head were wrapped with acoustic material.

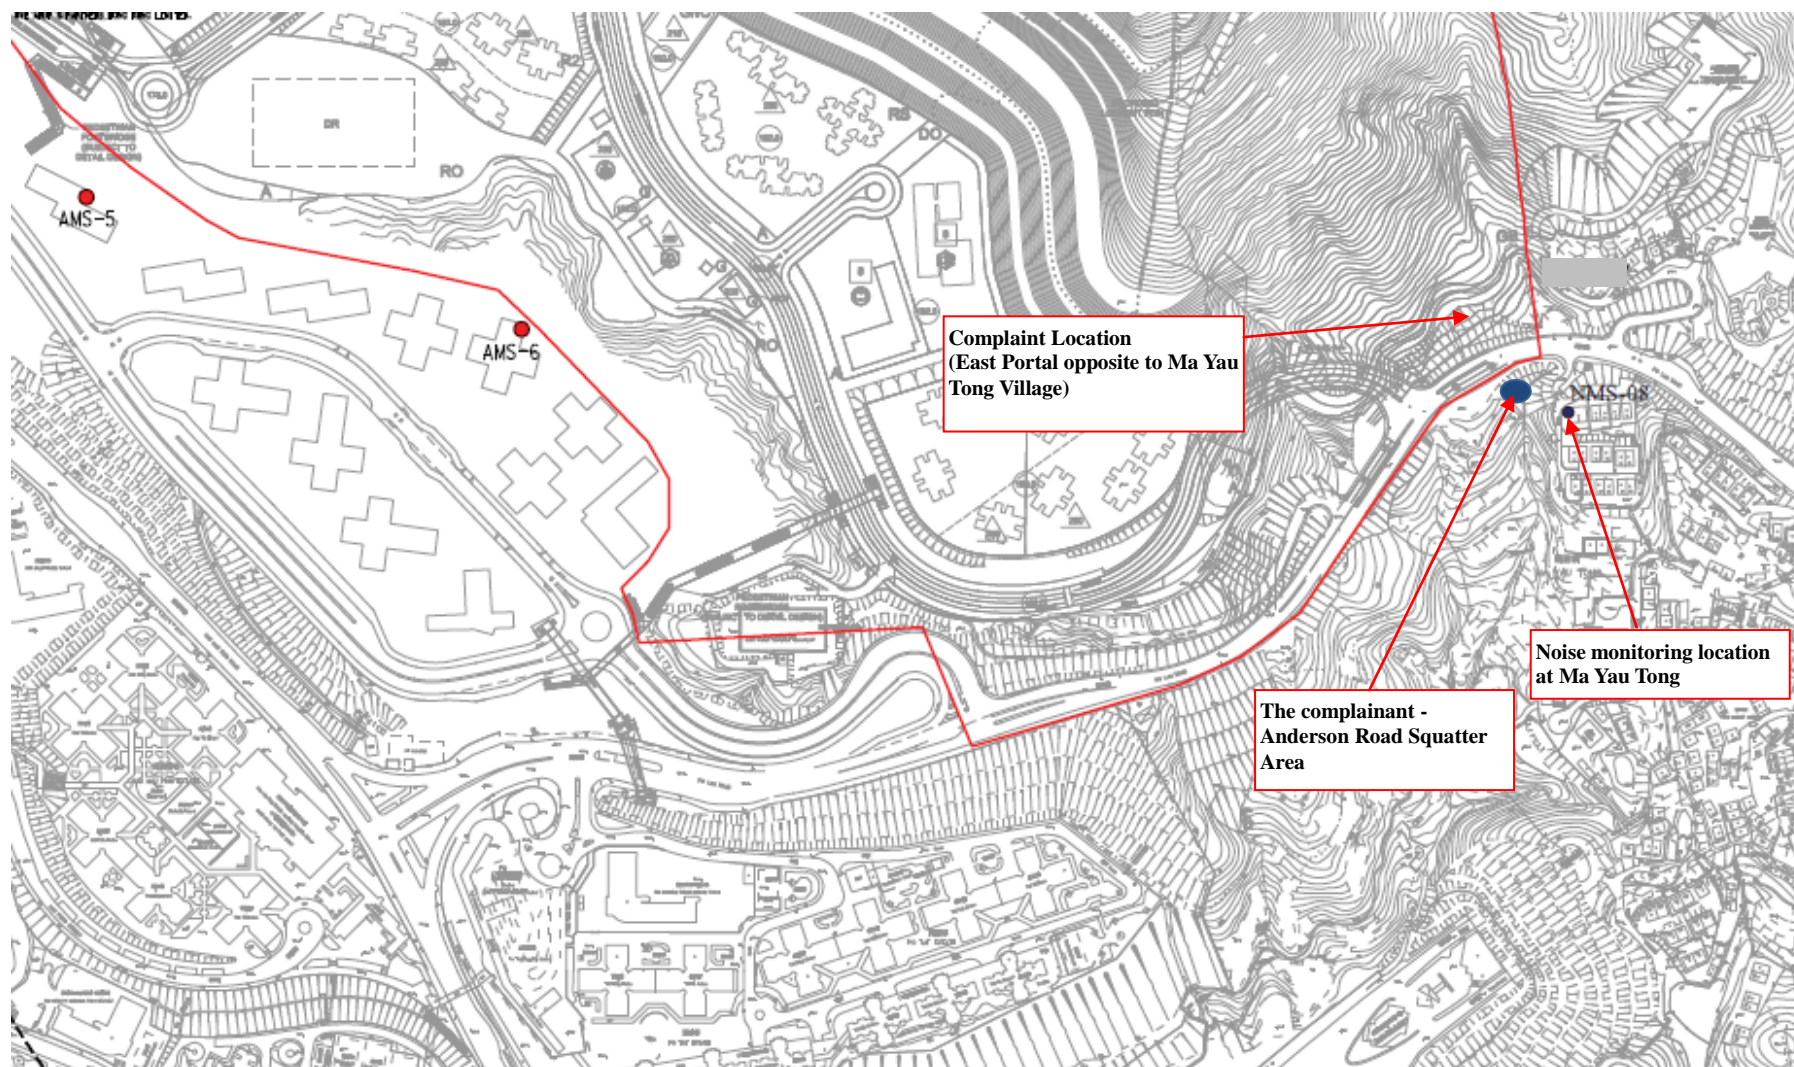


Figure 1 The Layout of NE/2016/01 and the Complaint Location